

NORMAL WEIGHT CONCRETE

DESIGN GUIDE

LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS

CJ-SERIES

Normal Weight Concrete



SJI COMPOSITE STEEL JOIST WEIGHT TABLES

The following tables may be used as a guide to assist with preliminary designs for floor and roof construction utilizing composite steel joists. These weight tables only apply to uniformly loaded composite steel joists with parallel chords. The top chords are considered as laterally supported by the structural deck and slab. The tables are applicable for normal weight concrete with a unit weight of 145 pcf (2350 kg/m³) and light weight concrete with an assumed unit weight of 110 pcf (1800 kg/m³) and based on a steel yield strength of 50 ksi (345 MPa). Concrete strength listed in the weight tables can vary from 3 – 5 ksi (20.7 – 34.5 MPa), with the higher concrete strength required for longer joist spans. The tables also include a provision based on a one-half span live load condition.

The first row of figures for each joist depth, denoted as “**Wt**”, gives the approximate weight of the composite steel joists in pounds per linear foot, plf (kilonewtons per meter, kN/m). These weights do not include accessories or bridging.

The second row, noted as “**W360**” are the composite live loads in pounds per linear foot, plf (kilonewtons per meter, kN/m) of joist which will produce an approximate composite deflection of 1/360 of the span. Live loads which will produce a composite deflection other than 1/360 of the span may be obtained by using the W360 figures. For example, to obtain the load for a deflection of 1/480 of the span, $W_{480} = W_{360} \times (360/480)$.

The third row denoted as “**N-ds**” lists the quantity and diameter of welded shear studs required per joist to carry the indicated Total Factored Uniformly Distributed Load. The installed shear stud length in inches is assumed to be equal to the deck height, in., + concrete thickness, in., above the deck – 1/2 inch (the stud length in millimeters is assumed to be equal to the deck height, mm, + concrete thickness, mm, above the deck – 13 mm). When determining the quantity of shear studs listed in the following tables, all studs are assumed to be installed in the “weak” position as shown in Figure 16.

The fourth row noted as “**I_{eff}**” lists the effective moment of inertia for the joist that will allow the Specifying Professional to determine the deflection under composite loading.

The fifth row indicates the number of rows and type of bridging. For more information on bridging type, size, and bridging forces, the Specifying Professional should refer to the Composite Joist Bridging Tables.

A description of the terms and abbreviations used in the weight tables is provided below:

- t_c** = Thickness of concrete above the top of the deck, in. (mm)
- h_r** = Nominal deck rib height, in. (mm)
- Js** = Joist spacing, ft. (m)
- TL** = Total factored uniform load applied to the composite steel joist, plf (kN/m).
- Wt** = Weight of composite steel joist, plf (kN/m).
- W360** = Composite load, plf (kN/m) applied after the concrete has cured that produces an approximate deflection of 1/360 of the span.
- N-ds** = Number of shear studs required/span – diameter of shear stud.
- I_{eff}** = Composite moment of inertia, in.⁴ (mm⁴)

The shaded areas of the weight tables indicate the different seat depths, where the blue shaded area represents a 2 1/2 in. seat; white a 5 in. seat; and green a 7 1/2 in. seat. These seat depths are based on the following criteria:

2 1/2 inches:

Where round web end bars are used and the top chord vertical angle leg is less than or equal to 2 inches.

5 inches:

Where the top chord vertical angle leg is greater than 2 inches, but less than 3 1/2 inches.

7 1/2 inches:

Where the top chord vertical angle leg is greater than or equal to 3 1/2 inches.

There are many design combinations and criteria that need to be considered for the proper design of a composite steel joist such as joist depth, span and spacing, deck type and thickness, concrete strength, concrete unit weight, shear stud diameter, shear stud length, deflection limitations, minimum duct size openings, panel layouts, UL fire rating, etc. The “SJI Composite Joist Floor Design Parameters Checklist” contained in the Code of Standard Practice for Composite Steel Joists and the “Responsibility of the Specifying Professional” may be used to help tailor your design to a specific project.



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
BEARING HEIGHT		2 1/2"	5"	7 1/2"							
Concrete Slab Parameters											
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi											
hr (in.)		1	1	1	1	1	1	1	1	1	
tc (in.)		2	2	2	2	2	2	2	2	2	
Js (ft.)		3	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
20	10	Wt(plf)	5.0	5.2	5.6	6.2	6.7	7.2	7.6	8.1	10.4
		W360(plf)	248	248	296	340	404	439	468	530	639
		N-ds	12-3/8"	12-3/8"	14-3/8"	18-3/8"	22-3/8"	24-3/8"	26-3/8"	30-3/8"	22-1/2"
		leff(in4)	46	46	55	63	75	82	87	99	119
		Bridging	(2)H	(1)H							
	12	Wt(plf)	5.1	5.3	5.7	6.2	6.4	7.1	7.5	7.8	9.9
		W360(plf)	316	316	379	420	436	519	563	608	730
		N-ds	12-3/8"	12-3/8"	14-3/8"	16-3/8"	18-3/8"	22-3/8"	24-3/8"	26-3/8"	18-1/2"
		leff(in4)	59	59	71	78	81	97	105	113	136
		Bridging	(2)H	(1)H							
	14	Wt(plf)	5.1	5.3	5.4	5.9	6.3	6.4	7.0	8.4	9.5
		W360(plf)	396	396	396	477	529	550	602	696	820
		N-ds	12-3/8"	12-3/8"	12-3/8"	14-3/8"	16-3/8"	18-3/8"	20-3/8"	12-1/2"	16-1/2"
		leff(in4)	74	74	74	89	98	102	112	130	153
		Bridging	(2)H	(1)H	(1)H						
	16	Wt(plf)	5.2	5.3	5.5	5.9	6.2	6.8	7.9	8.1	9.9
		W360(plf)	488	488	488	589	589	663	711	790	970
		N-ds	12-3/8"	12-3/8"	12-3/8"	14-3/8"	14-3/8"	16-3/8"	10-1/2"	12-1/2"	14-1/2"
		leff(in4)	91	91	91	110	110	123	132	147	181
		Bridging	(1)H								
	18	Wt(plf)	5.2	5.2	5.3	5.3	5.7	5.8	6.1	6.5	6.9
		W360(plf)	620	620	620	620	751	751	835	964	1058
		N-ds	12-3/8"	12-3/8"	12-3/8"	12-3/8"	14-3/8"	14-3/8"	16-3/8"	20-3/8"	22-3/8"
		leff(in4)	116	116	116	116	140	140	155	179	197
		Bridging	(1)H								
	20	Wt(plf)	5.3	5.3	5.3	5.4	5.4	5.4	5.7	6.1	7.5
		W360(plf)	717	717	717	717	867	867	963	1028	1284
		N-ds	12-3/8"	12-3/8"	12-3/8"	12-3/8"	14-3/8"	14-3/8"	16-3/8"	16-3/8"	12-1/2"
		leff(in4)	133	133	133	133	161	161	179	191	239
		Bridging	(1)H								
	24	Wt(plf)	5.4	5.4	5.4	5.5	5.9	5.9	5.8	6.2	8.0
		W360(plf)	898	898	898	898	1084	1084	1200	1284	1605
		N-ds	12-3/8"	12-3/8"	12-3/8"	12-3/8"	14-3/8"	14-3/8"	16-3/8"	16-3/8"	12-1/2"
		leff(in4)	167	167	167	167	202	202	224	239	299
		Bridging	(1)H								
	28	Wt(plf)	5.7	5.7	5.7	5.8	6.2	6.2	6.4	6.4	8.2
		W360(plf)	1059	1059	1059	1059	1274	1274	1407	1506	1886
		N-ds	12-3/8"	12-3/8"	12-3/8"	12-3/8"	14-3/8"	14-3/8"	16-3/8"	16-3/8"	12-1/2"
		leff(in4)	197	197	197	197	237	237	262	280	351
		Bridging	(1)H								
32	Wt(plf)	5.9	5.9	5.9	6.0	6.0	6.1	6.6	7.7	7.8	
	W360(plf)	1198	1198	1198	1198	1198	1467	1648	1704	2125	
	N-ds	12-3/8"	12-3/8"	12-3/8"	12-3/8"	12-3/8"	14-3/8"	16-3/8"	10-1/2"	12-1/2"	
	leff(in4)	223	223	223	223	223	273	307	317	396	
	Bridging	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength													
BEARING HEIGHT	2 1/2"	5"	7 1/2"										
Concrete Slab Parameters													
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi													
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot													
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500	4500
11.2	12.8	13.6	15.8	16.3	17.4	20.0	23	23	24	26	28	29	
770	882	961	1103	1162	1239	1380	1579	1755	1866	1941	2015	2116	
24-1/2"	28-1/2"	32-1/2"	24-5/8"	26-5/8"	28-5/8"	24-3/4"	30-3/4"	26-3/4"	30-3/4"	30-3/4"	32-3/4"	36-3/4"	
143	164	179	205	216	231	257	294	327	347	361	375	394	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
11.0	11.5	12.9	13.2	15.7	16.3	17.8	19.8	21	22	24	25	28	
879	965	1061	1161	1322	1377	1549	1656	1898	2017	2164	2301	2492	
22-1/2"	24-1/2"	26-1/2"	28-1/2"	20-5/8"	24-5/8"	28-5/8"	30-5/8"	20-3/4"	22-3/4"	26-3/4"	30-3/4"	32-3/4"	
164	180	198	216	246	256	288	308	353	375	403	428	464	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
10.7	11.7	12.3	13.9	14.6	16.5	17.6	19.9	20	23	24	25	27	
1053	1127	1202	1433	1514	1613	1774	2041	2209	2418	2576	2771	2836	
20-1/2"	22-1/2"	22-1/2"	16-5/8"	18-5/8"	20-5/8"	24-5/8"	20-3/4"	18-3/4"	20-3/4"	22-3/4"	26-3/4"	26-3/4"	
196	210	224	267	282	300	330	380	411	450	480	516	528	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
10.6	12.0	13.2	14.6	15.0	16.0	18.2	19.1	21	23	24	26	27	
1144	1319	1441	1693	1808	1893	2132	2363	2774	2938	3132	3452	3519	
16-1/2"	18-1/2"	14-5/8"	16-5/8"	18-5/8"	18-5/8"	16-3/4"	18-3/4"	18-3/4"	20-3/4"	22-3/4"	26-3/4"	26-3/4"	
213	246	268	315	337	353	397	440	517	547	583	643	655	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
7.6	9.2	10.3	10.5	11.7	12.3	14.2	15.4	16.5	17.8	20	21	23	
1331	1495	1714	1870	2016	2148	2433	2683	3049	3270	3628	3868	4166	
26-3/8"	18-1/2"	22-1/2"	22-1/2"	24-1/2"	26-1/2"	18-5/8"	24-5/8"	24-5/8"	28-5/8"	20-3/4"	22-3/4"	26-3/4"	
248	278	319	348	375	400	453	500	568	609	676	720	776	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
8.0	9.6	10.4	11.0	12.1	13.3	14.9	15.7	16.4	18.4	19	20	23	
1512	1662	1877	2098	2278	2566	2751	3019	3353	3656	3868	4104	4538	
16-1/2"	16-1/2"	20-1/2"	18-1/2"	14-5/8"	16-5/8"	18-5/8"	22-5/8"	24-5/8"	16-3/4"	18-3/4"	20-3/4"	22-3/4"	
282	309	350	391	424	478	512	562	624	681	720	764	845	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
8.1	9.6	10.4	11.1	12.4	13.5	14.8	15.6	16.3	18.2	18.9	20	23	
1853	2042	2302	2555	2781	3130	3366	3686	4034	4413	4665	4946	5492	
16-1/2"	16-1/2"	20-1/2"	18-1/2"	14-5/8"	16-5/8"	18-5/8"	22-5/8"	24-5/8"	16-3/4"	18-3/4"	20-3/4"	22-3/4"	
345	380	429	476	518	583	627	686	751	822	869	921	1020	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
8.7	9.7	10.6	11.2	12.4	13.5	15.0	15.6	16.4	18.3	19.0	20	23	
2143	2369	2664	2940	3210	3607	3891	4250	4600	5049	5329	5644	6294	
16-1/2"	16-1/2"	20-1/2"	18-1/2"	14-5/8"	16-5/8"	18-5/8"	22-5/8"	24-5/8"	16-3/4"	18-3/4"	20-3/4"	22-3/4"	
399	441	496	547	598	672	724	791	856	940	992	1050	1170	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	
9.4	9.7	11.3	12.4	13.3	13.9	14.8	15.6	17.5	18.2	20	21	22	
2479	2644	3071	3427	3676	3891	4330	4718	5291	5575	6169	6548	6959	
16-1/2"	16-1/2"	18-1/2"	14-5/8"	14-5/8"	16-5/8"	18-5/8"	22-5/8"	16-3/4"	16-3/4"	18-3/4"	20-3/4"	22-3/4"	
462	492	572	638	684	725	806	879	985	1040	1150	1220	1300	
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
25	10	Wt(plf)	5.5	6.2	7.0	7.8	8.5	9.1	11.1	12.3	13.7
		W360(plf)	170	215	255	287	328	346	401	446	527
		N-ds	14-3/8"	20-3/8"	24-3/8"	28-3/8"	32-3/8"	36-3/8"	24-1/2"	28-1/2"	34-1/2"
		Ieff(in4)	62	78	93	104	119	126	146	162	192
		Bridging	(1)X+(1)H	(2)H							
	12	Wt(plf)	5.6	6.2	6.6	7.4	8.0	9.0	9.4	11.9	12.6
		W360(plf)	211	235	268	318	357	407	429	511	564
		N-ds	14-3/8"	16-3/8"	20-3/8"	24-3/8"	28-3/8"	32-3/8"	36-3/8"	24-1/2"	28-1/2"
		Ieff(in4)	77	85	98	116	130	148	156	186	205
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	14	Wt(plf)	5.3	6.0	6.4	7.1	7.6	9.5	10.0	10.6	12.7
		W360(plf)	217	262	303	362	394	465	497	571	660
		N-ds	14-3/8"	14-3/8"	18-3/8"	22-3/8"	24-3/8"	16-1/2"	18-1/2"	22-1/2"	24-1/2"
		Ieff(in4)	79	95	110	132	143	169	181	208	240
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H
	16	Wt(plf)	5.6	6.0	6.5	6.9	7.5	8.5	10.2	10.6	11.4
		W360(plf)	265	320	355	406	443	523	570	618	707
		N-ds	14-3/8"	14-3/8"	16-3/8"	20-3/8"	22-3/8"	26-3/8"	16-1/2"	18-1/2"	22-1/2"
		Ieff(in4)	96	116	129	148	161	190	207	225	257
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	18	Wt(plf)	5.3	5.3	5.6	6.0	6.4	7.0	7.4	7.8	8.6
		W360(plf)	341	341	415	462	530	631	675	719	831
		N-ds	14-3/8"	14-3/8"	14-3/8"	16-3/8"	20-3/8"	24-3/8"	26-3/8"	28-3/8"	32-3/8"
		Ieff(in4)	124	124	151	168	193	229	245	261	302
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	20	Wt(plf)	5.4	5.4	5.7	6.0	6.5	6.8	7.2	7.6	8.2
		W360(plf)	403	403	490	546	627	684	745	805	914
		N-ds	14-3/8"	14-3/8"	14-3/8"	16-3/8"	20-3/8"	22-3/8"	24-3/8"	26-3/8"	30-3/8"
Ieff(in4)		147	147	178	198	228	249	271	293	333	
Bridging		(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	
24	Wt(plf)	5.6	5.6	5.6	6.0	6.3	6.7	7.1	7.5	7.6	
	W360(plf)	528	528	528	642	714	819	892	979	1053	
	N-ds	14-3/8"	14-3/8"	14-3/8"	14-3/8"	16-3/8"	20-3/8"	22-3/8"	24-3/8"	26-3/8"	
	Ieff(in4)	192	192	192	233	260	298	324	356	383	
	Bridging	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	
28	Wt(plf)	5.6	5.7	5.8	5.8	6.0	6.4	7.2	7.9	9.7	
	W360(plf)	649	649	649	787	873	927	1041	1160	1400	
	N-ds	14-3/8"	14-3/8"	14-3/8"	14-3/8"	16-3/8"	16-3/8"	18-3/8"	14-1/2"	16-1/2"	
	Ieff(in4)	236	236	236	286	318	337	378	422	509	
	Bridging	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	
32	Wt(plf)	5.9	5.9	6.0	6.0	6.2	6.6	7.1	8.0	8.7	
	W360(plf)	761	761	761	920	1018	1083	1204	1356	1588	
	N-ds	14-3/8"	14-3/8"	14-3/8"	14-3/8"	16-3/8"	16-3/8"	18-3/8"	14-1/2"	16-1/2"	
	Ieff(in4)	277	277	277	334	370	394	438	493	578	
	Bridging	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
14.6	16.9	18.7	20.0	22	25	26	31	31	35	39	39	45
637	726	802	937	1014	1097	1159	1336	1507	1660	1845	1845	2040
36-1/2"	42-1/2"	34-5/8"	36-5/8"	42-5/8"	34-3/4"	38-3/4"	48-3/4"	42-3/4"	48-3/4"	56-3/4"	56-3/4"	66-3/4"
232	264	292	341	369	399	422	486	548	604	671	671	742
(2)H	(1)H	(1)X	(1)X	(1)X								
13.1	15.6	17.0	19.1	21	22	25	27	27	30	32	35	38
675	773	869	1019	1097	1127	1312	1384	1518	1670	1757	1940	2113
32-1/2"	36-1/2"	44-1/2"	32-5/8"	38-5/8"	36-5/8"	34-3/4"	38-3/4"	34-3/4"	38-3/4"	42-3/4"	48-3/4"	56-3/4"
245	281	316	371	399	410	477	503	552	608	639	706	768
(2)H	(1)H	(1)X	(1)X	(1)X								
13.0	15.4	17.1	18.1	19.4	20.0	23	26	27	28	31	33	36
774	926	997	1120	1200	1280	1426	1578	1789	1886	2048	2203	2380
28-1/2"	24-5/8"	26-5/8"	24-5/8"	30-5/8"	34-5/8"	28-3/4"	32-3/4"	30-3/4"	34-3/4"	36-3/4"	40-3/4"	48-3/4"
281	337	362	407	436	466	518	574	651	686	745	801	865
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
12.9	15.3	16.3	17.7	18.7	20.0	22	23	26	27	29	31	33
893	1016	1129	1273	1364	1446	1593	1720	2047	2140	2256	2452	2506
26-1/2"	20-5/8"	24-5/8"	24-5/8"	26-5/8"	30-5/8"	24-3/4"	28-3/4"	28-3/4"	30-3/4"	34-3/4"	36-3/4"	36-3/4"
325	370	411	463	496	526	579	626	744	778	820	892	911
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
9.1	10.8	12.7	13.2	15.6	16.4	18.3	21	22	24	26	27	30
993	1145	1293	1415	1633	1731	1882	2094	2426	2598	2688	2818	3042
36-3/8"	26-1/2"	30-1/2"	30-1/2"	24-5/8"	26-5/8"	28-5/8"	24-3/4"	24-3/4"	28-3/4"	28-3/4"	30-3/4"	32-3/4"
361	416	470	515	594	629	685	761	882	945	977	1020	1110
(2)H	(1)H	(1)X	(1)X	(1)X								
9.2	10.7	12.4	12.9	15.0	15.8	17.1	19	21	23	26	26	29
1100	1256	1455	1567	1803	1908	2043	2229	2608	2820	3128	3128	3352
32-3/8"	24-1/2"	28-1/2"	28-1/2"	22-5/8"	24-5/8"	24-5/8"	30-5/8"	22-3/4"	24-3/4"	28-3/4"	28-3/4"	30-3/4"
400	457	529	570	656	694	743	811	949	1030	1140	1140	1220
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
8.9	10.3	12.2	12.8	13.6	15.5	16.7	19	21	23	25	26	29
1312	1541	1781	1916	2017	2302	2462	2853	3303	3567	3703	3969	4265
30-3/8"	24-1/2"	26-1/2"	26-1/2"	26-1/2"	22-5/8"	24-5/8"	30-5/8"	22-3/4"	24-3/4"	24-3/4"	28-3/4"	30-3/4"
477	560	648	697	734	837	895	1040	1200	1300	1350	1440	1550
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
10.6	11.8	12.8	14.0	15.3	15.8	17.0	18.4	22	23	24	24	27
1677	1858	2088	2336	2583	2724	3035	3268	3819	4083	4414	4414	4844
20-1/2"	20-1/2"	18-5/8"	16-5/8"	20-5/8"	20-5/8"	24-5/8"	24-5/8"	20-3/4"	22-3/4"	24-3/4"	24-3/4"	26-3/4"
610	676	759	850	940	991	1100	1190	1390	1490	1610	1610	1760
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
10.7	11.4	12.8	13.6	15.4	15.9	16.9	18.4	20	23	24	24	26
1936	2111	2411	2650	2973	3130	3479	3748	4189	4667	5034	5034	5376
20-1/2"	20-1/2"	18-5/8"	16-5/8"	20-5/8"	20-5/8"	24-5/8"	24-5/8"	20-3/4"	22-3/4"	24-3/4"	24-3/4"	28-3/4"
704	768	877	964	1080	1140	1270	1360	1520	1700	1830	1830	1960
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
30	12	Wt(plf)	6.1	7.2	7.9	8.7	10.1	11.4	13.5	14.0	15.5
		W360(plf)	155	204	229	263	310	337	386	418	476
		N-ds	18-3/8"	24-3/8"	28-3/8"	32-3/8"	40-3/8"	46-3/8"	32-1/2"	34-1/2"	40-1/2"
		Ieff(in4)	97	128	144	166	195	212	243	263	299
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(2)H	(2)H	(2)H	(2)H
	14	Wt(plf)	6.2	6.9	7.7	8.4	10.5	11.3	12.3	13.1	15.4
		W360(plf)	181	227	265	298	353	393	411	458	558
		N-ds	16-3/8"	22-3/8"	26-3/8"	30-3/8"	22-1/2"	24-1/2"	26-1/2"	30-1/2"	36-1/2"
		Ieff(in4)	114	142	166	187	222	247	258	288	350
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	16	Wt(plf)	6.0	6.8	7.4	8.4	9.9	11.2	12.5	13.1	16.0
		W360(plf)	196	251	298	324	376	427	486	518	622
		N-ds	16-3/8"	20-3/8"	24-3/8"	26-3/8"	18-1/2"	22-1/2"	24-1/2"	26-1/2"	22-5/8"
		Ieff(in4)	123	158	187	203	237	268	306	325	391
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	18	Wt(plf)	5.6	5.8	6.6	7.0	7.6	8.2	8.6	9.6	11.5
		W360(plf)	247	275	346	378	426	488	515	592	679
		N-ds	16-3/8"	16-3/8"	22-3/8"	24-3/8"	28-3/8"	32-3/8"	36-3/8"	40-3/8"	28-1/2"
		Ieff(in4)	155	173	218	238	268	307	324	372	427
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	20	Wt(plf)	5.3	5.7	6.3	6.7	7.4	8.1	8.3	8.7	11.2
		W360(plf)	243	296	380	415	485	547	586	627	784
		N-ds	16-3/8"	16-3/8"	20-3/8"	22-3/8"	26-3/8"	30-3/8"	32-3/8"	36-3/8"	26-1/2"
		Ieff(in4)	153	186	239	261	305	344	368	394	493
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	24	Wt(plf)	5.5	5.9	6.1	6.6	7.0	7.7	7.8	8.1	10.3
		W360(plf)	328	400	446	513	560	654	689	745	904
		N-ds	16-3/8"	16-3/8"	16-3/8"	20-3/8"	22-3/8"	26-3/8"	28-3/8"	30-3/8"	22-1/2"
		Ieff(in4)	206	251	280	322	352	411	433	468	568
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	26	Wt(plf)	5.6	5.7	6.0	6.4	7.1	7.3	7.6	7.9	9.4
		W360(plf)	371	371	453	528	634	691	738	786	942
		N-ds	16-3/8"	16-3/8"	16-3/8"	18-3/8"	22-3/8"	24-3/8"	26-3/8"	28-3/8"	32-3/8"
		Ieff(in4)	233	233	285	332	398	434	464	494	592
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	28	Wt(plf)	5.8	5.8	6.2	6.5	6.7	7.1	7.5	8.0	9.4
		W360(plf)	415	415	506	563	647	706	769	874	1047
		N-ds	16-3/8"	16-3/8"	16-3/8"	16-3/8"	20-3/8"	22-3/8"	24-3/8"	28-3/8"	32-3/8"
		Ieff(in4)	261	261	318	354	407	444	483	549	658
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H
	32	Wt(plf)	5.8	5.9	6.0	6.2	6.6	7.3	7.8	8.8	10.8
		W360(plf)	500	500	609	677	776	861	951	1052	1232
		N-ds	16-3/8"	16-3/8"	16-3/8"	16-3/8"	20-3/8"	22-3/8"	24-3/8"	16-1/2"	18-1/2"
		Ieff(in4)	315	315	383	425	488	541	598	661	774
		Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT		2 1/2"	5"	7 1/2"								
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
17.9	19.4	23	27	28	29	34	37	39	42	45	48	53
606	669	776	934	1004	1061	1186	1304	1499	1623	1664	1746	1915
48-1/2"	52-1/2"	46-5/8"	36-3/4"	42-3/4"	46-3/4"	54-3/4"	64-3/4"	54-3/4"	64-3/4"	64-3/4"	72-3/4"	84-3/4"
381	420	487	587	631	667	745	819	942	1020	1050	1100	1200
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
18.1	19.3	21.0	25	25	27	31	33	35	39	40	43	45
693	755	843	989	1043	1103	1281	1390	1547	1729	1753	1894	1926
30-5/8"	34-5/8"	38-5/8"	30-3/4"	34-3/4"	36-3/4"	46-3/4"	54-3/4"	46-3/4"	54-3/4"	54-3/4"	64-3/4"	64-3/4"
436	475	530	622	656	693	805	874	972	1090	1100	1190	1210
(2)H	(2)H	(1)H	(1)X	(1)X	(1)X							
16.9	19.2	21	23	24	27	28	32	33	37	40	41	45
742	861	929	1091	1178	1276	1350	1550	1703	1874	2055	2091	2304
26-5/8"	32-5/8"	34-5/8"	26-3/4"	30-3/4"	34-3/4"	36-3/4"	44-3/4"	38-3/4"	46-3/4"	54-3/4"	54-3/4"	64-3/4"
466	541	584	686	740	802	848	974	1070	1180	1290	1310	1450
(2)H	(1)H	(1)X	(1)X	(1)X								
12.1	14.9	16.9	17.9	20	21	24	28	29	32	35	36	41
825	961	1068	1199	1317	1432	1569	1715	1957	2113	2299	2345	2611
34-1/2"	40-1/2"	30-5/8"	32-5/8"	36-5/8"	40-5/8"	34-3/4"	36-3/4"	36-3/4"	38-3/4"	46-3/4"	46-3/4"	54-3/4"
519	604	671	753	828	900	986	1080	1230	1330	1440	1470	1640
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
11.9	14.2	15.3	17.1	18.6	20	23	25	28	29	32	36	37
939	1083	1168	1335	1450	1591	1782	1872	2180	2322	2507	2786	2786
32-1/2"	36-1/2"	38-1/2"	28-5/8"	30-5/8"	36-5/8"	30-3/4"	34-3/4"	32-3/4"	36-3/4"	38-3/4"	46-3/4"	46-3/4"
590	681	734	839	911	1000	1120	1180	1370	1460	1580	1750	1750
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
11.0	12.9	14.4	15.9	17.0	18.5	22	23	26	27	30	33	34
1087	1229	1386	1565	1685	1821	2204	2204	2577	2713	2934	3186	3371
26-1/2"	30-1/2"	32-1/2"	24-5/8"	24-5/8"	28-5/8"	26-3/4"	26-3/4"	26-3/4"	28-3/4"	30-3/4"	34-3/4"	38-3/4"
683	773	871	984	1060	1140	1390	1390	1620	1700	1840	2000	2120
(2)H	(1)H	(1)X	(1)X	(1)X								
10.6	12.7	14.0	15.5	16.5	18.6	21	23	25	26	29	31	33
1143	1326	1479	1656	1779	2041	2281	2474	2681	2881	3098	3343	3566
24-1/2"	28-1/2"	30-1/2"	22-5/8"	24-5/8"	28-5/8"	24-3/4"	26-3/4"	24-3/4"	26-3/4"	28-3/4"	30-3/4"	34-3/4"
718	833	929	1040	1120	1280	1430	1550	1680	1810	1950	2100	2240
(2)H	(1)H	(1)X	(1)X	(1)X								
10.5	12.7	13.7	15.5	16.7	18.0	21	23	25	27	29	31	33
1211	1401	1553	1830	1966	2115	2355	2736	2957	3176	3419	3692	3936
24-1/2"	26-1/2"	28-1/2"	22-5/8"	24-5/8"	24-5/8"	22-3/4"	26-3/4"	24-3/4"	26-3/4"	28-3/4"	30-3/4"	34-3/4"
761	881	976	1150	1240	1330	1480	1720	1860	2000	2150	2320	2470
(2)H	(1)H	(1)X	(1)X	(1)X								
11.6	13.4	14.2	15.7	17.2	18.1	19.1	21	24	26	27	30	31
1481	1726	1894	2099	2386	2529	2697	2932	3477	3729	3923	4255	4523
22-1/2"	18-5/8"	20-5/8"	20-5/8"	24-5/8"	26-5/8"	28-5/8"	30-5/8"	24-3/4"	26-3/4"	28-3/4"	30-3/4"	34-3/4"
931	1080	1190	1320	1500	1590	1690	1840	2190	2340	2470	2670	2840
(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
35	14	Wt(plf)	7.2	8.3	9.1	11.3	12.7	13.6	14.7	16.2	20.0
		W360(plf)	156	193	222	269	294	324	362	401	485
		N-ds	22-3/8"	28-3/8"	32-3/8"	24-1/2"	28-1/2"	32-1/2"	36-1/2"	40-1/2"	34-5/8"
		leff(in4)	155	193	222	269	294	324	362	400	484
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(3)H	(2)H	(2)H
	16	Wt(plf)	6.9	7.8	8.7	10.1	12.0	13.1	13.7	16.3	18.3
		W360(plf)	168	201	243	275	321	368	385	450	522
		N-ds	20-3/8"	24-3/8"	30-3/8"	36-3/8"	24-1/2"	30-1/2"	32-1/2"	36-1/2"	42-1/2"
		leff(in4)	168	201	243	275	321	368	384	449	521
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(2)H	(2)H
	18	Wt(plf)	5.9	6.6	7.3	8.1	8.8	9.6	11.6	12.2	14.3
		W360(plf)	176	221	272	312	344	382	442	472	565
		N-ds	18-3/8"	22-3/8"	28-3/8"	32-3/8"	38-3/8"	44-3/8"	30-1/2"	32-1/2"	40-1/2"
		leff(in4)	175	220	272	312	343	381	442	471	564
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(2)H	(2)H	(2)H
	20	Wt(plf)	5.9	6.6	7.1	7.7	8.6	9.3	10.0	11.7	12.6
		W360(plf)	212	267	313	353	399	443	472	547	614
		N-ds	18-3/8"	22-3/8"	26-3/8"	30-3/8"	36-3/8"	40-3/8"	42-3/8"	30-1/2"	34-1/2"
		leff(in4)	212	267	312	352	399	442	471	545	613
		Bridging	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(2)H	(2)H	(2)H	(2)H
	22	Wt(plf)	5.8	6.4	7.1	7.5	8.3	8.7	9.7	11.3	12.4
		W360(plf)	225	289	346	391	448	473	536	616	690
		N-ds	18-3/8"	20-3/8"	24-3/8"	28-3/8"	32-3/8"	36-3/8"	40-3/8"	28-1/2"	32-1/2"
		leff(in4)	224	289	345	390	447	472	535	615	688
Bridging		(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(2)H	(2)H	(2)H	(2)H	
24	Wt(plf)	5.9	6.2	6.9	7.3	8.0	8.4	9.4	10.8	12.0	
	W360(plf)	261	305	368	430	486	521	585	657	764	
	N-ds	18-3/8"	18-3/8"	22-3/8"	26-3/8"	30-3/8"	32-3/8"	38-3/8"	24-1/2"	30-1/2"	
	leff(in4)	261	305	367	430	485	520	584	656	763	
	Bridging	(1)X+(1)H	(1)X+(1)H	(1)X+(1)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	
26	Wt(plf)	6.0	6.2	6.7	7.1	7.7	8.5	9.2	10.5	11.6	
	W360(plf)	299	334	385	460	519	595	641	704	830	
	N-ds	18-3/8"	18-3/8"	20-3/8"	24-3/8"	28-3/8"	32-3/8"	36-3/8"	22-1/2"	28-1/2"	
	leff(in4)	298	333	384	459	518	594	639	703	828	
	Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	
28	Wt(plf)	5.8	6.4	6.8	7.2	7.6	8.2	9.0	10.3	11.4	
	W360(plf)	276	377	434	518	554	625	683	760	898	
	N-ds	18-3/8"	18-3/8"	20-3/8"	24-3/8"	26-3/8"	30-3/8"	32-3/8"	22-1/2"	26-1/2"	
	leff(in4)	276	376	433	517	553	624	682	759	896	
	Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	
32	Wt(plf)	5.9	6.0	6.3	6.7	7.3	7.9	9.4	10.0	11.9	
	W360(plf)	340	416	463	533	634	690	810	881	1010	
	N-ds	18-3/8"	18-3/8"	18-3/8"	20-3/8"	24-3/8"	26-3/8"	18-1/2"	20-1/2"	22-1/2"	
	leff(in4)	340	415	462	532	633	689	808	879	1010	
	Bridging	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
22	25	27	29	33	33	38	41	43	47	53	56	61
607	695	750	871	984	994	1130	1229	1386	1478	1627	1683	1823
40-5/8"	50-5/8"	54-5/8"	44-3/4"	52-3/4"	52-3/4"	60-3/4"	70-3/4"	62-3/4"	70-3/4"	80-3/4"	86-3/4"	100-3/4"
606	694	748	870	982	992	1130	1230	1380	1480	1620	1680	1820
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)X	(1)X	(1)X
21	23	25	28	29	31	34	38	41	42	46	52	53
654	724	819	950	1012	1108	1160	1304	1524	1557	1660	1825	1859
38-5/8"	40-5/8"	50-5/8"	38-3/4"	44-3/4"	52-3/4"	52-3/4"	60-3/4"	62-3/4"	62-3/4"	70-3/4"	80-3/4"	80-3/4"
652	722	817	949	1010	1110	1160	1300	1520	1550	1660	1820	1860
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
16.5	19.0	21	22	25	27	33	36	38	40	44	48	54
691	785	857	957	1065	1141	1374	1509	1651	1687	1855	1986	2191
48-1/2"	38-5/8"	40-5/8"	42-5/8"	34-3/4"	38-3/4"	52-3/4"	62-3/4"	52-3/4"	52-3/4"	62-3/4"	70-3/4"	80-3/4"
689	783	855	955	1060	1140	1370	1510	1650	1680	1850	1980	2190
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
15.6	17.8	19.5	21	24	26	30	33	35	39	41	45	48
783	877	966	1100	1212	1292	1520	1659	1804	2026	2054	2267	2392
44-1/2"	34-5/8"	36-5/8"	38-5/8"	32-3/4"	34-3/4"	44-3/4"	52-3/4"	44-3/4"	52-3/4"	52-3/4"	62-3/4"	70-3/4"
781	875	964	1100	1210	1290	1520	1660	1800	2020	2050	2260	2390
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
14.8	16.9	19.1	20	23	24	29	31	35	36	40	42	45
869	968	1129	1207	1358	1438	1694	1794	2120	2161	2415	2452	2666
40-1/2"	30-5/8"	38-5/8"	34-5/8"	30-3/4"	32-3/4"	38-3/4"	44-3/4"	44-3/4"	44-3/4"	52-3/4"	52-3/4"	62-3/4"
868	966	1130	1200	1360	1440	1690	1790	2120	2160	2410	2450	2660
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
14.3	16.2	18.1	20	22	23	28	29	32	36	37	42	43
950	1052	1209	1395	1525	1579	1835	1960	2234	2491	2524	2829	2829
36-1/2"	28-5/8"	34-5/8"	34-5/8"	40-5/8"	30-3/4"	34-3/4"	38-3/4"	36-3/4"	44-3/4"	44-3/4"	52-3/4"	52-3/4"
948	1050	1210	1390	1520	1580	1830	1960	2230	2490	2520	2820	2820
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
13.9	16.3	17.4	19.2	21	23	27	28	31	34	36	39	43
1021	1199	1287	1463	1614	1796	1968	2089	2390	2578	2825	2905	3211
34-1/2"	28-5/8"	30-5/8"	30-5/8"	34-5/8"	30-3/4"	32-3/4"	34-3/4"	32-3/4"	36-3/4"	44-3/4"	44-3/4"	52-3/4"
1020	1200	1280	1460	1610	1790	1960	2080	2390	2570	2820	2900	3200
(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
13.6	15.9	16.7	18.5	20	23	26	27	30	33	34	38	40
1088	1268	1354	1530	1667	1871	2091	2208	2501	2720	2882	3203	3252
32-1/2"	26-5/8"	28-5/8"	28-5/8"	30-5/8"	26-3/4"	30-3/4"	32-3/4"	30-3/4"	32-3/4"	36-3/4"	44-3/4"	44-3/4"
1090	1270	1350	1530	1660	1870	2090	2200	2500	2710	2880	3200	3240
(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
12.8	14.4	16.4	17.7	19	21	23	26	29	30	33	36	40
1203	1364	1566	1733	1885	2057	2280	2539	2844	3016	3282	3525	3929
28-1/2"	30-1/2"	26-5/8"	24-5/8"	28-5/8"	30-5/8"	26-3/4"	30-3/4"	28-3/4"	30-3/4"	32-3/4"	36-3/4"	44-3/4"
1200	1360	1560	1730	1880	2050	2280	2530	2840	3010	3270	3520	3920
(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
40	16	Wt(plf)	8.0	9.6	11.9	12.5	14.0	16.1	18.0	19.8	24
		W360(plf)	146	192	231	253	295	318	362	409	477
		N-ds	24-3/8"	32-3/8"	24-1/2"	28-1/2"	34-1/2"	36-1/2"	42-1/2"	34-5/8"	40-5/8"
		Ieff(in4)	218	286	344	376	440	474	540	610	710
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(3)H	(3)H
	18	Wt(plf)	6.9	7.8	9.0	10.2	11.9	13.1	14.3	16.3	18.1
		W360(plf)	150	186	226	263	298	329	366	411	455
		N-ds	22-3/8"	28-3/8"	36-3/8"	42-3/8"	30-1/2"	34-1/2"	40-1/2"	44-1/2"	46-1/2"
		Ieff(in4)	224	277	337	391	444	490	546	612	678
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(2)H	(2)H
	20	Wt(plf)	6.1	7.0	8.1	8.8	10.2	12.4	13.2	14.5	17.5
		W360(plf)	165	212	256	282	332	381	402	458	550
		N-ds	20-3/8"	26-3/8"	32-3/8"	38-3/8"	46-3/8"	32-1/2"	34-1/2"	40-1/2"	48-1/2"
		Ieff(in4)	246	315	382	420	495	567	598	682	820
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(2)H
	22	Wt(plf)	6.4	6.8	7.7	8.6	9.7	11.2	12.4	13.2	16.3
		W360(plf)	196	235	285	323	365	412	455	490	612
		N-ds	20-3/8"	24-3/8"	30-3/8"	36-3/8"	40-3/8"	28-1/2"	32-1/2"	34-1/2"	44-1/2"
		Ieff(in4)	293	350	424	481	544	614	678	729	912
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(2)H
	24	Wt(plf)	6.1	6.9	7.5	8.3	9.3	10.9	11.9	12.4	15.6
		W360(plf)	199	275	311	358	401	465	509	544	674
		N-ds	20-3/8"	24-3/8"	28-3/8"	32-3/8"	38-3/8"	26-1/2"	30-1/2"	32-1/2"	40-1/2"
		Ieff(in4)	297	410	464	533	598	692	758	810	1000
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(2)H
	26	Wt(plf)	6.2	6.7	7.3	8.0	9.1	10.7	11.6	12.0	14.8
		W360(plf)	229	290	340	384	443	512	558	597	732
		N-ds	20-3/8"	22-3/8"	26-3/8"	30-3/8"	36-3/8"	24-1/2"	28-1/2"	30-1/2"	36-1/2"
		Ieff(in4)	342	432	506	572	660	763	831	889	1090
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	(2)H
	28	Wt(plf)	6.1	6.5	7.2	8.0	8.9	10.4	11.4	11.6	14.3
		W360(plf)	234	301	360	436	477	545	610	645	787
		N-ds	20-3/8"	20-3/8"	24-3/8"	30-3/8"	32-3/8"	22-1/2"	26-1/2"	28-1/2"	34-1/2"
		Ieff(in4)	348	449	537	650	710	812	909	960	1170
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	(2)H
	30	Wt(plf)	6.3	6.7	7.3	7.9	9.0	10.1	11.1	11.4	14.0
		W360(plf)	263	339	405	458	535	587	654	696	835
		N-ds	20-3/8"	20-3/8"	24-3/8"	28-3/8"	32-3/8"	22-1/2"	24-1/2"	26-1/2"	30-1/2"
		Ieff(in4)	391	504	603	682	797	874	975	1040	1240
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	(2)H
32	Wt(plf)	6.2	6.4	7.0	7.6	8.2	9.0	10.9	11.2	13.6	
	W360(plf)	292	342	412	481	543	594	681	738	881	
	N-ds	20-3/8"	20-3/8"	22-3/8"	26-3/8"	30-3/8"	32-3/8"	22-1/2"	24-1/2"	28-1/2"	
	Ieff(in4)	435	509	613	717	809	885	1010	1100	1310	
	Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
25	28	33	33	36	40	44	49	52	56	63	68	71
588	649	777	832	928	1037	1133	1267	1415	1466	1623	1742	1777
50-5/8"	42-3/4"	52-3/4"	50-3/4"	60-3/4"	68-3/4"	78-3/4"	90-3/4"	80-3/4"	86-3/4"	100-3/4"	112-3/4"	112-3/4"
875	966	1160	1240	1380	1550	1690	1890	2110	2180	2420	2590	2650
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)X	(1)X	(1)X
20	24	28	31	33	36	41	45	48	54	57	63	66
561	642	760	870	910	1008	1135	1238	1366	1509	1543	1698	1744
42-5/8"	48-5/8"	46-3/4"	50-3/4"	50-3/4"	60-3/4"	68-3/4"	78-3/4"	68-3/4"	80-3/4"	86-3/4"	100-3/4"	100-3/4"
835	956	1130	1300	1360	1500	1690	1840	2040	2250	2300	2530	2600
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)X	(1)X	(1)X
20.0	22	25	27	31	33	37	41	43	48	52	54	62
681	730	850	921	1066	1115	1272	1399	1540	1654	1793	1829	2061
42-5/8"	44-5/8"	54-5/8"	38-3/4"	50-3/4"	50-3/4"	58-3/4"	68-3/4"	60-3/4"	68-3/4"	80-3/4"	80-3/4"	100-3/4"
1020	1090	1270	1370	1590	1660	1900	2080	2290	2460	2670	2720	3070
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)X	(1)X	(1)X
18.9	21	23	25	28	33	34	38	42	45	48	54	56
758	828	901	1027	1165	1326	1372	1532	1798	1854	1962	2170	2205
38-5/8"	40-5/8"	46-5/8"	34-3/4"	42-3/4"	50-3/4"	48-3/4"	58-3/4"	60-3/4"	60-3/4"	68-3/4"	80-3/4"	80-3/4"
1130	1230	1340	1530	1740	1980	2040	2280	2680	2760	2920	3230	3290
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)X	(1)X	(1)X
17.8	20	22	25	27	30	33	38	39	44	45	50	55
818	903	1002	1198	1286	1417	1569	1790	1924	2123	2157	2327	2570
34-5/8"	36-5/8"	42-5/8"	34-3/4"	38-3/4"	42-3/4"	50-3/4"	58-3/4"	50-3/4"	60-3/4"	60-3/4"	68-3/4"	80-3/4"
1220	1350	1490	1780	1920	2110	2340	2670	2870	3160	3210	3470	3830
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)X	(1)X	(1)X
17.1	19.6	21	24	26	29	31	35	39	41	45	47	52
880	1038	1138	1280	1385	1536	1646	1862	2202	2233	2471	2513	2709
30-5/8"	36-5/8"	40-5/8"	40-5/8"	34-3/4"	38-3/4"	42-3/4"	48-3/4"	50-3/4"	50-3/4"	60-3/4"	60-3/4"	68-3/4"
1310	1550	1690	1910	2060	2290	2450	2770	3280	3330	3680	3740	4040
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(2)X	(1)X	(1)X
16.4	18.3	20	23	25	28	30	35	36	41	43	47	49
934	1076	1202	1375	1480	1629	1759	2109	2249	2521	2560	2840	2882
28-5/8"	34-5/8"	36-5/8"	36-5/8"	32-3/4"	34-3/4"	38-3/4"	48-3/4"	42-3/4"	50-3/4"	50-3/4"	60-3/4"	60-3/4"
1390	1600	1790	2050	2200	2430	2620	3140	3350	3760	3810	4230	4290
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
16.5	17.6	20	22	24	27	30	33	37	38	43	45	49
1046	1125	1241	1430	1568	1716	1967	2147	2507	2542	2856	2904	3217
28-5/8"	30-5/8"	34-5/8"	34-5/8"	30-3/4"	32-3/4"	38-3/4"	40-3/4"	42-3/4"	42-3/4"	50-3/4"	50-3/4"	60-3/4"
1560	1680	1850	2130	2340	2560	2930	3200	3740	3790	4250	4330	4790
(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
15.9	17.5	20	22	24	27	28	31	34	38	40	45	47
1091	1246	1374	1580	1734	1900	2036	2239	2517	2804	2846	3207	3253
26-5/8"	30-5/8"	34-5/8"	34-5/8"	30-3/4"	32-3/4"	34-3/4"	36-3/4"	36-3/4"	42-3/4"	42-3/4"	50-3/4"	50-3/4"
1630	1860	2050	2350	2580	2830	3030	3340	3750	4180	4240	4780	4850
(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
45	18	Wt(plf)	8.3	9.7	10.9	12.3	13.6	15.2	17.4	18.7	22
		W360(plf)	133	164	192	220	244	274	303	331	386
		N-ds	28-3/8"	24-1/2"	26-1/2"	32-1/2"	36-1/2"	44-1/2"	48-1/2"	54-1/2"	44-5/8"
		leff(in4)	282	348	407	466	519	581	643	701	819
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	20	Wt(plf)	7.8	8.9	10.6	11.8	13.0	14.6	16.3	17.6	21
		W360(plf)	153	186	224	256	284	316	346	381	451
		N-ds	26-3/8"	32-3/8"	24-1/2"	30-1/2"	34-1/2"	40-1/2"	44-1/2"	48-1/2"	40-5/8"
		leff(in4)	324	394	474	544	601	671	734	808	956
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	22	Wt(plf)	7.3	8.3	9.4	10.6	12.5	13.8	15.5	16.5	20.0
		W360(plf)	168	204	243	281	322	359	391	426	518
		N-ds	24-3/8"	30-3/8"	38-3/8"	46-3/8"	32-1/2"	36-1/2"	40-1/2"	44-1/2"	38-5/8"
		leff(in4)	357	434	514	596	683	761	829	903	1100
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	24	Wt(plf)	6.8	7.7	8.9	9.6	12.1	13.1	14.8	15.7	19.1
		W360(plf)	179	221	269	299	362	401	435	471	572
		N-ds	24-3/8"	28-3/8"	36-3/8"	40-3/8"	30-1/2"	34-1/2"	36-1/2"	40-1/2"	34-5/8"
		leff(in4)	379	469	570	633	767	850	922	1000	1210
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	26	Wt(plf)	6.4	7.3	8.3	9.3	11.3	12.8	14.0	15.5	18.9
		W360(plf)	189	242	295	331	398	440	477	547	664
		N-ds	24-3/8"	26-3/8"	32-3/8"	38-3/8"	28-1/2"	32-1/2"	34-1/2"	40-1/2"	34-5/8"
		leff(in4)	400	514	625	701	845	934	1010	1160	1410
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	28	Wt(plf)	6.5	7.1	8.0	9.2	10.7	12.3	13.5	14.8	17.9
		W360(plf)	216	258	314	362	418	480	517	590	704
		N-ds	24-3/8"	24-3/8"	30-3/8"	36-3/8"	24-1/2"	30-1/2"	30-1/2"	36-1/2"	30-5/8"
		leff(in4)	458	548	665	768	887	1020	1100	1250	1490
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	30	Wt(plf)	6.4	7.3	7.8	8.9	10.8	11.8	13.1	14.4	16.8
		W360(plf)	221	292	331	387	473	515	556	630	739
		N-ds	24-3/8"	24-3/8"	28-3/8"	32-3/8"	24-1/2"	28-1/2"	28-1/2"	34-1/2"	38-1/2"
		leff(in4)	469	619	701	821	1000	1090	1180	1340	1570
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(2)H	(2)H	(2)H
	32	Wt(plf)	6.5	7.0	7.8	8.7	9.6	10.8	12.3	13.9	16.1
		W360(plf)	236	299	370	425	477	540	606	667	776
		N-ds	24-3/8"	24-3/8"	28-3/8"	32-3/8"	38-3/8"	42-3/8"	30-1/2"	30-1/2"	34-1/2"
		leff(in4)	501	633	784	902	1010	1140	1290	1410	1650
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(2)H	(2)H
	36	Wt(plf)	6.3	6.9	7.5	8.8	9.8	11.0	11.9	13.2	15.2
		W360(plf)	258	332	397	489	538	603	673	731	878
		N-ds	24-3/8"	24-3/8"	24-3/8"	30-3/8"	32-3/8"	24-1/2"	26-1/2"	26-1/2"	32-1/2"
		leff(in4)	546	705	842	1040	1140	1280	1430	1550	1860
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(2)H	(2)H



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT		2 1/2"	5"	7 1/2"								
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	2	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
25	31	34	36	40	44	49	54	61	63	70	76	88
480	573	634	697	780	828	930	998	1192	1219	1339	1420	1610
54-5/8"	52-3/4"	60-3/4"	58-3/4"	66-3/4"	74-3/4"	88-3/4"	94-3/4"	96-3/4"	96-3/4"	110-3/4"	124-3/4"	150-3/4"
1020	1220	1350	1480	1650	1760	1970	2120	2530	2580	2840	3010	3410
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
24	28	31	36	37	41	45	52	54	63	66	71	79
545	646	710	851	878	961	1051	1193	1309	1483	1523	1631	1785
48-5/8"	46-3/4"	52-3/4"	58-3/4"	56-3/4"	66-3/4"	74-3/4"	88-3/4"	76-3/4"	96-3/4"	96-3/4"	110-3/4"	124-3/4"
1160	1370	1510	1800	1860	2040	2230	2530	2780	3150	3230	3460	3790
(3)H	(2)H	(2)X	(2)X	(1)X								
22	27	28	33	36	38	42	48	54	56	65	66	74
618	732	782	925	1026	1058	1190	1314	1560	1590	1817	1817	2003
44-5/8"	42-3/4"	46-3/4"	48-3/4"	58-3/4"	56-3/4"	66-3/4"	74-3/4"	76-3/4"	76-3/4"	96-3/4"	96-3/4"	110-3/4"
1310	1550	1660	1960	2180	2240	2520	2790	3310	3370	3850	3850	4250
(3)H	(2)H	(1)X	(1)X	(1)X								
21	25	27	30	33	38	42	45	50	56	59	66	70
691	808	870	994	1096	1243	1398	1457	1679	1862	1906	2131	2188
40-5/8"	38-3/4"	42-3/4"	40-3/4"	48-3/4"	56-3/4"	66-3/4"	66-3/4"	66-3/4"	76-3/4"	76-3/4"	96-3/4"	96-3/4"
1470	1710	1840	2110	2320	2640	2970	3090	3560	3950	4040	4520	4640
(3)H	(2)H	(1)X	(1)X	(1)X								
21	23	27	29	33	34	38	42	45	50	55	59	65
789	860	1007	1084	1267	1303	1458	1638	1791	1941	2148	2199	2462
40-5/8"	46-5/8"	42-3/4"	38-3/4"	48-3/4"	46-3/4"	56-3/4"	66-3/4"	56-3/4"	66-3/4"	76-3/4"	76-3/4"	96-3/4"
1670	1820	2140	2300	2690	2760	3090	3480	3800	4120	4560	4660	5220
(3)H	(2)H	(2)X	(1)X	(1)X								
19.6	22	25	27	30	33	38	39	45	50	52	56	59
840	933	1079	1198	1320	1456	1663	1715	2037	2210	2243	2445	2504
36-5/8"	42-5/8"	38-3/4"	38-3/4"	40-3/4"	48-3/4"	56-3/4"	56-3/4"	56-3/4"	66-3/4"	66-3/4"	76-3/4"	76-3/4"
1780	1980	2290	2540	2800	3090	3530	3640	4320	4690	4760	5190	5310
(3)H	(2)H	(2)X	(2)X	(1)X								
18.7	22	24	26	29	31	35	39	42	47	50	53	59
875	1052	1134	1265	1403	1497	1696	1933	2096	2334	2485	2523	2819
34-5/8"	42-5/8"	44-5/8"	34-3/4"	38-3/4"	40-3/4"	46-3/4"	56-3/4"	48-3/4"	56-3/4"	66-3/4"	66-3/4"	76-3/4"
1860	2230	2400	2680	2980	3170	3600	4100	4450	4950	5270	5350	5980
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)X	(1)X	(1)X
18.7	21	23	26	28	31	36	38	43	47	50	55	59
976	1093	1200	1350	1464	1603	1925	1970	2330	2595	2633	2873	3139
34-5/8"	38-5/8"	40-5/8"	40-5/8"	34-3/4"	36-3/4"	46-3/4"	46-3/4"	48-3/4"	56-3/4"	56-3/4"	66-3/4"	76-3/4"
2070	2320	2550	2860	3100	3400	4080	4180	4940	5500	5580	6090	6660
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)H	(1)X	(1)X	(1)X
17.7	20	22	24	27	28	33	37	40	44	45	50	53
1092	1205	1351	1520	1667	1779	2078	2351	2526	2856	2856	3170	3243
30-5/8"	34-5/8"	36-5/8"	30-3/4"	32-3/4"	34-3/4"	40-3/4"	46-3/4"	40-3/4"	48-3/4"	48-3/4"	56-3/4"	56-3/4"
2320	2560	2870	3220	3540	3770	4410	4990	5360	6060	6060	6720	6880
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
50	20	Wt(plf)	9.0	10.5	11.8	13.6	16.1	17.4	18.7	21	25
		W360(plf)	128	163	187	219	253	271	289	322	389
		N-ds	26-1/2"	26-1/2"	30-1/2"	36-1/2"	44-1/2"	48-1/2"	54-1/2"	40-5/8"	50-5/8"
		leff(in4)	373	475	545	636	736	790	839	936	1130
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	22	Wt(plf)	8.4	10.2	11.4	13.0	14.5	16.3	17.6	19.9	24
		W360(plf)	142	183	214	249	278	304	327	371	446
		N-ds	28-3/8"	26-1/2"	28-1/2"	34-1/2"	40-1/2"	44-1/2"	48-1/2"	38-5/8"	46-5/8"
		leff(in4)	412	533	621	724	808	885	950	1080	1300
		Bridging	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H
	24	Wt(plf)	8.0	9.4	10.5	11.8	13.7	15.5	17.6	18.5	23
		W360(plf)	157	203	237	271	310	338	386	407	499
		N-ds	26-3/8"	36-3/8"	42-3/8"	52-3/8"	36-1/2"	40-1/2"	48-1/2"	46-1/2"	42-5/8"
		leff(in4)	456	590	689	789	903	984	1120	1180	1450
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H
	26	Wt(plf)	7.5	8.9	9.9	11.1	13.2	14.8	16.6	18.1	22
		W360(plf)	168	220	259	296	342	371	419	467	553
		N-ds	26-3/8"	32-3/8"	40-3/8"	48-3/8"	34-1/2"	36-1/2"	44-1/2"	46-1/2"	40-5/8"
		leff(in4)	489	641	755	862	995	1080	1220	1360	1610
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H
	28	Wt(plf)	7.4	8.4	9.6	10.5	12.8	13.9	15.9	17.2	21
		W360(plf)	191	235	279	311	372	415	453	498	606
		N-ds	26-3/8"	30-3/8"	38-3/8"	42-3/8"	32-1/2"	36-1/2"	40-1/2"	42-1/2"	36-5/8"
		leff(in4)	555	683	812	906	1080	1210	1320	1450	1760
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H
	30	Wt(plf)	6.9	7.8	9.2	11.0	12.3	14.1	15.0	16.7	19.6
		W360(plf)	198	245	303	350	402	459	485	539	644
		N-ds	26-3/8"	28-3/8"	36-3/8"	26-1/2"	30-1/2"	34-1/2"	36-1/2"	38-1/2"	34-5/8"
leff(in4)		575	713	883	1020	1170	1330	1410	1570	1880	
Bridging		(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	
32	Wt(plf)	6.9	7.6	8.6	10.0	11.8	12.9	14.7	16.3	19.5	
	W360(plf)	222	260	317	379	429	475	516	598	718	
	N-ds	26-3/8"	26-3/8"	32-3/8"	40-3/8"	28-1/2"	32-1/2"	34-1/2"	38-1/2"	34-5/8"	
	leff(in4)	646	758	922	1100	1250	1380	1500	1740	2090	
	Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	
36	Wt(plf)	6.9	7.6	8.5	9.5	10.7	12.3	14.1	15.0	17.8	
	W360(plf)	249	298	362	418	472	527	600	652	766	
	N-ds	26-3/8"	26-3/8"	30-3/8"	36-3/8"	40-3/8"	28-1/2"	30-1/2"	32-1/2"	28-5/8"	
	leff(in4)	725	868	1050	1220	1370	1530	1750	1900	2230	
	Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	
40	Wt(plf)	6.8	7.5	9.0	10.3	11.3	12.8	13.7	14.4	16.9	
	W360(plf)	257	325	414	482	540	620	680	728	856	
	N-ds	26-3/8"	26-3/8"	28-3/8"	32-3/8"	26-1/2"	26-1/2"	28-1/2"	30-1/2"	26-5/8"	
	leff(in4)	748	947	1200	1400	1570	1800	1980	2120	2490	
	Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(3)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
30	34	39	40	45	49	54	60	67	70	75	88	89
505	560	636	689	748	817	878	985	1155	1204	1287	1464	1464
52-3/4"	60-3/4"	68-3/4"	64-3/4"	72-3/4"	86-3/4"	92-3/4"	108-3/4"	108-3/4"	108-3/4"	122-3/4"	148-3/4"	148-3/4"
1470	1630	1850	2000	2180	2380	2560	2870	3360	3500	3740	4260	4260
(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
27	31	36	39	41	45	51	60	62	70	71	79	88
541	615	708	806	834	906	1030	1184	1292	1441	1449	1588	1755
58-5/8"	52-3/4"	60-3/4"	66-3/4"	64-3/4"	72-3/4"	86-3/4"	108-3/4"	94-3/4"	108-3/4"	108-3/4"	122-3/4"	148-3/4"
1580	1790	2060	2340	2430	2640	3000	3440	3760	4190	4220	4620	5110
(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
25	31	33	36	41	42	50	54	58	66	71	75	80
606	726	760	877	982	1011	1196	1256	1400	1580	1706	1755	1870
54-5/8"	52-3/4"	52-3/4"	56-3/4"	64-3/4"	64-3/4"	86-3/4"	86-3/4"	80-3/4"	94-3/4"	108-3/4"	108-3/4"	122-3/4"
1760	2110	2210	2550	2860	2940	3480	3660	4070	4600	4960	5110	5440
(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
24	28	33	33	38	42	48	54	56	61	66	74	76
662	775	884	926	1051	1174	1301	1461	1579	1682	1843	2035	2035
50-5/8"	46-3/4"	52-3/4"	46-3/4"	54-3/4"	64-3/4"	72-3/4"	86-3/4"	74-3/4"	80-3/4"	94-3/4"	108-3/4"	108-3/4"
1930	2260	2570	2690	3060	3420	3790	4250	4590	4890	5360	5920	5920
(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
23	27	31	33	38	39	44	50	56	59	66	70	76
718	842	928	1061	1204	1236	1385	1539	1805	1868	2110	2166	2331
46-5/8"	42-3/4"	46-3/4"	46-3/4"	54-3/4"	54-3/4"	64-3/4"	72-3/4"	74-3/4"	74-3/4"	94-3/4"	94-3/4"	108-3/4"
2090	2450	2700	3090	3500	3600	4030	4480	5250	5440	6140	6300	6780
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
22	25	27	33	35	38	42	48	50	56	61	66	70
774	884	965	1202	1236	1376	1548	1717	1844	2064	2190	2387	2452
42-5/8"	48-5/8"	42-3/4"	46-3/4"	46-3/4"	54-3/4"	64-3/4"	72-3/4"	64-3/4"	74-3/4"	80-3/4"	94-3/4"	94-3/4"
2250	2570	2810	3500	3600	4000	4500	4990	5370	6000	6370	6950	7130
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
22	25	29	31	35	36	41	46	51	53	60	66	71
868	949	1116	1229	1386	1420	1613	1809	2064	2115	2377	2514	2747
42-5/8"	36-3/4"	42-3/4"	40-3/4"	46-3/4"	46-3/4"	54-3/4"	64-3/4"	64-3/4"	64-3/4"	74-3/4"	80-3/4"	94-3/4"
2520	2760	3250	3580	4030	4130	4690	5260	6000	6150	6920	7310	7990
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)X	(1)X	(1)X
21	23	26	30	32	36	38	43	48	50	56	61	65
978	1087	1191	1418	1543	1737	1781	2025	2357	2412	2650	2899	2972
36-5/8"	40-5/8"	44-5/8"	38-3/4"	40-3/4"	46-3/4"	46-3/4"	54-3/4"	56-3/4"	56-3/4"	64-3/4"	74-3/4"	74-3/4"
2840	3160	3460	4130	4490	5060	5180	5890	6860	7020	7710	8430	8650
(3)H	(2)H	(2)H	(2)H	(1)X	(1)X	(1)X						
20	22	24	27	30	32	37	43	45	50	53	57	65
1083	1201	1320	1483	1691	1735	2085	2402	2545	2850	2927	3135	3520
34-5/8"	36-5/8"	34-3/4"	32-3/4"	38-3/4"	36-3/4"	46-3/4"	54-3/4"	48-3/4"	56-3/4"	56-3/4"	64-3/4"	74-3/4"
3150	3490	3840	4310	4920	5050	6070	6990	7400	8290	8520	9120	10240
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
55	24	Wt(plf)	9.5	10.7	12.2	13.6	16.3	17.6	19.1	22	26
		W360(plf)	147	174	210	234	271	291	313	364	424
		N-ds	28-1/2"	28-1/2"	32-1/2"	36-1/2"	44-1/2"	48-1/2"	52-1/2"	44-5/8"	50-5/8"
		Ieff(in4)	569	674	812	906	1050	1130	1210	1410	1640
		Bridging	(1)X+(3)H	(1)X+(2)H	(3)H						
	26	Wt(plf)	8.9	10.0	12.0	13.1	14.6	17.6	19.2	21	25
		W360(plf)	157	188	233	258	289	340	366	404	472
		N-ds	30-3/8"	38-3/8"	30-1/2"	34-1/2"	40-1/2"	48-1/2"	52-1/2"	40-5/8"	46-5/8"
		Ieff(in4)	609	726	902	1000	1120	1320	1420	1570	1830
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H
	28	Wt(plf)	8.5	9.8	11.2	12.6	13.9	16.6	18.2	20	24
		W360(plf)	167	206	245	282	314	365	396	445	514
N-ds		28-3/8"	36-3/8"	28-1/2"	32-1/2"	36-1/2"	44-1/2"	46-1/2"	38-5/8"	42-5/8"	
Ieff(in4)		647	800	947	1090	1220	1410	1530	1720	1990	
Bridging		(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	
30	Wt(plf)	8.2	9.3	10.4	11.6	13.4	16.0	17.2	19.0	23	
	W360(plf)	180	220	260	298	339	391	420	470	556	
	N-ds	28-3/8"	32-3/8"	40-3/8"	48-3/8"	34-1/2"	40-1/2"	42-1/2"	46-1/2"	40-5/8"	
	Ieff(in4)	696	852	1010	1150	1310	1510	1630	1820	2150	
	Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	
32	Wt(plf)	7.9	9.2	10.3	11.5	13.4	15.2	17.2	19.0	23	
	W360(plf)	188	248	293	335	382	415	474	531	628	
	N-ds	28-3/8"	32-3/8"	40-3/8"	48-3/8"	34-1/2"	36-1/2"	42-1/2"	46-1/2"	40-5/8"	
	Ieff(in4)	730	960	1130	1300	1480	1610	1840	2060	2430	
	Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	
34	Wt(plf)	7.8	8.7	9.8	11.9	13.0	15.0	16.0	17.8	21	
	W360(plf)	211	257	307	365	404	464	493	551	660	
	N-ds	28-3/8"	30-3/8"	38-3/8"	28-1/2"	32-1/2"	36-1/2"	40-1/2"	42-1/2"	36-5/8"	
	Ieff(in4)	815	995	1190	1410	1570	1800	1910	2130	2560	
	Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	
36	Wt(plf)	7.8	9.3	10.9	12.4	13.6	15.5	17.0	19.3	21	
	W360(plf)	213	287	336	398	440	501	540	635	700	
	N-ds	28-3/8"	30-3/8"	36-3/8"	28-1/2"	28-1/2"	28-5/8"	28-5/8"	30-5/8"	34-5/8"	
	Ieff(in4)	824	1110	1300	1540	1700	1940	2090	2460	2710	
	Bridging	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	
40	Wt(plf)	7.5	8.5	9.8	10.5	12.3	14.3	15.3	17.4	20	
	W360(plf)	232	298	369	408	486	554	591	689	771	
	N-ds	28-3/8"	28-3/8"	32-3/8"	38-3/8"	28-1/2"	30-1/2"	32-1/2"	38-1/2"	30-5/8"	
	Ieff(in4)	897	1160	1430	1580	1880	2140	2290	2670	2990	
	Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	
44	Wt(plf)	7.9	8.4	9.7	10.8	12.5	13.4	14.8	16.3	19.4	
	W360(plf)	276	332	406	469	536	585	655	722	856	
	N-ds	28-3/8"	28-3/8"	30-3/8"	28-1/2"	28-1/2"	28-1/2"	30-1/2"	28-5/8"	28-5/8"	
	Ieff(in4)	1070	1290	1570	1810	2080	2270	2540	2800	3310	
	Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(2)H	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT		2 1/2"	5"	7 1/2"								
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
31	36	39	41	45	50	60	62	70	75	88	89	92
540	621	682	733	798	886	1037	1073	1262	1360	1571	1585	1628
52-3/4"	60-3/4"	68-3/4"	60-3/4"	70-3/4"	82-3/4"	104-3/4"	104-3/4"	106-3/4"	120-3/4"	146-3/4"	146-3/4"	146-3/4"
2090	2410	2640	2840	3090	3430	4020	4150	4890	5270	6080	6140	6310
(3)H	(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
28	33	36	41	45	50	53	62	66	71	79	89	92
578	660	735	854	930	1032	1087	1251	1367	1487	1650	1846	1895
46-3/4"	52-3/4"	60-3/4"	60-3/4"	70-3/4"	82-3/4"	82-3/4"	104-3/4"	92-3/4"	106-3/4"	120-3/4"	146-3/4"	146-3/4"
2240	2550	2840	3310	3600	4000	4210	4850	5290	5760	6390	7150	7340
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
28	33	36	38	42	46	53	58	66	66	75	80	92
665	759	846	904	1010	1096	1251	1326	1570	1590	1777	1911	2178
46-3/4"	52-3/4"	60-3/4"	52-3/4"	60-3/4"	70-3/4"	82-3/4"	90-3/4"	92-3/4"	92-3/4"	106-3/4"	120-3/4"	146-3/4"
2580	2940	3280	3500	3910	4240	4850	5140	6080	6160	6880	7400	8577
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
27	30	33	38	42	44	50	56	61	66	75	76	84
716	790	875	1028	1149	1174	1307	1467	1636	1805	2018	2034	2223
42-3/4"	46-3/4"	52-3/4"	52-3/4"	60-3/4"	60-3/4"	70-3/4"	82-3/4"	78-3/4"	92-3/4"	106-3/4"	106-3/4"	120-3/4"
2770	3060	3390	3980	4450	4550	5060	5680	6340	6990	7810	7880	8610
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
26	30	33	35	39	44	50	56	59	66	71	76	80
757	891	987	1048	1188	1322	1473	1653	1784	2030	2106	2288	2339
38-3/4"	46-3/4"	52-3/4"	46-3/4"	52-3/4"	60-3/4"	70-3/4"	82-3/4"	72-3/4"	92-3/4"	92-3/4"	106-3/4"	106-3/4"
2930	3450	3820	4060	4600	5120	5700	6400	6910	7860	8160	8860	9060
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
24	27	31	35	39	40	45	50	56	61	70	71	76
788	912	1006	1169	1325	1336	1519	1667	1942	2074	2348	2365	2550
44-5/8"	42-3/4"	46-3/4"	46-3/4"	52-3/4"	52-3/4"	60-3/4"	70-3/4"	72-3/4"	78-3/4"	92-3/4"	92-3/4"	106-3/4"
3050	3530	3900	4530	5130	5170	5880	6460	7520	8030	9090	9160	9870
(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
24	28	31	34	35	40	44	48	52	56	61	70	71
884	974	1114	1293	1303	1478	1657	1815	1964	2168	2315	2614	2614
36-3/4"	38-3/4"	46-3/4"	46-3/4"	46-3/4"	52-3/4"	60-3/4"	70-3/4"	62-3/4"	72-3/4"	78-3/4"	92-3/4"	92-3/4"
3420	3770	4310	5010	5050	5720	6420	7030	7610	8390	8970	10120	10120
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
23	26	30	33	37	38	43	48	51	56	64	67	76
991	1087	1262	1408	1588	1619	1843	2072	2193	2423	2742	2857	3195
40-5/8"	44-5/8"	42-3/4"	40-3/4"	46-3/4"	46-3/4"	52-3/4"	60-3/4"	54-3/4"	62-3/4"	72-3/4"	78-3/4"	92-3/4"
3840	4210	4890	5450	6150	6270	7140	8020	8490	9380	10620	11060	12370
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
22	24	27	30	33	37	42	45	50	53	57	65	66
1064	1186	1303	1521	1656	1867	2121	2212	2553	2634	2847	3217	3217
38-5/8"	34-3/4"	36-3/4"	38-3/4"	40-3/4"	46-3/4"	52-3/4"	52-3/4"	54-3/4"	54-3/4"	62-3/4"	72-3/4"	72-3/4"
4120	4590	5040	5890	6410	7230	8210	8560	9880	10200	11020	12460	12460
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(1)H	(1)X	(1)X	(1)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1.5	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
60	24	Wt(plf)	10.9	12.6	14.4	16.5	18.9	20	24	25	30
		W360(plf)	128	158	185	211	242	252	288	314	379
		N-ds	30-1/2"	30-1/2"	36-1/2"	42-1/2"	52-1/2"	56-1/2"	48-5/8"	50-5/8"	52-3/4"
		leff(in4)	643	793	932	1060	1220	1270	1450	1580	1910
		Bridging	(1)X+(3)H								
	26	Wt(plf)	10.4	12.3	13.8	15.5	17.5	19.1	22	24	30
		W360(plf)	141	174	205	230	263	283	319	351	443
		N-ds	36-3/8"	30-1/2"	34-1/2"	40-1/2"	48-1/2"	52-1/2"	44-5/8"	46-5/8"	52-3/4"
		leff(in4)	711	877	1030	1160	1320	1420	1600	1760	2230
		Bridging	(1)X+(3)H								
	28	Wt(plf)	9.7	11.1	12.5	15.5	16.6	19.3	21	23	27
		W360(plf)	152	189	218	265	282	326	351	383	466
		N-ds	32-3/8"	30-1/2"	32-1/2"	40-1/2"	44-1/2"	52-1/2"	40-5/8"	42-5/8"	56-5/8"
		leff(in4)	765	950	1100	1330	1420	1640	1760	1930	2340
		Bridging	(1)X+(3)H								
	30	Wt(plf)	9.5	10.8	12.0	13.8	16.6	18.3	20	22	26
		W360(plf)	161	206	236	277	322	350	379	416	505
		N-ds	30-3/8"	30-1/2"	30-1/2"	36-1/2"	44-1/2"	46-1/2"	52-1/2"	40-5/8"	52-5/8"
		leff(in4)	808	1030	1190	1390	1620	1760	1910	2090	2540
		Bridging	(1)X+(3)H								
	32	Wt(plf)	9.5	10.4	11.6	13.4	16.0	17.3	19.0	21	26
		W360(plf)	181	217	254	297	343	368	402	449	571
		N-ds	30-3/8"	30-1/2"	30-1/2"	34-1/2"	40-1/2"	42-1/2"	46-1/2"	36-5/8"	52-5/8"
		leff(in4)	912	1090	1270	1490	1720	1850	2020	2260	2870
		Bridging	(1)X+(3)H								
	36	Wt(plf)	8.5	9.7	11.6	13.2	15.1	16.7	18.5	21.0	23
		W360(plf)	197	242	303	341	402	437	475	536	627
		N-ds	30-3/8"	32-3/8"	30-1/2"	30-1/2"	36-1/2"	38-1/2"	30-5/8"	34-5/8"	46-5/8"
		leff(in4)	988	1210	1520	1710	2020	2200	2390	2690	3150
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H
	40	Wt(plf)	8.7	10.0	11.5	13.0	14.7	17.1	18.7	19.6	22
		W360(plf)	221	274	331	391	444	511	550	601	721
		N-ds	30-3/8"	30-3/8"	38-3/8"	30-1/2"	30-1/2"	30-5/8"	30-5/8"	30-5/8"	42-5/8"
		leff(in4)	1110	1380	1670	1970	2230	2570	2770	3020	3630
		Bridging	(1)X+(3)H	(1)X+(3)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H
	44	Wt(plf)	9.0	9.9	12.2	14.1	15.1	16.4	18.0	19.6	23
		W360(plf)	242	304	384	439	506	566	610	672	825
		N-ds	30-3/8"	30-3/8"	30-1/2"	30-1/2"	30-1/2"	32-1/2"	30-5/8"	30-5/8"	38-5/8"
		leff(in4)	1220	1530	1930	2210	2540	2850	3070	3380	4150
		Bridging	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(1)X+(2)H	(3)H	(3)H	(3)H	(3)H	(2)H
	48	Wt(plf)	8.0	9.1	10.6	11.9	13.5	15.3	16.8	18.4	20
		W360(plf)	252	326	404	454	535	608	655	757	833
		N-ds	30-3/8"	30-3/8"	32-3/8"	38-3/8"	30-1/2"	30-1/2"	32-1/2"	38-1/2"	46-1/2"
		leff(in4)	1270	1640	2030	2280	2690	3060	3290	3810	4190
		Bridging	(1)X+(2)H	(3)H	(3)H						



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT		2 1/2"	5"	7 1/2"								
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	3.5	3.5	3.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
36	39	43	49	53	58	67	74	87	88	94		
472	518	567	659	704	770	870	966	1177	1196	1373		
60-3/4"	68-3/4"	74-3/4"	82-3/4"	88-3/4"	104-3/4"	118-3/4"	134-3/4"	144-3/4"	144-3/4"	144-3/4"		
2370	2610	2850	3310	3540	3870	4380	4860	5920	6010	6900		
(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X		
34	39	43	49	50	58	62	70	75	88	92	95	
532	605	663	769	789	899	950	1062	1205	1394	1568	1612	
60-3/4"	68-3/4"	74-3/4"	82-3/4"	82-3/4"	104-3/4"	104-3/4"	118-3/4"	118-3/4"	144-3/4"	144-3/4"	144-3/4"	
2670	3040	3330	3870	3970	4520	4780	5340	6060	7010	7880	8110	
(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	
31	36	41	45	50	52	61	69	71	79	92	93	96
560	646	725	819	910	935	1080	1227	1304	1449	1802	1820	1870
52-3/4"	60-3/4"	66-3/4"	68-3/4"	82-3/4"	82-3/4"	104-3/4"	118-3/4"	104-3/4"	118-3/4"	144-3/4"	144-3/4"	144-3/4"
2820	3250	3640	4120	4580	4700	5430	6170	6560	7280	9060	9150	9400
(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
31	36	41	42	46	52	56	65	71	79	80	93	94
639	737	827	882	958	1066	1136	1304	1485	1650	1790	2069	2087
52-3/4"	60-3/4"	66-3/4"	60-3/4"	68-3/4"	82-3/4"	88-3/4"	104-3/4"	104-3/4"	118-3/4"	118-3/4"	144-3/4"	144-3/4"
3210	3710	4160	4430	4810	5360	5710	6560	7470	8290	9000	10400	10490
(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
30	33	38	42	47	48	56	66	67	75	79	85	96
673	757	861	995	1082	1108	1265	1475	1559	1744	1927	2083	2394
56-5/8"	52-3/4"	58-3/4"	60-3/4"	68-3/4"	68-3/4"	82-3/4"	104-3/4"	90-3/4"	104-3/4"	104-3/4"	118-3/4"	144-3/4"
3380	3810	4330	5000	5440	5570	6360	7420	7840	8770	9690	10470	12040
(3)H	(3)H	(3)H	(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X	(2)X
27	31	33	38	43	44	50	56	61	67	71	76	84
779	861	954	1116	1248	1276	1424	1598	1773	1957	2155	2347	2595
42-3/4"	46-3/4"	52-3/4"	52-3/4"	60-3/4"	60-3/4"	68-3/4"	82-3/4"	76-3/4"	90-3/4"	90-3/4"	104-3/4"	118-3/4"
3920	4330	4800	5610	6280	6420	7160	8030	8910	9840	10830	11800	13050
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
26	29	33	35	40	44	46	54	59	62	70	72	80
883	982	1153	1219	1383	1539	1585	1900	2066	2159	2587	2606	2905
38-3/4"	42-3/4"	52-3/4"	46-3/4"	52-3/4"	60-3/4"	60-3/4"	82-3/4"	70-3/4"	76-3/4"	90-3/4"	90-3/4"	104-3/4"
4440	4940	5800	6130	6950	7740	7970	9550	10390	10860	13010	13100	14600
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
26	29	34	37	38	42	48	54	55	63	66	74	75
997	1102	1282	1477	1488	1685	1922	2128	2218	2513	2764	3124	3144
44-5/8"	38-3/4"	44-3/4"	46-3/4"	46-3/4"	52-3/4"	60-3/4"	68-3/4"	60-3/4"	70-3/4"	76-3/4"	90-3/4"	90-3/4"
5010	5540	6450	7420	7480	8470	9660	10700	11150	12630	13900	15700	15810
(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X
24	27	30	33	37	39	45	51	56	57	66	67	77
1058	1163	1349	1502	1695	1729	2000	2244	2553	2577	3059	3078	3609
40-5/8"	44-5/8"	42-3/4"	40-3/4"	46-3/4"	46-3/4"	52-3/4"	60-3/4"	60-3/4"	60-3/4"	70-3/4"	70-3/4"	90-3/4"
5320	5850	6780	7550	8520	8690	10050	11280	12840	12960	15380	15480	18140
(3)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)H	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1.5	
		tc (in.)	2	2	2	2	2	2	2	2	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
65	30	Wt(plf)	10.6	12.4	14.2	16.4	17.9	21	23	25	31
		W360(plf)	146	181	213	255	274	317	333	371	461
		N-ds	36-3/8"	34-1/2"	34-1/2"	44-1/2"	48-1/2"	40-5/8"	44-5/8"	46-5/8"	52-3/4"
		Ieff(in4)	936	1160	1360	1630	1750	2020	2130	2370	2950
		Bridging	(4)X	(3)X							
	32	Wt(plf)	10.2	11.7	14.0	15.6	18.1	19.9	22	25	28
		W360(plf)	156	195	241	271	313	339	367	426	475
		N-ds	34-3/8"	42-3/8"	34-1/2"	40-1/2"	46-1/2"	52-1/2"	40-5/8"	48-5/8"	56-5/8"
		Ieff(in4)	998	1240	1540	1730	2000	2170	2350	2720	3040
		Bridging	(4)X	(3)X	(3)X						
	34	Wt(plf)	10.3	11.5	13.7	15.1	16.9	18.9	21	24	28
		W360(plf)	175	208	255	286	324	357	385	447	541
		N-ds	34-3/8"	40-3/8"	34-1/2"	36-1/2"	44-1/2"	46-1/2"	38-5/8"	42-5/8"	46-3/4"
		Ieff(in4)	1120	1330	1630	1830	2070	2280	2460	2850	3460
		Bridging	(4)X	(3)X							
	36	Wt(plf)	10.1	11.5	13.2	14.9	16.0	18.9	20	23	26
		W360(plf)	181	232	270	319	339	398	429	473	565
		N-ds	34-3/8"	40-3/8"	34-1/2"	36-1/2"	40-1/2"	46-1/2"	38-5/8"	40-5/8"	52-5/8"
		Ieff(in4)	1150	1480	1730	2040	2170	2550	2750	3020	3610
		Bridging	(4)X	(3)X							
	38	Wt(plf)	9.6	10.8	13.0	14.6	16.2	18.0	19.7	22	27
		W360(plf)	198	237	283	333	375	409	446	498	634
		N-ds	34-3/8"	34-1/2"	34-1/2"	34-1/2"	40-1/2"	42-1/2"	34-5/8"	36-5/8"	42-3/4"
		Ieff(in4)	1270	1520	1810	2130	2400	2620	2850	3190	4050
		Bridging	(4)X	(3)X							
	40	Wt(plf)	9.3	10.8	12.7	14.0	15.6	18.3	20.0	22	25
		W360(plf)	202	249	308	346	391	455	500	554	647
		N-ds	34-3/8"	36-3/8"	46-3/8"	34-1/2"	34-1/2"	34-5/8"	34-5/8"	38-5/8"	48-5/8"
Ieff(in4)		1290	1590	1970	2210	2500	2910	3200	3540	4140	
Bridging		(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	
44	Wt(plf)	9.1	10.7	11.8	14.2	16.2	17.8	18.9	20	24	
	W360(plf)	227	282	335	398	452	513	547	604	728	
	N-ds	34-3/8"	34-3/8"	40-3/8"	34-1/2"	34-1/2"	38-1/2"	42-1/2"	46-1/2"	44-5/8"	
	Ieff(in4)	1450	1800	2140	2540	2890	3280	3500	3860	4650	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	
48	Wt(plf)	9.4	11.4	13.8	14.8	15.9	18.1	19.6	21	26	
	W360(plf)	248	311	381	446	498	569	615	679	837	
	N-ds	34-3/8"	34-3/8"	34-1/2"	34-1/2"	34-1/2"	34-1/2"	38-1/2"	34-3/4"	34-3/4"	
	Ieff(in4)	1580	1990	2440	2850	3190	3640	3930	4340	5350	
	Bridging	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	
52	Wt(plf)	9.5	10.3	11.5	13.1	15.1	17.2	17.8	18.7	22	
	W360(plf)	259	325	400	455	535	610	641	698	846	
	N-ds	34-3/8"	34-3/8"	36-3/8"	34-1/2"	34-1/2"	34-1/2"	34-1/2"	38-1/2"	38-5/8"	
	Ieff(in4)	1660	2070	2550	2910	3420	3900	4100	4460	5410	
	Bridging	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	3.5	3.5	3.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
36	41	45	50	52	60	67	75	79	89	93		
573	643	704	811	833	954	1059	1177	1284	1445	1618		
60-3/4"	66-3/4"	74-3/4"	78-3/4"	78-3/4"	100-3/4"	116-3/4"	130-3/4"	116-3/4"	142-3/4"	142-3/4"		
3660	4110	4500	5180	5330	6100	6770	7520	8210	9240	10340		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X		
32	36	41	45	52	56	62	70	78	88	92	93	
581	659	739	835	943	997	1120	1253	1451	1633	1826	1844	
66-5/8"	60-3/4"	66-3/4"	66-3/4"	78-3/4"	86-3/4"	100-3/4"	116-3/4"	116-3/4"	142-3/4"	142-3/4"	142-3/4"	
3710	4210	4730	5340	6030	6370	7160	8010	9270	10440	11670	11790	
(3)X	(3)X	(3)X	(3)X	(3)X	(2)X							
33	38	42	47	52	54	63	70	75	80	93	96	97
663	754	845	949	1058	1087	1258	1407	1524	1649	2044	2102	2120
52-3/4"	58-3/4"	66-3/4"	66-3/4"	78-3/4"	78-3/4"	100-3/4"	116-3/4"	102-3/4"	116-3/4"	142-3/4"	142-3/4"	142-3/4"
4230	4820	5400	6070	6760	6950	8040	9000	9740	10540	13070	13430	13550
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
32	36	38	43	48	54	58	66	74	75	84	93	97
726	823	851	982	1084	1210	1289	1460	1695	1718	2028	2292	2355
66-5/8"	60-3/4"	58-3/4"	60-3/4"	66-3/4"	78-3/4"	86-3/4"	100-3/4"	102-3/4"	102-3/4"	116-3/4"	142-3/4"	142-3/4"
4640	5260	5440	6280	6930	7740	8240	9330	10840	10980	12960	14650	15050
(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
31	35	39	44	49	51	57	66	71	76	85	88	97
745	843	958	1099	1199	1229	1382	1615	1738	1897	2236	2293	2598
46-3/4"	50-3/4"	58-3/4"	60-3/4"	66-3/4"	66-3/4"	78-3/4"	100-3/4"	88-3/4"	102-3/4"	116-3/4"	116-3/4"	142-3/4"
4760	5390	6120	7020	7660	7860	8830	10320	11110	12130	14300	14660	16600
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
30	33	38	40	44	50	57	61	67	75	80	84	88
806	909	1035	1094	1218	1350	1518	1628	1860	2081	2286	2472	2533
56-5/8"	52-3/4"	58-3/4"	52-3/4"	60-3/4"	66-3/4"	78-3/4"	86-3/4"	88-3/4"	102-3/4"	102-3/4"	116-3/4"	116-3/4"
5150	5810	6610	6990	7790	8630	9700	10400	11890	13300	14610	15800	16190
(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
28	31	35	40	41	46	51	59	62	71	72	80	86
904	984	1113	1295	1323	1476	1627	1868	2016	2285	2438	2718	2937
52-5/8"	46-3/4"	50-3/4"	52-3/4"	52-3/4"	60-3/4"	66-3/4"	78-3/4"	74-3/4"	88-3/4"	88-3/4"	102-3/4"	116-3/4"
5780	6290	7110	8280	8460	9440	10400	11940	12890	14600	15580	17380	18770
(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
29	32	37	38	44	46	52	56	63	66	74	78	83
1016	1114	1331	1375	1580	1612	1827	1984	2312	2422	2881	2948	3218
38-3/4"	40-3/4"	50-3/4"	46-3/4"	52-3/4"	52-3/4"	60-3/4"	66-3/4"	68-3/4"	74-3/4"	88-3/4"	88-3/4"	102-3/4"
6500	7120	8510	8790	10100	10300	11680	12680	14780	15480	18420	18850	20570
(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
26	29	33	37	39	43	49	56	57	65	69	77	78
1044	1154	1343	1549	1581	1789	2013	2266	2348	2662	2917	3298	3318
36-3/4"	38-3/4"	44-3/4"	46-3/4"	46-3/4"	52-3/4"	60-3/4"	66-3/4"	60-3/4"	68-3/4"	74-3/4"	88-3/4"	88-3/4"
6670	7380	8580	9900	10110	11440	12870	14490	15010	17010	18650	21080	21210
(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1	1	1.5	
		tc (in.)	2	2	2	2	2	2	2	2.5	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
70	32	Wt(plf)	11.4	13.5	15.8	18.5	19.8	22	25	27	31
		W360(plf)	141	184	219	255	272	303	328	359	442
		N-ds	38-3/8"	36-1/2"	38-1/2"	46-1/2"	52-1/2"	44-5/8"	46-5/8"	52-5/8"	52-3/4"
		Ieff(in4)	1130	1470	1750	2040	2170	2420	2620	2870	3530
		Bridging	(4)X								
	34	Wt(plf)	11.0	13.0	15.3	17.1	18.4	22	24	27	32
		W360(plf)	150	195	232	263	283	324	349	405	505
		N-ds	36-3/8"	36-1/2"	36-1/2"	42-1/2"	46-1/2"	40-5/8"	42-5/8"	52-5/8"	66-5/8"
		Ieff(in4)	1200	1550	1850	2100	2260	2590	2790	3230	4030
		Bridging	(4)X	(3)X							
	36	Wt(plf)	11.1	12.8	14.3	16.0	18.4	20	23	26	31
		W360(plf)	168	206	242	273	316	342	385	430	554
		N-ds	36-3/8"	36-1/2"	36-1/2"	40-1/2"	46-1/2"	52-1/2"	42-5/8"	48-5/8"	52-3/4"
		Ieff(in4)	1340	1640	1930	2180	2520	2730	3070	3430	4430
		Bridging	(4)X								
	38	Wt(plf)	10.8	12.4	13.8	16.7	18.4	22	23	24	29
		W360(plf)	175	219	254	310	336	396	416	450	564
		N-ds	36-3/8"	36-1/2"	36-1/2"	38-1/2"	36-5/8"	38-5/8"	42-5/8"	44-5/8"	46-3/4"
		Ieff(in4)	1400	1750	2030	2470	2680	3160	3320	3590	4500
		Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X
	40	Wt(plf)	10.7	12.1	13.9	15.3	17.4	19.3	21	24	29
		W360(plf)	192	228	280	313	359	392	427	496	621
		N-ds	36-3/8"	40-3/8"	36-1/2"	36-1/2"	42-1/2"	46-1/2"	36-5/8"	44-5/8"	46-3/4"
		Ieff(in4)	1530	1820	2230	2500	2860	3130	3410	3960	4960
		Bridging	(4)X	(3)X	(3)X						
	44	Wt(plf)	10.3	11.4	13.1	14.8	16.6	18.6	21	24	28
		W360(plf)	211	254	313	353	402	439	483	562	701
		N-ds	36-3/8"	38-3/8"	48-3/8"	36-1/2"	38-1/2"	36-5/8"	36-5/8"	42-5/8"	42-3/4"
		Ieff(in4)	1690	2030	2500	2820	3210	3500	3850	4490	5600
		Bridging	(4)X	(3)X	(3)X						
	48	Wt(plf)	10.0	11.1	13.1	15.2	17.1	18.2	20.0	22	25
		W360(plf)	230	284	339	402	456	487	560	626	727
		N-ds	36-3/8"	36-3/8"	36-1/2"	36-1/2"	36-1/2"	38-1/2"	46-1/2"	38-5/8"	36-3/4"
		Ieff(in4)	1840	2270	2710	3210	3640	3890	4470	5000	5800
		Bridging	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X
	52	Wt(plf)	10.2	13.1	14.1	15.3	17.4	19.6	22	23	27
		W360(plf)	251	320	381	441	503	577	631	699	859
		N-ds	36-3/8"	36-3/8"	36-1/2"	36-1/2"	36-1/2"	38-1/2"	36-5/8"	36-5/8"	36-3/4"
		Ieff(in4)	2010	2560	3040	3520	4010	4610	5040	5580	6860
		Bridging	(4)X	(4)X	(3)X						
56	Wt(plf)	12.2	12.8	14.0	15.4	16.6	17.8	18.8	21	25	
	W360(plf)	310	334	404	475	530	595	635	706	894	
	N-ds	36-3/8"	36-3/8"	38-3/8"	36-1/2"	36-1/2"	36-1/2"	38-1/2"	36-5/8"	34-3/4"	
	Ieff(in4)	2480	2670	3220	3790	4230	4750	5070	5630	7130	
	Bridging	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	3.5	3.5	3.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
39	43	49	52	60	62	74	84	88	92			
563	619	693	748	858	882	1051	1183	1292	1346			
68-3/4"	74-3/4"	84-3/4"	76-3/4"	98-3/4"	98-3/4"	130-3/4"	158-3/4"	140-3/4"	140-3/4"			
4500	4940	5530	5980	6850	7040	8390	9450	10310	10740			
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X			
36	42	47	52	57	63	71	80	89	94			
585	670	730	841	890	991	1112	1238	1451	1511	1674		
60-3/4"	66-3/4"	74-3/4"	76-3/4"	84-3/4"	98-3/4"	114-3/4"	130-3/4"	140-3/4"	140-3/4"	140-3/4"		
4670	5350	5830	6710	7110	7910	8870	9880	11580	12060	13370		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X		
36	41	45	52	54	62	66	75	80	92	94		
653	734	804	938	965	1106	1156	1296	1457	1684	1830		
60-3/4"	66-3/4"	74-3/4"	76-3/4"	76-3/4"	98-3/4"	98-3/4"	114-3/4"	114-3/4"	140-3/4"	140-3/4"		
5210	5860	6420	7490	7700	8830	9230	10350	11630	13440	14610		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X		
33	38	43	47	52	56	65	71	79	84	93	97	
658	750	840	943	1051	1113	1281	1400	1612	1672	2023	2080	
52-3/4"	58-3/4"	66-3/4"	66-3/4"	76-3/4"	84-3/4"	98-3/4"	114-3/4"	114-3/4"	114-3/4"	140-3/4"	140-3/4"	140-3/4"
5260	5990	6710	7530	8390	8890	10230	11180	12870	13350	16150	16600	
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	
33	38	43	48	54	56	66	75	76	84	94	97	102
725	826	925	1053	1177	1206	1411	1583	1661	1839	2222	2284	2358
52-3/4"	58-3/4"	66-3/4"	66-3/4"	76-3/4"	76-3/4"	98-3/4"	114-3/4"	100-3/4"	114-3/4"	140-3/4"	140-3/4"	140-3/4"
5790	6590	7390	8410	9390	9630	11270	12640	13260	14680	17740	18240	18830
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X						
31	35	40	45	50	55	59	67	71	80	85	89	102
788	893	1014	1161	1288	1416	1494	1711	1833	2045	2351	2411	2798
46-3/4"	50-3/4"	58-3/4"	60-3/4"	66-3/4"	76-3/4"	76-3/4"	98-3/4"	86-3/4"	100-3/4"	114-3/4"	114-3/4"	140-3/4"
6290	7130	8100	9270	10280	11300	11930	13660	14640	16320	18770	19250	22340
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
30	35	40	42	46	51	57	62	71	72	81	86	89
870	1043	1185	1243	1387	1518	1707	1834	2137	2163	2549	2756	2826
42-3/4"	50-3/4"	58-3/4"	52-3/4"	60-3/4"	66-3/4"	76-3/4"	84-3/4"	86-3/4"	86-3/4"	100-3/4"	114-3/4"	114-3/4"
6940	8330	9460	9920	11070	12120	13630	14640	17060	17270	20350	22000	22560
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
31	35	38	44	46	52	55	63	66	75	78	83	88
964	1119	1247	1466	1497	1685	1834	2082	2241	2532	2733	2986	3229
38-3/4"	44-3/4"	50-3/4"	52-3/4"	52-3/4"	60-3/4"	66-3/4"	76-3/4"	72-3/4"	86-3/4"	86-3/4"	100-3/4"	114-3/4"
7700	8930	9950	11700	11950	13450	14640	16620	17890	20210	21820	23840	25780
(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
29	32	37	39	44	46	52	58	66	69	77	79	85
1058	1163	1393	1454	1646	1684	1893	2102	2439	2556	3031	3052	3385
38-3/4"	40-3/4"	50-3/4"	46-3/4"	52-3/4"	52-3/4"	60-3/4"	66-3/4"	68-3/4"	72-3/4"	86-3/4"	86-3/4"	100-3/4"
8450	9290	11120	11610	13140	13450	15110	16780	19480	20410	24190	24360	27030
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2	2.5	2.5	2.5	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
75	34	Wt(plf)	12.4	14.7	16.4	19.0	22	25	27	30	35
		W360(plf)	140	180	204	237	267	304	344	389	450
		N-ds	40-3/8"	38-1/2"	38-1/2"	38-5/8"	40-5/8"	48-5/8"	58-5/8"	64-5/8"	76-5/8"
		Ieff(in4)	1370	1770	2000	2320	2620	2990	3380	3820	4420
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(3)X
	38	Wt(plf)	11.7	13.4	15.3	17.6	20.0	23	24	28	32
		W360(plf)	160	198	234	270	310	336	382	444	510
		N-ds	38-3/8"	38-1/2"	38-1/2"	42-1/2"	52-1/2"	40-5/8"	50-5/8"	56-5/8"	66-5/8"
		Ieff(in4)	1570	1940	2300	2650	3040	3300	3750	4360	5010
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X
	40	Wt(plf)	11.8	13.9	15.5	17.4	19.3	22	25	27	33
		W360(plf)	168	218	258	293	320	366	421	465	563
		N-ds	38-3/8"	38-1/2"	38-1/2"	42-1/2"	46-1/2"	40-5/8"	50-5/8"	52-5/8"	66-5/8"
		Ieff(in4)	1650	2140	2540	2880	3150	3590	4140	4570	5530
		Bridging	(4)X	(3)X							
	42	Wt(plf)	11.5	12.9	14.8	16.4	19.4	22	23	26	32
		W360(plf)	184	225	268	302	355	387	438	510	617
		N-ds	38-3/8"	38-1/2"	38-1/2"	38-1/2"	38-5/8"	38-5/8"	46-5/8"	52-5/8"	66-5/8"
		Ieff(in4)	1800	2210	2630	2960	3490	3800	4300	5000	6060
		Bridging	(4)X	(3)X							
	44	Wt(plf)	11.0	13.2	15.6	17.8	18.8	22	24	27	30
		W360(plf)	189	240	283	341	364	428	483	537	617
		N-ds	38-3/8"	38-1/2"	38-1/2"	38-1/2"	42-1/2"	38-5/8"	44-5/8"	48-5/8"	56-5/8"
		Ieff(in4)	1850	2350	2780	3350	3570	4200	4750	5270	6060
		Bridging	(4)X	(3)X	(3)X						
	48	Wt(plf)	10.8	12.4	13.8	15.7	18.5	20	23	25	29
		W360(plf)	205	264	304	360	418	460	532	580	685
		N-ds	38-3/8"	40-3/8"	38-1/2"	38-1/2"	42-1/2"	38-5/8"	42-5/8"	44-5/8"	52-5/8"
Ieff(in4)		2010	2590	2990	3530	4110	4510	5220	5700	6720	
Bridging		(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	
52	Wt(plf)	10.2	11.6	14.0	16.8	18.2	19.2	21	23	27	
	W360(plf)	218	282	339	411	463	494	573	635	741	
	N-ds	38-3/8"	38-3/8"	38-1/2"	38-1/2"	38-1/2"	42-1/2"	38-5/8"	40-5/8"	48-5/8"	
	Ieff(in4)	2140	2770	3330	4040	4550	4850	5620	6230	7280	
	Bridging	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	
56	Wt(plf)	12.2	13.5	14.8	17.0	19.0	21	23	24	29	
	W360(plf)	256	319	377	446	507	555	623	689	820	
	N-ds	38-3/8"	38-3/8"	38-1/2"	38-1/2"	38-1/2"	38-1/2"	34-5/8"	38-5/8"	34-3/4"	
	Ieff(in4)	2520	3130	3700	4380	4980	5450	6110	6760	8050	
	Bridging	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	
60	Wt(plf)	12.4	13.3	14.6	16.0	17.2	18.8	21	23	27	
	W360(plf)	289	338	404	467	524	593	675	754	893	
	N-ds	38-3/8"	38-3/8"	40-3/8"	38-1/2"	38-1/2"	38-1/2"	34-5/8"	36-5/8"	44-5/8"	
	Ieff(in4)	2840	3320	3960	4590	5140	5820	6630	7400	8770	
	Bridging	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	2.5	3.5	3.5	3.5
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
40	45	51	59	61	67	75	88	92				
527	578	644	762	786	865	964	1119	1212				
66-3/4"	74-3/4"	84-3/4"	96-3/4"	96-3/4"	112-3/4"	126-3/4"	156-3/4"	138-3/4"				
5180	5680	6330	7480	7720	8490	9460	10990	11910				
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X				
38	43	50	52	61	63	71	80	92	93			
603	677	800	849	975	1002	1124	1252	1499	1523			
58-3/4"	66-3/4"	84-3/4"	74-3/4"	96-3/4"	96-3/4"	112-3/4"	126-3/4"	138-3/4"	138-3/4"	138-3/4"		
5920	6640	7850	8340	9580	9840	11040	12300	14720	14960			
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X			
38	43	48	54	59	66	75	81	93	97	102		
665	746	827	952	1007	1132	1272	1382	1652	1706	1894		
58-3/4"	66-3/4"	74-3/4"	74-3/4"	82-3/4"	96-3/4"	112-3/4"	126-3/4"	138-3/4"	138-3/4"	138-3/4"	138-3/4"	
6530	7330	8120	9350	9890	11120	12490	13570	16220	16750	18600		
(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X		
36	42	47	52	54	63	67	75	84	93	97		
715	818	894	1026	1056	1212	1267	1421	1625	1838	2027		
60-3/4"	66-3/4"	74-3/4"	74-3/4"	74-3/4"	96-3/4"	96-3/4"	112-3/4"	110-3/4"	138-3/4"	138-3/4"	138-3/4"	
7020	8040	8780	10080	10370	11910	12440	13950	15960	18050	19900		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X		
35	40	44	48	54	58	66	75	80	92	94	97	
722	822	917	1030	1151	1218	1382	1551	1731	2003	2167	2228	
50-3/4"	58-3/4"	66-3/4"	66-3/4"	74-3/4"	82-3/4"	96-3/4"	112-3/4"	110-3/4"	138-3/4"	138-3/4"	138-3/4"	138-3/4"
7090	8070	9010	10120	11300	11960	13570	15230	17000	19670	21270	21880	
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	
35	40	44	47	52	57	63	72	80	86	89	102	104
848	964	1076	1132	1240	1383	1489	1690	1940	2102	2294	2664	2687
50-3/4"	58-3/4"	66-3/4"	60-3/4"	66-3/4"	74-3/4"	82-3/4"	96-3/4"	98-3/4"	110-3/4"	110-3/4"	138-3/4"	138-3/4"
8320	9470	10570	11120	12180	13580	14620	16600	19050	20640	22530	26160	26380
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X						
32	36	40	46	48	53	60	71	72	81	88	89	103
875	991	1126	1304	1337	1463	1660	1951	2028	2263	2636	2658	3087
46-3/4"	50-3/4"	58-3/4"	60-3/4"	60-3/4"	66-3/4"	74-3/4"	96-3/4"	84-3/4"	98-3/4"	110-3/4"	110-3/4"	138-3/4"
8590	9730	11060	12810	13130	14360	16300	19160	19920	22220	25880	26100	30310
(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
33	38	42	46	52	55	63	66	75	78	83	89	94
970	1159	1315	1394	1571	1699	1931	2030	2350	2414	2780	3008	3099
40-3/4"	50-3/4"	58-3/4"	52-3/4"	60-3/4"	66-3/4"	74-3/4"	82-3/4"	84-3/4"	84-3/4"	98-3/4"	110-3/4"	110-3/4"
9520	11380	12910	13690	15420	16680	18960	19940	23080	23700	27290	29540	30430
(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X
30	34	38	44	46	52	57	66	69	78	79	86	95
986	1149	1299	1521	1558	1740	1935	2197	2356	2663	2820	3130	3464
38-3/4"	44-3/4"	50-3/4"	52-3/4"	52-3/4"	60-3/4"	66-3/4"	74-3/4"	72-3/4"	84-3/4"	84-3/4"	98-3/4"	110-3/4"
9690	11280	12750	14940	15300	17080	19000	21580	23140	26150	27690	30740	34020
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
BEARING HEIGHT		2 1/2"	5"	7 1/2"							
Concrete Slab Parameters											
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi											
		hr (in.)	1	1	1	1	1	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2	2.5	2.5	2.5	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
80	38	Wt(plf)	13.4	15.4	17.8	21	22	25	28	31	36
		W360(plf)	151	186	225	261	274	314	357	405	470
		N-ds	42-3/8"	40-1/2"	42-1/2"	40-5/8"	40-5/8"	52-5/8"	56-5/8"	52-3/4"	60-3/4"
		leff(in4)	1800	2220	2680	3110	3260	3740	4260	4830	5600
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X
	40	Wt(plf)	12.8	14.7	17.0	19.6	23	24	26	30	36
		W360(plf)	158	193	233	270	310	332	369	440	519
		N-ds	40-3/8"	40-1/2"	40-1/2"	40-5/8"	42-5/8"	50-5/8"	54-5/8"	64-5/8"	60-3/4"
		leff(in4)	1880	2300	2770	3220	3690	3950	4400	5250	6180
		Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X
	42	Wt(plf)	13.0	14.7	16.9	19.1	21	24	27	29	36
		W360(plf)	173	211	253	291	314	360	411	451	569
		N-ds	40-3/8"	40-1/2"	40-1/2"	46-1/2"	40-5/8"	48-5/8"	52-5/8"	46-3/4"	60-3/4"
		leff(in4)	2060	2520	3020	3470	3740	4290	4900	5380	6790
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(3)X
	44	Wt(plf)	12.3	14.0	16.0	19.0	21	22	25	27	32
		W360(plf)	176	219	260	304	348	370	418	461	558
		N-ds	40-3/8"	40-1/2"	40-1/2"	42-1/2"	52-1/2"	62-1/2"	50-5/8"	52-5/8"	66-5/8"
		leff(in4)	2100	2610	3090	3620	4140	4410	4980	5490	6650
		Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(3)X
	46	Wt(plf)	11.7	14.2	16.1	18.1	19.5	22	25	28	34
		W360(plf)	181	238	282	321	346	387	454	508	617
		N-ds	40-3/8"	40-1/2"	40-1/2"	42-1/2"	46-1/2"	40-5/8"	50-5/8"	42-3/4"	52-3/4"
		leff(in4)	2160	2830	3360	3830	4120	4610	5410	6050	7350
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(3)X
	48	Wt(plf)	11.7	14.1	16.3	17.9	20.0	22	25	29	33
		W360(plf)	196	246	293	333	384	424	477	566	668
		N-ds	40-3/8"	40-1/2"	40-1/2"	40-1/2"	46-1/2"	42-5/8"	36-3/4"	42-3/4"	52-3/4"
		leff(in4)	2340	2930	3500	3970	4570	5050	5690	6740	7960
		Bridging	(4)X	(3)X	(3)X						
	52	Wt(plf)	12.7	14.3	15.8	18.6	22	23	25	28	32
		W360(plf)	218	275	321	370	433	475	531	615	720
		N-ds	40-3/8"	42-3/8"	40-1/2"	40-1/2"	42-1/2"	38-5/8"	40-5/8"	38-3/4"	44-3/4"
		leff(in4)	2600	3280	3830	4410	5160	5670	6330	7330	8580
		Bridging	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X
	56	Wt(plf)	12.6	14.2	15.6	17.6	18.4	21	23	25	30
		W360(plf)	231	299	347	413	441	524	583	645	763
		N-ds	40-3/8"	40-3/8"	40-1/2"	40-1/2"	40-1/2"	38-5/8"	42-5/8"	36-3/4"	42-3/4"
		leff(in4)	2750	3570	4130	4920	5260	6250	6950	7690	9100
		Bridging	(4)X	(3)X							
	60	Wt(plf)	12.5	13.9	16.0	18.4	21	22	24	27	32
		W360(plf)	242	315	376	451	524	567	637	708	832
		N-ds	40-3/8"	40-3/8"	40-1/2"	40-1/2"	40-1/2"	34-5/8"	38-5/8"	34-3/4"	38-3/4"
		leff(in4)	2880	3760	4480	5370	6240	6760	7590	8430	9920
		Bridging	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
3	3	3	3	3	3.5	3.5	3.5	3.5	3.5	3.5	4	4
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
41	50	52	61	67	71	80	92	96				
562	679	700	830	914	981	1095	1272	1359				
66-3/4"	84-3/4"	84-3/4"	94-3/4"	110-3/4"	110-3/4"	124-3/4"	154-3/4"	136-3/4"				
6700	8090	8340	9890	10900	11700	13050	15160	16190				
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X				
41	46	52	56	63	70	79	89	93				
621	682	772	844	941	1083	1209	1369	1471				
66-3/4"	74-3/4"	84-3/4"	80-3/4"	94-3/4"	110-3/4"	124-3/4"	154-3/4"	136-3/4"				
7390	8130	9210	10060	11220	12900	14400	16320	17530				
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X				
41	47	52	55	64	67	75	84	94	98			
681	759	848	898	1033	1104	1241	1377	1612	1661			
66-3/4"	74-3/4"	84-3/4"	74-3/4"	94-3/4"	94-3/4"	110-3/4"	124-3/4"	136-3/4"	136-3/4"			
8110	9040	10110	10700	12310	13150	14780	16410	19210	19800			
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X			
38	43	49	54	58	66	75	80	93	97			
684	768	852	980	1037	1205	1354	1470	1757	1811			
58-3/4"	66-3/4"	74-3/4"	74-3/4"	80-3/4"	94-3/4"	110-3/4"	124-3/4"	136-3/4"	136-3/4"			
8160	9160	10160	11680	12360	14360	16140	17520	20940	21590			
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X			
38	43	49	55	59	67	75	81	86	97	103		
744	835	927	1064	1127	1309	1471	1597	1704	1966	2033		
58-3/4"	66-3/4"	74-3/4"	74-3/4"	80-3/4"	94-3/4"	110-3/4"	124-3/4"	110-3/4"	136-3/4"	136-3/4"		
8860	9950	11040	12690	13440	15600	17530	19030	20300	23430	24220		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X		
38	43	47	51	56	61	67	76	84	94	97		
804	903	988	1056	1180	1296	1439	1615	1840	2086	2148		
58-3/4"	66-3/4"	74-3/4"	66-3/4"	74-3/4"	80-3/4"	94-3/4"	110-3/4"	110-3/4"	136-3/4"	136-3/4"		
9590	10760	11780	12590	14060	15450	17140	19240	21930	24860	25590		
(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X		
38	42	47	52	58	59	69	78	82	87	97	102	103
866	984	1103	1237	1395	1445	1705	1907	2011	2182	2476	2618	2639
50-3/4"	58-3/4"	66-3/4"	66-3/4"	74-3/4"	74-3/4"	94-3/4"	110-3/4"	96-3/4"	110-3/4"	136-3/4"	136-3/4"	136-3/4"
10320	11720	13150	14750	16620	17230	20320	22720	23960	26000	29510	31200	31450
(3)X	(3)X	(3)X	(3)X	(2)X								
36	40	42	48	54	60	63	72	81	85	90	103	105
960	1093	1120	1299	1423	1646	1731	1968	2251	2311	2505	2974	2997
50-3/4"	58-3/4"	58-3/4"	60-3/4"	66-3/4"	74-3/4"	80-3/4"	94-3/4"	96-3/4"	96-3/4"	110-3/4"	136-3/4"	136-3/4"
11440	13030	13350	15480	16960	19620	20630	23450	26830	27540	29850	35440	35710
(3)X	(3)X	(3)X	(3)X	(3)X	(2)X							
36	40	45	52	53	56	64	70	78	83	85	93	103
1009	1140	1297	1511	1524	1689	1921	2059	2372	2595	2618	2955	3360
44-3/4"	50-3/4"	58-3/4"	60-3/4"	60-3/4"	66-3/4"	74-3/4"	80-3/4"	82-3/4"	96-3/4"	96-3/4"	110-3/4"	136-3/4"
12020	13590	15450	18010	18160	20130	22890	24530	28270	30930	31200	35220	40040
(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 4.0 ksi									
		hr (in.)	1	1	1	1	1.5	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2.5	2.5	2.5	2.5	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
90	44	Wt(plf)	14.7	17.1	21	22	25	28	32	36	42
		W360(plf)	149	188	234	251	278	334	368	429	486
		N-ds	46-3/8"	46-1/2"	46-1/2"	46-5/8"	46-5/8"	56-5/8"	52-3/4"	60-3/4"	66-3/4"
		Ieff(in4)	2530	3190	3980	4250	4710	5670	6250	7280	8240
		Bridging	(5)X	(4)X	(4)X						
	46	Wt(plf)	14.6	17.0	19.1	22	24	26	31	33	41
		W360(plf)	162	205	234	273	303	341	401	427	529
		N-ds	46-3/8"	46-1/2"	46-1/2"	46-5/8"	46-5/8"	54-5/8"	52-3/4"	52-3/4"	66-3/4"
		Ieff(in4)	2760	3470	3970	4640	5130	5790	6810	7250	8980
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X
	48	Wt(plf)	14.5	16.7	19.2	22	23	27	29	34	39
		W360(plf)	169	209	254	293	308	375	401	463	531
		N-ds	46-3/8"	46-1/2"	46-1/2"	46-5/8"	46-5/8"	52-5/8"	46-3/4"	52-3/4"	58-3/4"
		Ieff(in4)	2860	3550	4310	4980	5230	6370	6800	7860	9010
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X
	50	Wt(plf)	13.7	16.5	18.0	20.0	23	25	29	33	38
		W360(plf)	172	226	255	294	337	382	433	501	574
		N-ds	46-3/8"	46-1/2"	46-1/2"	46-1/2"	46-5/8"	48-5/8"	46-3/4"	52-3/4"	58-3/4"
		Ieff(in4)	2930	3840	4330	5000	5720	6480	7350	8500	9740
		Bridging	(5)X	(5)X	(4)X						
	52	Wt(plf)	13.8	15.7	17.9	20.0	22	25	28	31	38
		W360(plf)	186	228	274	316	339	406	442	494	618
		N-ds	46-3/8"	46-1/2"	46-1/2"	46-1/2"	52-1/2"	50-5/8"	42-3/4"	46-3/4"	58-3/4"
		Ieff(in4)	3150	3870	4650	5360	5750	6890	7510	8380	10480
		Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X
	56	Wt(plf)	13.6	15.4	17.6	19.3	23	25	27	31	36
		W360(plf)	199	248	296	338	397	447	478	567	646
		N-ds	46-3/8"	48-3/8"	46-1/2"	46-1/2"	46-5/8"	44-5/8"	38-3/4"	46-3/4"	50-3/4"
Ieff(in4)		3380	4210	5010	5730	6740	7580	8110	9620	10960	
Bridging		(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	
60	Wt(plf)	13.5	15.1	17.7	21	24	25	29	31	38	
	W360(plf)	216	266	321	376	437	493	558	619	753	
	N-ds	46-3/8"	46-3/8"	46-1/2"	46-1/2"	46-1/2"	40-5/8"	38-3/4"	40-3/4"	50-3/4"	
	Ieff(in4)	3660	4520	5440	6380	7410	8360	9470	10500	12780	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	
66	Wt(plf)	13.4	16.9	19.3	21	25	28	30	34	37	
	W360(plf)	241	311	368	417	491	564	613	711	821	
	N-ds	46-3/8"	46-3/8"	46-1/2"	46-1/2"	46-1/2"	34-3/4"	34-3/4"	38-3/4"	44-3/4"	
	Ieff(in4)	4090	5280	6250	7070	8340	9570	10400	12070	13940	
	Bridging	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	
72	Wt(plf)	16.9	18.0	19.4	21	23	24	26	29	33	
	W360(plf)	289	347	404	456	521	581	676	740	866	
	N-ds	46-3/8"	46-3/8"	48-3/8"	46-1/2"	46-1/2"	34-5/8"	40-5/8"	36-3/4"	40-3/4"	
	Ieff(in4)	4900	5890	6860	7740	8830	9860	11480	12560	14700	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 4.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
3	3	3	3	3	3.5	3.5	3.5	3.5	3.5	3.5	4	4
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
47	53	63	71	72	80	94						
578	646	757	868	879	1006	1171						
74-3/4"	84-3/4"	102-3/4"	106-3/4"	106-3/4"	120-3/4"	150-3/4"						
9800	10970	12850	14730	14910	17080	19860						
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X						
46	52	57	63	71	80	92	94					
621	704	750	860	958	1096	1275	1297					
74-3/4"	84-3/4"	88-3/4"	90-3/4"	106-3/4"	120-3/4"	150-3/4"	150-3/4"					
10530	11950	12720	14600	16250	18590	21630	22010					
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X					
45	53	59	66	72	76	93	97					
641	764	825	956	1039	1112	1383	1431					
66-3/4"	84-3/4"	88-3/4"	90-3/4"	106-3/4"	106-3/4"	150-3/4"	150-3/4"					
10880	12960	14000	16220	17620	18870	23460	24280					
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X					
43	49	55	63	67	75	81	94	98				
684	760	852	1008	1045	1201	1307	1519	1610				
66-3/4"	74-3/4"	84-3/4"	90-3/4"	90-3/4"	106-3/4"	120-3/4"	150-3/4"	132-3/4"				
11600	12900	14450	17110	17720	20390	22180	25780	27330				
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X				
43	49	55	62	67	76	85	95	98				
736	818	917	1020	1125	1293	1438	1635	1731				
66-3/4"	74-3/4"	84-3/4"	80-3/4"	90-3/4"	106-3/4"	120-3/4"	150-3/4"	132-3/4"				
12480	13890	15560	17320	19080	21940	24400	27740	29380				
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X				
41	46	51	58	63	72	77	86	97	103			
775	879	966	1106	1183	1374	1508	1674	1981	2051			
58-3/4"	66-3/4"	74-3/4"	74-3/4"	80-3/4"	90-3/4"	106-3/4"	120-3/4"	132-3/4"	132-3/4"			
13150	14920	16400	18770	20080	23320	25580	28410	33620	34810			
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X			
43	48	52	59	60	71	75	81	89	98	103		
901	1011	1110	1281	1293	1556	1613	1769	1995	2267	2344		
58-3/4"	66-3/4"	74-3/4"	74-3/4"	74-3/4"	90-3/4"	90-3/4"	106-3/4"	104-3/4"	132-3/4"	132-3/4"		
15280	17160	18840	21730	21950	26410	27370	30010	33850	38460	39780		
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X		
43	49	53	59	66	67	77	83	89	95	104	110	
985	1128	1251	1414	1593	1646	1934	2122	2234	2446	2786	2934	
50-3/4"	58-3/4"	66-3/4"	66-3/4"	74-3/4"	74-3/4"	90-3/4"	106-3/4"	92-3/4"	104-3/4"	132-3/4"	132-3/4"	
16710	19150	21230	24000	27030	27940	32820	36000	37910	41500	47270	49780	
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	(2)X	
40	45	47	52	58	62	69	78	86	91	97	107	114
1099	1248	1281	1460	1616	1823	1969	2231	2527	2606	2827	3306	3409
50-3/4"	58-3/4"	58-3/4"	60-3/4"	66-3/4"	74-3/4"	80-3/4"	90-3/4"	92-3/4"	92-3/4"	104-3/4"	132-3/4"	132-3/4"
18650	21180	21740	24770	27430	30930	33400	37860	42880	44230	47960	56100	57840
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 5.0 ksi									
		hr (in.)	1	1	1	1	1.5	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2.5	2.5	2.5	3	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
100	50	Wt(plf)	16.4	18.7	22	25	27	33	36	37	46
		W360(plf)	157	190	235	264	298	365	399	402	513
		N-ds	52-3/8"	50-1/2"	52-1/2"	50-5/8"	44-3/4"	52-3/4"	60-3/4"	60-3/4"	74-3/4"
		Ieff(in4)	3670	4430	5480	6150	6930	8490	9290	9370	11950
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X
	52	Wt(plf)	15.9	18.6	21	24	27	29	34	37	43
		W360(plf)	160	205	237	267	317	343	393	434	521
		N-ds	50-3/8"	50-1/2"	50-1/2"	56-1/2"	48-5/8"	46-3/4"	52-3/4"	60-3/4"	66-3/4"
		Ieff(in4)	3730	4780	5520	6220	7380	7980	9160	10100	12130
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X
	54	Wt(plf)	16.0	18.0	21	25	27	30	34	38	44
		W360(plf)	172	206	255	298	330	374	414	476	567
		N-ds	50-3/8"	50-1/2"	50-1/2"	56-1/2"	44-5/8"	56-5/8"	52-3/4"	58-3/4"	66-3/4"
		Ieff(in4)	4010	4800	5940	6950	7670	8710	9640	11080	13210
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X
	56	Wt(plf)	15.6	18.1	20.0	23	26	29	33	37	43
		W360(plf)	175	221	253	293	344	380	436	500	600
		N-ds	50-3/8"	50-1/2"	50-1/2"	52-1/2"	44-5/8"	52-5/8"	66-5/8"	60-3/4"	66-3/4"
		Ieff(in4)	4070	5140	5890	6820	8010	8850	10160	11640	13970
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X
	58	Wt(plf)	15.3	18.1	20.0	23	26	28	32	35	41
		W360(plf)	179	236	271	313	368	400	444	488	590
		N-ds	50-3/8"	50-1/2"	50-1/2"	52-1/2"	44-5/8"	42-3/4"	46-3/4"	52-3/4"	58-3/4"
		Ieff(in4)	4160	5500	6300	7290	8560	9310	10320	11360	13740
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X
	60	Wt(plf)	15.4	17.5	21	25	26	30	33	37	43
		W360(plf)	191	237	295	346	381	439	472	539	645
		N-ds	50-3/8"	50-1/2"	50-1/2"	52-1/2"	44-5/8"	42-3/4"	44-3/4"	50-3/4"	58-3/4"
		Ieff(in4)	4440	5520	6860	8060	8860	10220	10980	12530	15010
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X
	66	Wt(plf)	14.4	18.2	21	24	28	31	34	37	42
		W360(plf)	214	271	332	386	442	507	546	599	768
		N-ds	50-3/8"	52-3/8"	50-1/2"	50-1/2"	44-3/4"	38-3/4"	40-3/4"	44-3/4"	58-3/4"
Ieff(in4)		4980	6310	7730	8980	10280	11800	12710	13940	17890	
Bridging		(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	
72	Wt(plf)	17.2	19.2	21	24	25	27	29	32	39	
	W360(plf)	229	302	362	417	468	536	566	627	792	
	N-ds	50-3/8"	50-3/8"	50-1/2"	50-1/2"	46-1/2"	44-5/8"	48-5/8"	42-3/4"	50-3/4"	
	Ieff(in4)	5330	7020	8440	9710	10890	12470	13190	14590	18440	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	
80	Wt(plf)	19.1	19.6	21	23	24	27	31	34	39	
	W360(plf)	351	351	386	468	518	574	663	728	882	
	N-ds	50-3/8"	50-3/8"	52-3/8"	50-1/2"	44-1/2"	38-3/4"	38-3/4"	38-3/4"	44-3/4"	
	Ieff(in4)	8160	8160	8990	10900	12050	13350	15430	16940	20530	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT		2 1/2"	5"	7 1/2"								
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 5.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
3	3	3	3	3	3.5	3.5	3.5	3.5	3.5	3.5	4	4
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
51	61	68	71	80	89							
587	689	761	815	902	1050							
84-3/4"	102-3/4"	112-3/4"	102-3/4"	116-3/4"	146-3/4"							
13670	16040	17720	18960	20990	24430							
(4)X	(4)X	(4)X	(3)X	(3)X	(3)X							
53	57	66	71	80	93	95						
643	686	786	878	973	1182	1183						
84-3/4"	88-3/4"	102-3/4"	102-3/4"	116-3/4"	146-3/4"	146-3/4"						
14970	15980	18290	20440	22640	27520	27550						
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X						
49	55	63	71	80	81	94						
637	715	825	944	1045	1092	1272						
74-3/4"	84-3/4"	102-3/4"	102-3/4"	116-3/4"	116-3/4"	146-3/4"						
14830	16640	19210	21970	24330	25420	29600						
(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X						
48	55	64	67	76	81	94						
673	766	885	942	1050	1170	1362						
74-3/4"	84-3/4"	102-3/4"	90-3/4"	102-3/4"	116-3/4"	146-3/4"						
15660	17830	20590	21920	24450	27230	31710						
(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X						
49	56	62	68	76	85	95	102					
729	818	890	1006	1122	1277	1455	1538					
74-3/4"	84-3/4"	88-3/4"	90-3/4"	102-3/4"	116-3/4"	146-3/4"	146-3/4"					
16980	19050	20730	23420	26120	29730	33860	35800					
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X					
46	55	62	67	75	77	94	97					
728	872	949	1072	1196	1245	1549	1604					
66-3/4"	84-3/4"	88-3/4"	90-3/4"	102-3/4"	102-3/4"	146-3/4"	146-3/4"					
16940	20290	22090	24950	27830	28980	36060	37330					
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X					
49	55	60	66	74	79	87	97	102				
891	988	1093	1198	1350	1513	1675	1908	2019				
66-3/4"	74-3/4"	84-3/4"	80-3/4"	90-3/4"	102-3/4"	116-3/4"	146-3/4"	126-3/4"				
20730	22990	25440	27900	31410	35220	38990	44410	46990				
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X				
44	50	56	62	69	74	83	91	106	107			
915	1041	1144	1317	1413	1600	1793	1982	2349	2398			
58-3/4"	66-3/4"	74-3/4"	74-3/4"	80-3/4"	90-3/4"	102-3/4"	116-3/4"	126-3/4"	126-3/4"			
21290	24220	26630	30660	32900	37240	41740	46130	54670	55820			
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X			
42	47	55	59	64	70	79	87	96	99	114	116	
1001	1139	1304	1440	1588	1745	1981	2207	2488	2514	2991	3036	
50-3/4"	58-3/4"	66-3/4"	66-3/4"	74-3/4"	80-3/4"	90-3/4"	102-3/4"	100-3/4"	100-3/4"	126-3/4"	126-3/4"	
23300	26520	30350	33520	36960	40630	46110	51360	57910	58510	69620	70670	
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X	(2)X	(2)X	(2)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 5.0 ksi									
		hr (in.)	1	1	1	1	1.5	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2.5	2.5	2.5	3	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
110	56	Wt(plf)	17.7	21	24	27	31	34	37	42	48
		W360(plf)	160	196	231	273	310	343	387	438	499
		N-ds	56-3/8"	56-1/2"	56-1/2"	56-3/4"	48-3/4"	52-3/4"	60-3/4"	66-3/4"	74-3/4"
		Ieff(in4)	4970	6080	7150	8450	9610	10620	11970	13550	15470
		Bridging	(5)X	(4)X							
	58	Wt(plf)	17.3	20.0	23	26	30	33	37	42	48
		W360(plf)	162	210	244	272	327	361	413	468	534
		N-ds	56-3/8"	56-1/2"	56-1/2"	60-1/2"	52-5/8"	66-5/8"	60-3/4"	66-3/4"	74-3/4"
		Ieff(in4)	5000	6510	7560	8410	10130	11180	12810	14500	16550
		Bridging	(5)X	(4)X							
	60	Wt(plf)	17.3	19.6	25	27	29	35	40	41	49
		W360(plf)	172	209	267	298	331	399	458	474	578
N-ds		56-3/8"	56-1/2"	56-1/2"	60-1/2"	48-5/8"	50-3/4"	58-3/4"	58-3/4"	74-3/4"	
Ieff(in4)		5340	6480	8270	9230	10240	12350	14180	14700	17920	
Bridging		(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	
62	Wt(plf)	17.4	19.7	22	24	29	33	35	39	45	
	W360(plf)	184	223	259	292	352	410	428	491	569	
	N-ds	56-3/8"	56-1/2"	56-1/2"	56-1/2"	48-5/8"	66-5/8"	52-3/4"	58-3/4"	66-3/4"	
	Ieff(in4)	5690	6910	8020	9060	10900	12690	13260	15200	17640	
	Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	
64	Wt(plf)	17.1	20.0	22	25	29	31	35	39	46	
	W360(plf)	184	237	275	311	374	399	455	521	604	
	N-ds	56-3/8"	56-1/2"	56-1/2"	56-1/2"	48-5/8"	56-5/8"	52-3/4"	58-3/4"	66-3/4"	
	Ieff(in4)	5690	7340	8520	9630	11580	12350	14080	16140	18720	
	Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	
66	Wt(plf)	16.4	19.6	24	26	30	34	38	42	46	
	W360(plf)	193	236	298	338	383	443	504	575	649	
	N-ds	56-3/8"	56-1/2"	56-1/2"	56-1/2"	48-3/4"	44-3/4"	50-3/4"	58-3/4"	66-3/4"	
	Ieff(in4)	5990	7310	9230	10470	11860	13710	15610	17830	20100	
	Bridging	(5)X	(5)X	(4)X							
72	Wt(plf)	18.1	20.0	25	29	32	35	37	41	49	
	W360(plf)	210	263	331	392	438	502	544	620	730	
	N-ds	56-3/8"	56-3/8"	56-1/2"	56-1/2"	48-3/4"	42-3/4"	44-3/4"	50-3/4"	58-3/4"	
	Ieff(in4)	6500	8150	10250	12140	13560	15550	16860	19200	22600	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	
80	Wt(plf)	19.3	21	23	25	27	30	33	36	44	
	W360(plf)	272	300	365	425	472	532	588	646	832	
	N-ds	56-3/8"	56-3/8"	56-1/2"	56-1/2"	52-1/2"	48-5/8"	42-3/4"	44-3/4"	58-3/4"	
	Ieff(in4)	8420	9290	11310	13150	14620	16490	18230	20010	25770	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	
88	Wt(plf)	25	25	27	29	31	33	35	38	42	
	W360(plf)	332	332	417	484	543	590	678	745	896	
	N-ds	56-3/8"	56-3/8"	56-1/2"	56-1/2"	48-1/2"	42-3/4"	42-3/4"	42-3/4"	50-3/4"	
	Ieff(in4)	10280	10280	12930	15010	16820	18280	20990	23080	27770	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 5.0 ksi												
1.5	1.5	1.5	2	2	2	2	2	3	3	3	3	3
3	3	3	3	3	3.5	3.5	3.5	3.5	3.5	3.5	4	4
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
57	64	72	81	90	94							
600	673	751	854	961	1030							
88-3/4"	102-3/4"	112-3/4"	112-3/4"	142-3/4"	142-3/4"							
18600	20830	23260	26460	29780	31910							
(4)X	(4)X	(4)X	(4)X	(4)X	(4)X							
55	65	72	81	94	95							
622	720	804	914	1054	1102							
84-3/4"	102-3/4"	112-3/4"	112-3/4"	142-3/4"	142-3/4"							
19260	22300	24890	28310	32640	34130							
(4)X	(4)X	(4)X	(3)X	(3)X	(3)X							
55	64	71	76	81	94							
663	768	858	914	987	1175							
84-3/4"	102-3/4"	112-3/4"	100-3/4"	112-3/4"	142-3/4"							
20550	23790	26570	28310	30570	36410							
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X							
55	60	68	76	82	94	98						
706	753	850	972	1050	1250	1297						
84-3/4"	88-3/4"	102-3/4"	100-3/4"	112-3/4"	142-3/4"	142-3/4"						
21870	23320	26340	30130	32530	38740	40170						
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X						
56	61	68	77	86	96	99						
750	799	903	1032	1140	1327	1376						
84-3/4"	88-3/4"	102-3/4"	100-3/4"	112-3/4"	142-3/4"	142-3/4"						
23220	24760	27980	31980	35300	41110	42640						
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X						
53	60	67	75	84	85	98						
739	836	957	1094	1207	1256	1457						
74-3/4"	84-3/4"	102-3/4"	100-3/4"	112-3/4"	112-3/4"	142-3/4"						
22890	25890	29650	33880	37400	38910	45150						
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X						
55	63	69	74	83	84	102	105					
886	1004	1075	1215	1346	1396	1747	1789					
74-3/4"	84-3/4"	88-3/4"	90-3/4"	100-3/4"	100-3/4"	142-3/4"	142-3/4"					
27440	31090	33300	37640	41680	43240	54130	55430					
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X					
50	56	63	70	75	84	92	107	108				
964	1061	1200	1314	1450	1655	1833	2137	2220				
66-3/4"	74-3/4"	84-3/4"	80-3/4"	90-3/4"	100-3/4"	112-3/4"	142-3/4"	122-3/4"				
29860	32880	37170	40710	44930	51280	56780	66200	68770				
(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X				
49	56	59	68	70	79	88	97	107	115			
1050	1188	1291	1486	1559	1798	2006	2228	2575	2689			
58-3/4"	66-3/4"	74-3/4"	74-3/4"	80-3/4"	90-3/4"	100-3/4"	112-3/4"	122-3/4"	122-3/4"			
32540	36800	40000	46050	48280	55690	62140	69030	79760	83290			
(4)X	(3)X	(2)X										



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength											
		BEARING HEIGHT	2 1/2"	5"	7 1/2"						
		Concrete Slab Parameters									
		Normal Weight Concrete (145 pcf) f'c = 5.0 ksi									
		hr (in.)	1	1	1	1	1.5	1.5	1.5	1.5	
		tc (in.)	2	2	2	2	2.5	2.5	2.5	3	
		Js (ft.)	3	3	3	3	3	3	3.5	4	
Joist Span (ft.)	Joist Depth (in.)	Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot									
		TL	300	400	500	600	700	800	900	1000	1200
120	72	Wt(plf)	19.5	22	27	31	34	39	43	44	56
		W360(plf)	192	234	297	342	387	455	515	527	666
		N-ds	60-3/8"	60-1/2"	60-1/2"	60-1/2"	46-3/4"	50-3/4"	58-3/4"	58-3/4"	74-3/4"
		Ieff(in4)	7730	9430	11940	13760	15550	18310	20720	21200	26800
		Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X
	74	Wt(plf)	19.6	22	25	27	32	37	39	44	49
		W360(plf)	202	247	288	326	397	468	486	555	634
		N-ds	60-3/8"	60-1/2"	60-1/2"	60-1/2"	46-3/4"	50-3/4"	50-3/4"	58-3/4"	66-3/4"
		Ieff(in4)	8140	9930	11570	13120	15990	18820	19540	22310	25510
		Bridging	(5)X	(5)X	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X
	76	Wt(plf)	20.0	22	25	27	30	33	37	43	48
		W360(plf)	213	260	302	343	405	434	497	575	656
		N-ds	60-3/8"	60-1/2"	60-1/2"	60-1/2"	52-5/8"	46-3/4"	50-3/4"	58-3/4"	66-3/4"
		Ieff(in4)	8560	10440	12160	13790	16280	17460	19970	23150	26400
		Bridging	(5)X	(4)X	(4)X						
	78	Wt(plf)	19.2	24	29	33	34	40	46	49	53
		W360(plf)	203	278	332	383	424	492	565	639	722
		N-ds	60-3/8"	60-1/2"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	50-3/4"	58-3/4"	66-3/4"
		Ieff(in4)	8150	11190	13350	15400	17070	19780	22710	25710	29020
		Bridging	(5)X	(5)X	(4)X						
	80	Wt(plf)	19.2	23	28	32	34	38	42	49	53
		W360(plf)	212	268	345	379	445	504	575	670	756
		N-ds	60-3/8"	62-3/8"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	50-3/4"	58-3/4"	66-3/4"
		Ieff(in4)	8540	10780	13880	15220	17880	20270	23140	26940	30400
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X
	82	Wt(plf)	19.3	22	25	30	33	37	41	43	53
		W360(plf)	222	278	324	389	461	497	594	614	791
		N-ds	60-3/8"	62-3/8"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	50-3/4"	50-3/4"	66-3/4"
		Ieff(in4)	8940	11170	13040	15640	18530	20010	23890	24690	31800
		Bridging	(5)X	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X
	84	Wt(plf)	20.0	22	24	31	34	36	41	42	50
		W360(plf)	232	290	335	410	481	514	620	633	799
		N-ds	60-3/8"	62-3/8"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	50-3/4"	50-3/4"	66-3/4"
		Ieff(in4)	9340	11670	13470	16500	19350	20670	24950	25460	32120
		Bridging	(5)X	(5)X	(5)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X
	88	Wt(plf)	25	26	30	33	40	42	44	47	57
W360(plf)		260	307	384	422	514	587	636	717	849	
N-ds		60-3/8"	60-3/8"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	46-3/4"	50-3/4"	58-3/4"	
Ieff(in4)		10460	12340	15430	16980	20680	23610	25600	28850	34130	
Bridging		(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	
96	Wt(plf)	30	30	31	33	34	36	38	41	52	
	W360(plf)	416	416	416	488	546	615	671	724	954	
	N-ds	60-1/2"	60-1/2"	60-1/2"	60-1/2"	46-3/4"	46-3/4"	46-3/4"	46-3/4"	58-3/4"	
	Ieff(in4)	16730	16730	16730	19640	21950	24750	26990	29130	38360	
	Bridging	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	(4)X	



NORMAL WEIGHT CONCRETE

DESIGN GUIDE LRFD WEIGHT TABLE FOR COMPOSITE STEEL JOISTS, CJ-SERIES

Based on a 50 ksi Maximum Yield Strength												
BEARING HEIGHT	2 1/2"	5"	7 1/2"									
Concrete Slab Parameters												
Normal Weight Concrete (145 pcf) f'c = 5.0 ksi												
1.5	1.5	1.5	2	2	2	2	3	3	3	3	3	3
3	3	3	3	3	3.5	3.5	3.5	4	4	4	4	4
5	5.5	6	7	7.5	8	9	10	11	12	13	14	15
Total Safe Factored Uniformly Distributed Joist Load in Pounds Per Linear Foot												
1400	1600	1800	2000	2200	2400	2700	3000	3300	3600	3900	4200	4500
60	67	76	81	88	98							
754	864	967	1022	1123	1310							
84-3/4"	102-3/4"	112-3/4"	100-3/4"	112-3/4"	136-3/4"							
30330	34760	38880	41130	45180	52690							
(4)X	(4)X	(4)X	(4)X	(3)X	(3)X							
58	63	72	78	87	98	104						
776	836	946	1054	1164	1378	1435						
84-3/4"	88-3/4"	102-3/4"	100-3/4"	112-3/4"	136-3/4"	136-3/4"						
31220	33610	38050	42380	46800	55430	57710						
(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X						
57	64	73	79	88	99	105						
804	878	994	1107	1222	1447	1507						
84-3/4"	88-3/4"	102-3/4"	100-3/4"	112-3/4"	136-3/4"	136-3/4"						
32330	35310	39980	44520	49160	58220	60610						
(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X						
60	72	77	83	92	93	105						
817	973	1079	1204	1329	1380	1593						
74-3/4"	88-3/4"	102-3/4"	100-3/4"	112-3/4"	112-3/4"	136-3/4"						
32880	39120	43410	48430	53470	55520	64090						
(4)X	(3)X	(3)X	(3)X	(3)X	(3)X	(3)X						
57	65	76	83	84	90	104						
839	951	1115	1261	1275	1417	1654						
74-3/4"	84-3/4"	102-3/4"	100-3/4"	100-3/4"	112-3/4"	136-3/4"						
33750	38240	44830	50720	51260	56990	66530						
(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X						
57	62	72	77	84	90	104	107					
878	972	1142	1203	1333	1481	1729	1784					
74-3/4"	84-3/4"	102-3/4"	90-3/4"	100-3/4"	112-3/4"	136-3/4"	118-3/4"					
35290	39100	45930	48390	53600	59560	69540	71740					
(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X					
57	62	65	75	83	91	104	107					
916	1015	1067	1230	1369	1545	1804	1860					
74-3/4"	84-3/4"	88-3/4"	90-3/4"	100-3/4"	112-3/4"	136-3/4"	118-3/4"					
36860	40820	42910	49490	55080	62160	72570	74830					
(4)X	(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X					
64	71	74	83	88	91	103	113					
971	1165	1227	1410	1541	1606	1786	2077					
66-3/4"	84-3/4"	88-3/4"	90-3/4"	100-3/4"	100-3/4"	112-3/4"	118-3/4"					
39040	46850	49340	56710	61970	64590	71830	83550					
(3)X	(3)X	(3)X	(3)X	(3)X	(3)X	(2)X	(2)X					
56	60	68	75	83	88	98	109	116				
1075	1170	1325	1445	1622	1811	2015	2328	2483				
66-3/4"	74-3/4"	84-3/4"	80-3/4"	90-3/4"	100-3/4"	112-3/4"	118-3/4"	118-3/4"				
43240	47050	53300	58110	65250	72840	81050	93620	99850				
(4)X	(4)X	(4)X	(4)X	(3)X	(3)X	(3)X	(3)X	(2)X				



Steel Joist Institute – SJI COSP - 2020

CODE OF STANDARD PRACTICE FOR STEEL JOISTS AND JOIST GIRDERS

Adopted by the Steel Joist Institute April 7, 1931
Revised to Nov. 10, 2014 - Effective Jan.1, 2015

SECTION 1. GENERAL

1.1 SCOPE

The practices and customs set forth herein are in accordance with good engineering practice, tend to ensure safety in steel joist and Joist Girder construction, and are standard within the industry. There shall be no conflict between this code and any legal building regulation. This code shall only supplement and amplify such laws. Unless specific provisions to the contrary are made in a contract for the purchase of steel joists or Joist Girders, this code is understood to govern the interpretation of such a contract.

1.2 APPLICATION

This Code of Standard Practice is to govern as a standard unless otherwise covered in the architects' and engineers' plans and specifications.

1.3 DEFINITIONS

Add-Load. A single vertical concentrated load that occurs at any one panel point along the joist chord. This load is in addition to any other gravity loads specified.

Bend-Check Load. A vertical concentrated load used to design the joist chord for the additional bending stresses resulting from this load being applied at any location between the joist panel points. This load shall already be accounted for in the specified joist designation load, uniform load, or Add-Load and is used only for the additional bending check in the chord and does not contribute to the overall axial forces within the joist. An ideal use of this is for incidental loads which have already been accounted for in the design loading but may induce additional bending stress due to this load occurring at any location along the chord.

Buyer. The entity that has agreed to purchase Material from the manufacturer and has also agreed to the terms of sale.

Erector. The entity that is responsible for the safe and proper erection of the materials in accordance with all applicable codes and regulations.

Material. Steel joists, Joist Girders and accessories as provided by the seller.

Owner. The entity that is identified as such in the contract documents.

Steel Joist Institute – SJI COSP - 2020

Placement Plans. Drawings that are prepared depicting the interpretation of the contract document's requirements for the Material to be supplied by the Seller. These floor or roof plans are approved by the Specifying Professional, Buyer, or Owner for conformance with the design requirements. The Seller uses the information contained on these drawings for final material design. A unique piece mark number is typically shown for the individual placement of the steel joists, Joist Girders and accessories along with sections that describe the end bearing conditions and minimum attachment required so that material is placed in the proper location in the field.

Seller. A company certified by the Steel Joist Institute engaged in the manufacture and distribution of steel joists, Joist Girders and accessories.

Specifying Professional. The licensed professional who is responsible for sealing the building contract documents, that indicates that he or she has performed or supervised the analysis, design and document preparation for the structure and has knowledge of the load-carrying structural system.

Structural Drawings. The graphic or pictorial portions of the contract documents showing the design, location and dimensions of the work. These documents generally include plans, elevations, sections, details, connections, all loads, schedules, diagrams and notes.

1.4 DESIGN

In the absence of ordinances or specifications to the contrary, all designs prepared by the Specifying Professional shall be in accordance with the Steel Joist Institute Standard Specifications of latest adoption.

1.5 RESPONSIBILITY FOR DESIGN AND ERECTION

When material requirements are specified, the seller shall assume no responsibility other than to furnish the items listed in Section 5.2(a). When material requirements are not specified, the seller shall furnish the items listed in Section 5.2(a) in accordance with Steel Joist Institute Standard Specifications of latest adoption, and this code. Pertinent design information shall be provided to the seller as stipulated in Section 6.1. The seller shall identify material by showing size and type. In no case shall the seller assume any responsibility for the erection of the item furnished.

1.6 PERFORMANCE TESTS FOR OPEN WEB STEEL JOIST CONSTRUCTION

When a performance test on a joist is required, the following criteria shall be used:

- a) The performance test load shall be the maximum factored uniformly distributed downward design load for the selected joist.
 - (1) The TOTAL safe factored uniformly distributed load-carrying capacity tabulated in the Standard LRFD Load Table for the specific joist designation and span.
 - (2) For a joist with factored loading conditions other than those found in the Standard LRFD Load Table, this is the LRFD Load Combination resulting in the highest uniformly distributed downward factored design load.
 - (3) For a joist with loading conditions other than those found in the Standard ASD Load Table, this is the ASD Load Combination resulting in the highest uniformly distributed downward design load multiplied times 1.50.
- b) Joist self-weight and the weight of all test materials shall be included in the calculation of applied performance test loading as appropriate for the joist during testing.

Steel Joist Institute – SJI COSP - 2020

- c) Loading shall be uniformly distributed across the full length of the joist top chord, and the load application shall maintain uniform distribution throughout the test. At any stage during the application of the test loading, the test load shall not be distributed in such a manner as to result in any joist component being subjected to a higher proportion of force than intended by the joist design.
- d) If tested as a panel assembly, the joists shall be tested in pairs with deck, deck attachments, and bridging installed per the approved joist and deck Placement Plans. All bottom chord horizontal bridging rows shall be terminated by bracing back to the top chord of the adjacent joist or by a lateral restraint system which does not inhibit the vertical deflection of the test joist.
- e) If tested singly in a load test machine apparatus, the joist chords shall be braced to prevent lateral movement, without inhibiting vertical displacement. The joist top chord shall have lateral braces located at equal spacing of no more than 36 inches (914 mm) on center. The joist bottom chord shall have lateral braces located, at a minimum, per the bottom chord bridging locations shown on the approved joist placement plan.
- f) The performance test loading shall be applied at a rate of no greater than 25 plf per minute and shall be sustained for no less than 15 minutes. After the maximum test load has been removed for a minimum of 10 minutes, the remaining vertical displacement at midspan shall not exceed 20% of the vertical midspan deflection sustained under the full performance test load.
- g) All costs associated with such testing shall be borne by the purchaser.
- h) Joists that have been designed and manufactured and have satisfied the above performance test criteria shall be considered to satisfy the intent of the Steel Joist Institute Standard Specifications, and shall be considered acceptable for use in construction. No further proof of strength of individual joist components or connections is required.

SECTION 2.

JOISTS, JOIST GIRDERS, AND ACCESSORIES

2.1 STEEL JOISTS AND JOIST GIRDERS

Steel joists and Joist Girders shall carry the designations and meet the requirements of the Steel Joist Institute Standard Specifications of latest adoption.

K-Series, LH-Series, DLH-Series joists, and Joist Girders are furnished either underslung or square ended, with top chords either parallel, pitched one way or pitched two ways. It is not recommended that any Joist Girder, or any DLH-Series joist that exceeds 72 inches (1829 mm) in depth and has a span greater than 80 feet (24384 mm), be used in a bottom bearing configuration.

The steel joist or Joist Girder designation depth or nominal depth shall be the depth at midspan, except for double pitched joists which shall be the depth at the ridge. K-Series, LH-Series, DLH-Series joists, and Joist Girders shall be permitted to have either parallel chords or a top chord pitch of up to 1/2 inch per foot (1:24).

2.2 BEARING SEATS

Underslung types are furnished with minimum end bearing depths as shown in Table 2.2-1. A standard maximum joist bearing seat width (perpendicular to the joist length) is provided. This width shall be permitted to vary based on the joist design and joist manufacturer.

Steel Joist Institute – SJI COSP - 2020

TABLE 2.2-1

STANDARD END BEARING SEAT DEPTH AND STANDARD MAXIMUM SEAT WIDTH		
JOIST SECTION NUMBER ¹	MINIMUM BEARING DEPTH	MAXIMUM SEAT WIDTH ²
K1-12	2 ½" (64 mm)	6" (152 mm)
LH02-06	5" (127 mm)	6" (152 mm)
LH07-17, DLH10-17	5" (127 mm)	8" (203 mm)
JG	7 ½" (191 mm)	8" (203 mm)
LH/DLH18-25, JG ³	7 ½" (191 mm)	13" (330 mm)
JG ⁴	10" (254 mm)	13" (330 mm)
⁽¹⁾ Last two digits of joist designation shown in Load Table. ⁽²⁾ THE SEAT WIDTH MAY VARY BASED ON DESIGN. ⁽³⁾ Joist Girders with a self weight greater than 50 plf (0.73 kN/m). ⁽⁴⁾ Joist Girders with a self weight equal to or greater than 150 plf (2.19 kN/m).		

Joist Girder bearing seat widths vary depending on the Joist Girder size and shall be permitted to be up to 13" (330 mm) wide. The supporting structural member shall be made wide enough to accommodate the seat widths.

Where steel joists or Joist Girders are sloped, sloped end bearings may be provided where the slope exceeds 1/4 inch per foot (1:48). When sloped end bearings are required, the seat depths shall be adjusted to maintain the standard height at the shallow end of the sloped bearing. For Open Web Steel Joists, K-Series, bearing ends shall be permitted to not be beveled for slopes of 1/4 inch or less per foot (1:48). For sloped joist bearing seats refer to the sloped seat depth requirements of Table 2.2-2 and Table 2.2-3.



Steel Joist Institute – SJI COSP - 2020

TABLE 2.2-2
SLOPED SEAT REQUIREMENTS FOR SLOPES 3/8":12 AND GREATER
K-SERIES OPEN WEB STEEL JOISTS

LOW END W/OUT TOP CHORD EXTENSIONS	HIGH END W/OUT TOP CHORD EXTENSIONS	SLOPE "X":12	MINIMUM HIGH END SEAT DEPTH "d"
		3/8	3 1/2
		1/2	3 1/2
		1	3 1/2
		1 1/2	4
		2	4
		2 1/2	4
		3	4 1/2
		3 1/2	4 1/2
		4	4 1/2
		4 1/2	5
		5	5
		5 1/2	5 1/2
SEE NOTE (2) FOR SLOPE RATES GREATER THAN 6:12		6	5 1/2

Notes:

- (1) Depths shown are the minimum required for manufacturing of sloped seats. Depths may vary depending on actual bearing conditions.
- (2) $d = 1/2 + 2.5/\cos\theta + 4\tan\theta$ (Rounded up to the nearest 1/2".)
- (3) Clearance must be checked at outer edge of support. Increase bearing depths as required to allow passage of 2 1/2" deep extension.
- (4) If extension depth greater than 2 1/2" is required, increase bearing depths accordingly.
- (5) If slope is 1/4 : 12 or less, sloped seats are not required.
- (6) Required bearing seat depth is determined at END OF SEAT.
- (7) Also refer to SJI Specification 5.4 for special considerations of joist end reaction location.

Steel Joist Institute – SJI COSP - 2020

**TABLE 2.2-3
SLOPED SEAT REQUIREMENTS FOR SLOPES 3/8":12 AND GREATER
LH- AND DLH-SERIES OPEN WEB STEEL JOISTS**

LOW END W/OUT TOP CHORD EXTENSIONS	HIGH END W/OUT TOP CHORD EXTENSIONS	SLOPE "X" : 12	MINIMUM HIGH END SEAT DEPTH "d"
		3/8	6
		1/2	6
		1	6 1/2
		1 1/2	6 1/2
		2	7
		2 1/2	7
		3 1/2	7 1/2
		4	8
		4 1/2	8 1/2
		5	8 1/2
		5 1/2	9
		6	9 1/2
		SEE NOTE (2) FOR SLOPE RATES GREATER THAN 6:12	

Notes:

- (1) Depths shown are the minimum required for manufacturing of sloped seats. Depth may vary depending on actual bearing condition.
- (2) $d = 1/2 + 5 / \cos\theta + 6 \tan\theta$
- (3) Clearance must be checked at outer edge of support. Increase bearing seat depth as required to allow passage of 5" deep extension.
- (4) If extension depth greater than 5" is required, increase bearing depths accordingly.
- (5) Add 2 1/2" to seat depth at 18 thru 25 chord section numbers. Consult with joist manufacturer for information when TCXs are present.
- (6) If slope is 1/4 : 12 or less, sloped seats may not be required.
- (7) Required bearing seat depth shall be determined at END OF SEAT.
- (8) Also refer to SJI Specification 5.4 for special considerations of joist end reaction location.

2.3 JOIST LOCATION AND SPACING

The uniform loads as shown in the Standard Specifications Load Tables & Weight Tables of latest adoption shall be used to determine maximum joist spacing.

Where sidewalls, wall beams or tie beams are capable of supporting the floor slab or roof deck, the first adjacent joists should be placed one full space from these members. Joists are provided with camber and may have a significant difference in elevation with respect to the adjacent structure because of this camber. This difference in elevation shall be given consideration when locating the first joist adjacent to a side wall, wall beam, or tie beam.

K-Series Joists should be placed no closer than 6 inches (152 mm) to adjacent walls or structural members. LH-Series and DLH-Series Joists should be placed no closer than 12 inches (305 mm) to adjacent walls or structural members. Where partition walls are supported by parallel floor joists, there shall be at least one joist provided under each such partition, and more than one such joist shall be provided if necessary to safely support the weight of such partition and the adjacent floor. When partitions occur perpendicular to the joists, they shall be treated as concentrated loads on the supporting joists.

2.4 SPECIFYING DESIGN LOADS

Neither the Steel Joist Institute nor the joist manufacturer establishes the loading requirements for which structures are designed.

The *specifying professional* shall provide the nominal loads and load combinations as stipulated by the applicable code under which the structure is designed and shall provide the design basis (ASD or LRFD).

The *specifying professional* shall calculate and provide the magnitude and location of ALL JOIST and JOIST GIRDER LOADS. This includes all special loads (drift loads, mechanical units, net uplift, axial loads, moments, structural bracing loads, or other applied loads) which are to be incorporated into the joist or Joist Girder design. For Joist Girders, reactions from supported members shall be clearly denoted as point loads on the Joist Girder. When necessary to clearly convey the information, a load diagram or load schedule shall be provided.

The *specifying professional* shall give due consideration to the following loads and load effects:

- Ponded rain water.
- Accumulation of snow in the vicinity of obstructions such as penthouses, signs, parapets, adjacent buildings, etc.
- Wind and seismic forces. Indicate wind NET uplift in pounds per square foot (Pascals) and any other wind or seismic forces required to be incorporated into the joist or Joist Girder design. If applicable, make clear if loads specified are reduced (i.e. for ASD $0.6W=$, $0.7E=$) and provide any pertinent S_{Ds} values. Connection details shall be designed by the *specifying professional*.
- Movable partitions. Convey any special deflection requirements as well as any stacked loading conditions.
- Type and magnitude of end moments and/or axial forces at the joist and Joist Girder end supports shall be shown on the Structural Drawings. For moment resisting joists or Joist Girders framing at or near the top of a column, due consideration shall be given to extend the column length to allow a plate type connection between the top of the joist or Joist Girder top chord and the column.
Avoid transferring joist or Joist Girder end moments and axial forces through the bearing seat connection.
A note shall be provided on the structural drawings stating that all moment resisting joists shall have all dead loads applied to the joist before the bottom chord struts are welded to the supporting connection whenever the design moments provided do not include dead load.
The top and bottom chord moment connection details shall be designed by the *specifying professional*. The joist designer shall furnish the *specifying professional* with the joist detail information if requested. Additional design tools and details are available at the Steel Joist Institute's website, www.steeljoist.org.
- Joist chords shall not carry out-of-plane or torsional loads, such as from horizontal components of concentrated loads applied to laterally sloped joists, braces, screen walls, posts, etc. The structural contract drawings shall show the required structural bracing to resolve these forces.



Steel Joist Institute – SJI COSP - 2020

Where concentrated loads occur, the magnitude and location of these concentrated loads shall be shown on the structural drawings when, in the opinion of the *specifying professional*, they shall require consideration by the joist manufacturer. For nominal concentrated loads, which have been accounted for in the specified uniform design loads, a “strut” to transfer the load to a panel point on the opposite chord shall not be required provided that the sum of the concentrated loads within a chord panel does not exceed 100 pounds (445 N) and the attachments are concentric to the chord. When exact dimensional locations for concentrated loads which do not meet the above criteria are provided by the *specifying professional*, the joist shall be designed for the loads and load locations provided without the need for additional field applied web members at the specified locations.

(a) Specifying Joist Design Loads

The Steel Joist Institute Load Tables are based on uniform loading conditions and are valid for use in selecting joist sizes for gravity loads that can be expressed in terms of “pounds per linear foot” (kiloNewtons per meter) of joist.

For other loads, the Specifying Professional shall use one of the five options described below that allows:

- The estimator to price the joists.
- The joist manufacturer to design the joists in accordance with the Standard Specifications of latest adoption.
- The owner to obtain the most economical joists.

Option 1: Select a joist designation from the Standard Load Table (or specify a joist type using a uniform load in the designation) which has been determined to be adequate for all design loads. The shear and moment envelope resulting from the selected uniform load shall meet the actual shear and moment requirements. Thus, this option alone may not be adequate if large concentrated loads need to be designed for.

Option 2: Select a joist designation from the Standard Load Table (or specify a joist type using a uniform load in the designation) and also provide the load and location of any additional loads on the structural plan with a note “Joist manufacturer shall design joists for additional loads at locations shown.” This option works well for a few added loads per joist with known magnitude and locations.

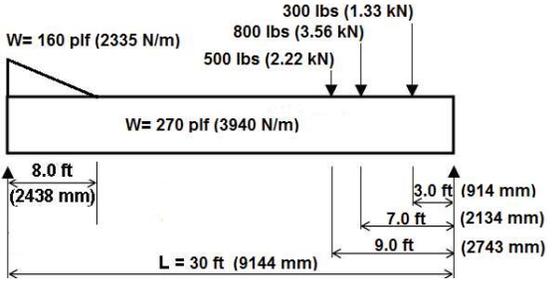
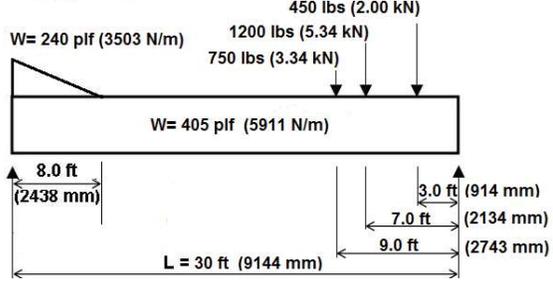
Option 3: For additional point loads with exact locations not known along the joist or for incidental loads, any one, or both, of the following can be specified on the structural plan in addition to option 1 or 2 above:

- a) “**Design for a () lb. concentrated load located at any one panel point along the joist**”. This is referred to as an *Add-Load*.
- b) “**Design for additional bending stresses resulting from a () lb. concentrated load located at any location along () chord**”. This is referred to as a *Bend-Check* and can be specified on the top chord, bottom chord, or both top and bottom chords. This can be used when the concentrated load is already accounted for in the joist designation, uniform load, or specified *Add-Load* yet this specified amount of load shall be permitted to also be located at any location between panel points. The additional bending stresses as a result of this load are then designed for. A *Bend-Check* load shall not exceed (*Add-Load* + 400 lbs.) A *Bend-Check* load can be specified by itself without an *Add-Load*.
- c) Both (a) and (b) above can be specified with equal concentrated loads for each; or simply denote “**Design joist for a () lb. concentrated load at any location along the () chord.**”

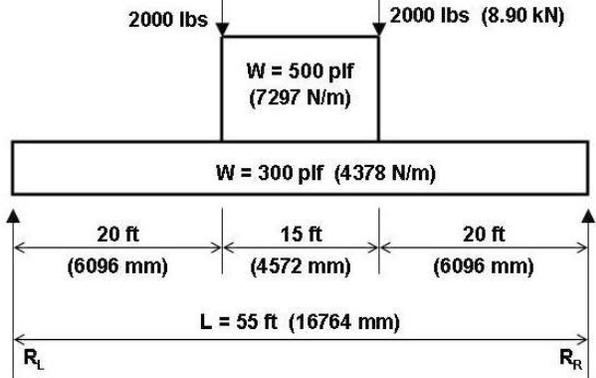
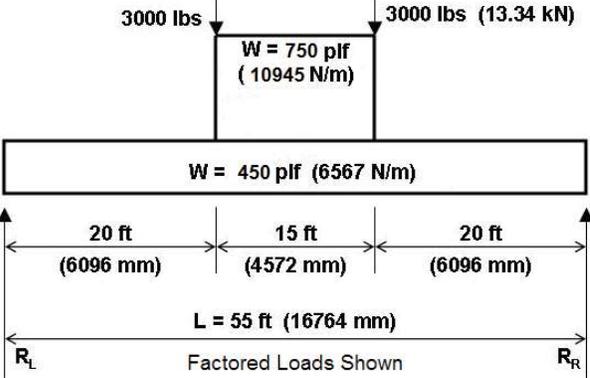
Example uses:

- *Specifying professional* selects a standard joist capable of carrying a 500 lb. RTU. However, the location and exact frame size is not yet known but the frame load shall result in two- 250 lb. point loads at least 5'-0" apart. **Specify a 250 lb. Bend-Check.**
- Standard joist specified but not selected for 500 lb. RTU load, location not known. **Specify a 500 lb. Add-Load and 250 lb. Bend-Check.**
- Standard SJI joist selected to carry collateral load of 3 psf. *Specifying professional* wants bending from 150 lb. incidental loads to also be designed for. **Specify a 150 lb. Bend-Check.**

Steel Joist Institute – SJI COSP - 2020

OPTION 4 - ASD EXAMPLE 2:	OPTION 4 - LRFD EXAMPLE 2:
U.S. CUSTOMARY UNITS AND (METRIC UNITS)	U.S. CUSTOMARY UNITS AND (METRIC UNITS)
 <p>W= 160 plf (2335 N/m) 300 lbs (1.33 kN) 800 lbs (3.56 kN) 500 lbs (2.22 kN)</p> <p>W= 270 plf (3940 N/m)</p> <p>8.0 ft (2438 mm) 3.0 ft (914 mm) 7.0 ft (2134 mm) 9.0 ft (2743 mm)</p> <p>L = 30 ft (9144 mm)</p>	 <p>W= 240 plf (3503 N/m) 450 lbs (2.00 kN) 1200 lbs (5.34 kN) 750 lbs (3.34 kN)</p> <p>W= 405 plf (5911 N/m)</p> <p>8.0 ft (2438 mm) 3.0 ft (914 mm) 7.0 ft (2134 mm) 9.0 ft (2743 mm)</p> <p>L = 30 ft (9144 mm)</p>
<p>M = 443 k-in. (50.1 kN-m) R_L = 5000 lbs (22.24 kN), R_R = 5340 lbs (23.75 kN) Select a 22KCS2, M = 488 k-in. (55.1 kN-m) R = 5900 lbs (26.2 kN) Bridging section no. 6 for L = 30 ft. (9144 mm)</p> <p>Use 22K6 to determine bridging and stability requirements. Since the maximum uniform load of 430 plf [6275 N/m] (270 plf (3940 N/m) + 160 plf (2335 N/m)) does not exceed the maximum KCS Joist uniform load of 550 plf (8020 N/m) and a standard KCS Joist can be selected from the load table, a load diagram is not required.</p>	<p>M = 664 k-in. (75.03 kN-m) R_L = 7500 lbs (33.36 kN), R_R = 8010 lbs (35.63 kN) Select a 22KCS2, M = 732 k-in. (82.64 kN-m) R = 8850 lbs (39.3 kN) Bridging section no. 6 for L = 30 ft. (9144mm)</p> <p>Use 22K6 to determine bridging and stability requirements. Since the maximum factored uniform load of 645 plf (9413 N/m) (405 plf (5911 N/m) + 240 plf (3503 N/m)) does not exceed the maximum KCS Joist uniform load of 825 plf (12030 N/m) and a standard KCS Joist can be selected from the load table, a load diagram is not required.</p>

Steel Joist Institute – SJI COSP - 2020

OPTION 4 - ASD EXAMPLE 3:	OPTION 4 - LRFD EXAMPLE 3:
U.S. CUSTOMARY UNITS AND (METRIC UNITS)	U.S. CUSTOMARY UNITS AND (METRIC UNITS)
	
<p>M = 2910 k-in. (328.8 kN-m) RL = RR = 14000 lbs (62.28 kN) EXCEEDS CAPACITY OF 30KCS5 (MAXIMUM KCS JOIST) AND EXCEEDS MAXIMUM UNIFORM LOAD OF 550 plf (8027 N/m). OPTION A: Use double joists each having a minimum moment capacity, M = 1455 k-in. (164.4 kN-m) and shear capacity, R = 7000 lbs (31.14 kN) and a uniform load of 400 plf (5838 N/m). Select two 28KCS5, M = 1704 k-in. (192.5 kN-m), R = 9200 lbs (40.9 kN). Bridging section no. 12 for L = 55 ft. (16764 mm). Use 28K12 to determine bridging and stability requirements. OPTION B: Select a LH-Series Joist. See OPTION 5.</p>	<p>M = 4365 k-in. (493.2 kN-m) RL = RR = 21000 lbs (93.41 kN) EXCEEDS CAPACITY OF 30KCS5 (MAXIMUM KCS JOIST) AND EXCEEDS MAXIMUM FACTORED UNIFORM LOAD OF 825 plf (12040 N/m). OPTION A: Use double joists each having a minimum moment capacity, M = 2183 k-in. (246.65 kN-m) and shear capacity, R = 10500 lbs (46.71 kN) and a uniform load of 600 plf (8756 N/m). Select two 28KCS5, M = 2556 k-in. (288.7 kN-m), R = 13800 lbs (61.3 kN). Bridging section no. 12 for L = 55 ft. (16764 mm) Use 28K12 to determine bridging and stability requirements. OPTION B: Select a LH-Series Joist. See OPTION 5.</p>

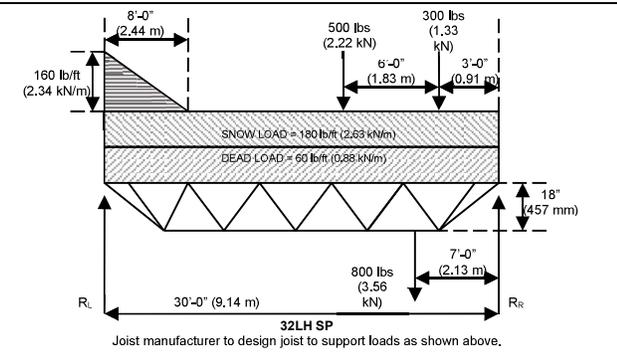
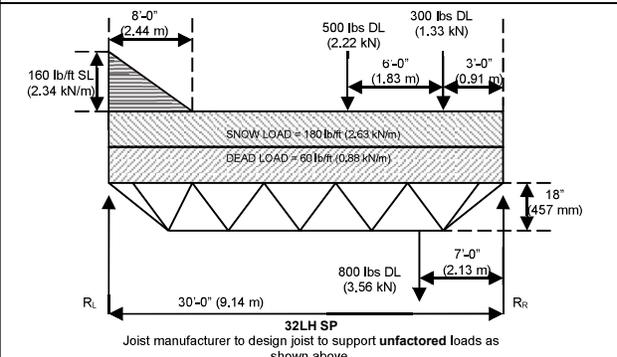
Option 5: Specify a SPECIAL joist designation when the joist includes more complex loading or for conditions which need consideration of multiple potentially controlling load combinations.

- Provide a load diagram and/or enough information on the drawings to clearly define ALL loads.
- If the loading criteria are too complex to adequately communicate on the drawings or with a simple load diagram, then the *specifying professional* shall provide a load schedule along with the appropriate load combinations. Regardless of where the loads are shown, unfactored design loads broken down by load categories shall be provided in order to design the joists correctly with applicable load combinations.

Place the designation (e.g. 28K SP or 28LH SP) with the following note: "Joist manufacturer to design joist to support loads as shown."



Steel Joist Institute – SJI COSP - 2020

OPTION 5 - ASD EXAMPLE: U.S. CUSTOMARY UNITS AND (METRIC UNITS)	OPTION 5 - LRFD EXAMPLE: U.S. CUSTOMARY UNITS AND (METRIC UNITS)
Load diagram per ASCE 7 2.4.1(3), D + S	Unfactored Load diagram per ASCE 7 2.3.2(3), 1.2D+1.6S
 <p style="text-align: center; font-size: small;">Joist manufacturer to design joist to support loads as shown above.</p>	 <p style="text-align: center; font-size: small;">Joist manufacturer to design joist to support unfactored loads as shown above.</p>
PLEASE NOTE THE LOAD COMBINATIONS SHOWN ARE FOR REFERENCE EXAMPLES ONLY.	

CAUTION FOR OPTIONS 1 thru 5 ABOVE:

If a K-Series joist is being specified, the Specifying Professional shall compare the equivalent uniform loads derived from the maximum moment and shear to the uniform loads tabulated in the K-Series Load Table. An equivalent unfactored uniform load in excess of 550 plf (8020 N/m) or a maximum unfactored end reaction exceeding 9200 lbs. (40.9 kN) indicates that the *specifying professional* shall use additional joists to reduce the loading or use an LH-Series joist and make provisions for 5 inch (127 mm) deep bearing seats.

If the joist has not been designed for localized accumulation of loads that results in a point or concentrated load, this load attachment shall be made at top or bottom chord panel points. Therefore, specify on the structural drawings, "Where concentrated loads do not occur at panel points, an extra web shall be field applied from the point of attachment to a panel point on the opposite chord", and indicate the extra web size and weld requirements. When exact dimensional locations for concentrated loads are provided by the *specifying professional*, the joist shall be designed for the loads and load locations provided without the need for additional field applied web members at the specified locations.

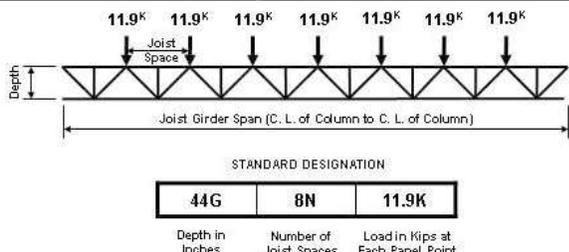
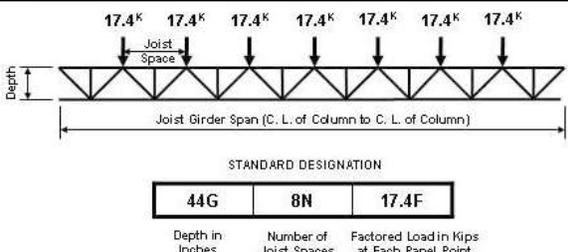
(b) Specifying Joist Girder Design Loads

The Steel Joist Institute's Design Guide ASD or LRFD Weight Tables for Joist Girders are based on uniformly spaced panel point loading conditions and are valid for use in selecting Joist Girder sizes for gravity conditions that can be expressed in kips (kiloNewtons) per panel point on the Joist Girder. Note that anything other than point loads shall be shown unfactored or in a Load Schedule. For a given Joist Girder span, the *specifying professional* first determines the number of joist spaces. Then the panel point loads are calculated and a depth is selected. The information provided in the tables gives the Joist Girder weight in pounds per linear foot (kiloNewtons per meter) for various depths and loads.

1. The purpose of the Joist Girder Design Guide Weight Table is to assist the *specifying professional* in the selection of a roof or floor support system.
2. It is not necessary to use only the depths, spans, or loads shown in the tables.
3. Holes in chord elements present special problems that shall be considered by both the *specifying professional* and the Joist Girder Manufacturer. The sizes and locations of such holes shall be clearly indicated on the structural drawings.
4. Live load deflection rarely governs because of the relatively small span to depth ratios of Joist Girders. However, it is recommended that a breakdown of the point loads, by load category (i.e. TL/LL), be provided so specified deflection requirements and load combinations can be properly accounted for in design.



Steel Joist Institute – SJI COSP - 2020

Example using <u>Allowable Strength Design (ASD)</u> and U. S. Customary units:	Example using <u>Load and Resistance Factor Design (LRFD)</u> and U. S. Customary units:
	
<p>Given 42'-0" x 50'-0" bay. Joists spaced on 5'-3" centers</p> <p>Live Load = 30 psf Dead Load = 15 psf (includes the approximate Joist Girder weight) Total Load = 45 psf</p> <p>Note: Web configuration may vary from that shown. Contact joist manufacturer if exact layout must be known.</p> <ol style="list-style-type: none"> 1. Determine number of actual joist spaces (N). In this example, N = 8. 2. Compute total load: Total load = 5.25 x 45 psf = 236.25 plf 3. Joist Girder Section: (Interior) <ol style="list-style-type: none"> a) Compute the concentrated load at top chord panel points $P = 236.25 \times 50 = 11,813 \text{ lbs} = 11.9 \text{ kips}$ (use 12K for depth selection). b) Select Joist Girder depth: Refer to the ASD Joist Girder Design Guide Weight Table for the 42'-0" span, 8 panel, 12.0K Joist Girder. The rule of about one inch of depth for each foot of span is a good compromise of limited depth and economy. Therefore, select a depth of 44 inches. c) The Joist Girder shall then be designated 44G8N11.9K. d) The ASD Joist Girder Design Guide Weight Table shows the weight for a 44G8N12K as 49 pounds per linear foot. The designer should verify that the weight is not greater than the weight assumed in the Dead Load above. 	<p>Given 42'-0" x 50'-0" bay. Joists spaced on 5'-3" centers</p> <p>Live Load = 30 psf x 1.6 Dead Load = 15 psf x 1.2 (includes the approximate Joist Girder weight) Total Load = 66 psf (factored)</p> <p>Note: Web configuration may vary from that shown. Contact joist manufacturer if exact layout must be known.</p> <ol style="list-style-type: none"> 1. Determine number of actual joist spaces (N). In this example, N = 8. 2. Compute total factored load: Total load = 5.25 x 66 psf = 346.50 plf 3. Joist Girder Section: (Interior) <ol style="list-style-type: none"> a) Compute the factored concentrated load at top chord panel points $P = 346.5 \times 50 = 17,325 \text{ lbs} = 17.4 \text{ kips}$ (use 18K for depth selection). b) Select Joist Girder depth: Refer to the LRFD Joist Girder Design Guide Weight Table for the 42'-0" span, 8 panel, 18.0K Joist Girder. The rule of about one inch of depth for each foot of span is a good compromise of limited depth and economy. Therefore, select a depth of 44 inches. c) The Joist Girder shall then be designated 44G8N17.4F. Note that the letter "F" is included at the end of the designation to clearly indicate that this is a factored load. d) The LRFD Joist Girder Design Guide Weight Table shows the weight for a 44G8N18.0F as 49 pounds per linear foot. The designer should verify that the weight is not greater than the weight assumed in the Dead Load above.

Steel Joist Institute – SJI COSP - 2020

<p>e) Check live load deflection: Live load = 30 psf x 50 ft. = 1500 plf Approximate Joist Girder moment of inertia = 0.027 NPLd = 0.027 x 8 x 11.9 x 42 x 44 = 4750 in.⁴ Allowable deflection for plastered ceilings = L/360 = $\frac{42(12)}{360} = 1.40$ in. $\Delta = 1.15 \left[\frac{5wL^4}{384EI} \right] = \frac{1.15(5)(1.500/12)[(42)(12)]^4}{384(29000)(4750)}$ = 0.88 in. <1.40 in., Okay</p>	<p>e) Check live load deflection: Live load = 30 psf x 50 ft. = 1500 plf Approximate Joist Girder moment of inertia = 0.018 NPLd = 0.018 x 8 x 17.4 x 42 x 44 = 4630 in.⁴ Allowable deflection for plastered ceilings = L/360 = $\frac{42(12)}{360} = 1.40$ in. $\Delta = 1.15 \left[\frac{5wL^4}{384EI} \right] = \frac{1.15(5)(1.500/12)[(42)(12)]^4}{384(29000)(4630)}$ = 0.90 in. <1.40 in., Okay</p>
---	---

(c) Load Schedule Example

LOAD SCHEDULE (all loads are to be shown as unfactored)

MARK	DESIGNATION ⁽¹⁾ (TL/LL) Joists: (plf) Girders: (kips)	LOADING ⁽²⁾		W WIND		ADD-LOAD ⁽⁶⁾ TL/LL (kips/kips)	BEND-CHECK ⁽⁷⁾		REMARKS
		DL ⁽³⁾ (plf)	LL ⁽⁴⁾ or L _r /S/R (plf)	DOWN WARD (plf)	NET ⁽⁵⁾ UPLIFT (plf)		D TC (kips)	D BC (kips)	
J1	18KSP	120	185		180	1.0/0.6		0.3	Axial Loads Wind Moments Drift Loads, see diagram
J2	24K7SP	85	155						
J3	28LHSP	110	355	95	175	0.5			
G1	36G5N6.5K/3.5K				360				End Moments

- (1) Joist designation loads include all uniform gravity loads. **Provide both Total and Live loads.**
- (2) Loading values are not required if designation loading values are correct for deflection and load combinations.
- (3) When standard SJI designations are used, the design Dead Load is required for load combinations with Wind or Seismic.
- (4) The Floor or Roof Live load, Snow, or Rain load.
- (5) When Net Uplift is specified for simple loading, it shall already take into account possible reduced Dead Loading present in order to create the largest Net uplift load combination. For more complex loading or when the Dead Load varies greatly for use in load combinations below, **Gross** uplift should be specified with the minimum and maximum Dead Loading values clearly defined. If the uplift cannot be assigned in pounds per lineal foot, a diagram can be shown for joist loading using pounds per square foot.
- (6) A concentrated load applied at any panel point on both the top chord and bottom chord.
- (7) Chord members shall be designed for additional bending stresses created by this concentrated Total load.



Steel Joist Institute – SJI COSP - 2020

When in-plane moments (wind load, seismic load) are specified, continuity moments (live load) **shall** also be specified. A Load Schedule that shows a complete breakdown of all loads by Load Category may be required.

AXIAL and END MOMENT LOAD SCHEDULE

MARK	DESIGNATION (TL/LL) Joists: (plf) Girders: (kips)	MIN. I (in. ⁴)	AXIAL			END MOMENTS								TRANSFER DETAILS @ GRIDS	
			W WIND (kips)	E SEISMIC (kips)	E _m (kips)	LIVE LOAD CONTINUITY MOMENTS (k-ft.)	LATERAL MOMENTS (k-ft.)								
							W WIND		E		E _m				
							LEFT	RIGHT	LEFT	RIGHT	LEFT	RIGHT	LEFT		RIGHT
J1 J2 G1	18KSP 24K7SP 36G5N6.5K/3.5K	985	W=18.0	E=21.8											9/S8 @ 4 11/S8 @ B,C

When special loads as shown in the tables above are specified, the load combinations to be used for joist and Joist Girder design **shall** be provided. Two examples showing how to list load combinations are shown below:

LRFD example- Basic Load Combinations	ASD example - Basic Load Combinations
1. 1.4D	1. D
2. 1.2D + 1.6L + 0.5(L _r or S or R)	2. D + L
3. 1.2D + 1.6(L _r or S or R) + (1.0L or 0.5W)	3. D + (L _r or S or R)
4. 1.2D + 1.0W + 1.0L + 0.5(L _r or S or R)	4. D + 0.75L + 0.75(L _r or S or R)
5. 1.2D + 1.0E + 1.0L + 0.2S	5. D + (0.6W or 0.7E)
6. 0.9D + 1.0W	6a. D + 0.75L + 0.75(0.6W) + 0.75(L _r or S or R)
7. 0.9D + 1.0E	6b. D + 0.75L + 0.75(0.7E) + 0.75S
	7. 0.6D + 0.6W
	8. 0.6D + 0.7E
Special Seismic Load Combinations	Special Seismic Load Combinations
8. (1.2 + 0.2S _{DS})D + E _h + L + 0.2S	9. (1.0 + 0.14S _{DS})D + 0.7E _h
9. (0.9 – 0.2S _{DS})D + E _h	10. (1.0 + 0.105S _{DS})D + 0.525E _h + 0.75L + 0.75(L _r or S or R)
	11. (0.6 – 0.14S _{DS})D + 0.7E _h

2.5 JOIST AND JOIST GIRDER EXTENSIONS

Steel joist and Joist Girder extensions shall be specified and designed in accordance with the requirements of the Steel Joist Institute Standard Specifications of latest adoption.



2.6 CEILING EXTENSIONS

Ceiling extensions shall be furnished to support ceilings that are to be attached directly to the bottom of the joists. They are not furnished for the support of suspended ceilings. The ceiling extension shall be either an extended bottom chord element or a loose unit, whichever is standard with the manufacturer, and shall be of sufficient strength to properly support any specified ceiling loads.

2.7 BRIDGING AND BRIDGING ANCHORS

- (a) Bridging standard with the manufacturer and complying with the Steel Joist Institute Standard Specifications of latest adoption shall be used for bridging all joists furnished by the joist manufacturer. Positive anchorage shall be provided at the ends of each bridging row at both top and bottom chords.
- (b) For K-Series and LH-Series joists, horizontal bridging is recommended for spans up to and including 60 feet (18288 mm) except where the Steel Joist Institute Standard Specifications Load Tables & Weight Tables require bolted diagonal bridging for erection stability.

LH-Series and DLH-Series joists exceeding 60 feet (18288 mm) in length shall have bolted diagonal bridging for all rows.

Refer to Section 5.5 in the Steel Joist Institute Standard Specification for erection stability requirements.

Refer to Appendix B for OSHA steel joist erection stability requirements.

Horizontal bridging shall consist of continuous horizontal steel members designed per Section 5.5 in the Steel Joist Institute Standard Specifications. The material sizes listed in Table 2.7-1 meet the requirements of the specifications. Alternately, or for "load/length" designation joists, Table 2.7-2 provides the maximum horizontal bridging force, P_{br} , for various combinations of joist spacing and bridging angle size.

- (c) Diagonal cross bridging consisting of angles or other shapes connected to the top and bottom chords of K-Series, LH-Series, and DLH-Series joists shall be used when required by the Steel Joist Institute Standard Specifications of latest adoption.

Diagonal bridging, when used, shall be designed per Section 5.5 in the Steel Joist Institute Standard Specifications.

When the bridging members are connected at their point of intersection, the material sizes listed in Table 2.7-3 and Table 2.7-4 meet the requirements of the specifications.

For LH-Series and DLH-Series joists, where the joist spacing is less than 70 percent of the joist depth, bolted horizontal bridging shall be provided in addition to the diagonal bridging, as shown in Table 2.7-4.

- (d) When bolted diagonal erection bridging is required, the following shall apply:
1. The bridging shall be indicated on the joist placement plans.
 2. The joist placement plans shall be the exclusive indicator for the proper placement of this bridging.
 3. Shop installed bridging clips, or functional equivalents, shall be provided where the bridging bolts to the steel joist.
 4. When two pieces of bridging are attached to a steel joist by a common bolt, the nut that secures the first piece of bridging shall not be removed from the bolt for the attachment of the second piece.
 5. Bridging attachments shall not protrude above the top chord of the steel joists.
 6. See Table 2.7-5 for bolt sizes that meet the connection requirements of the Steel Joist Institute Standard Specifications Section 5.5.

Steel Joist Institute – SJI COSP - 2020

TABLE 2.7-1

MAXIMUM JOIST SPACING FOR HORIZONTAL BRIDGING							
SPANS OVER 60 ft. (18.3 m) REQUIRE BOLTED DIAGONAL BRIDGING							
JOIST SECTION NUMBER ¹	Nominal Unfactored Force P _{br} lbs (N)	BRIDGING MATERIAL SIZE ²					
		Equal Leg Angles					
		1 x 7/64 (25 x 3 mm) r = 0.20" (5.08 mm)	1-1/4 x 7/64 (32 x 3 mm) r = 0.25" (6.35 mm)	1-1/2 x 7/64 (38 x 3 mm) r = 0.30" (7.62 mm)	1-3/4 x 7/64 (45 x 3 mm) r = 0.35" (8.89 mm)	2 x 1/8 (52 x 3 mm) r = 0.40" (10.16 mm)	2-1/2 x 5/32 (64 x 4 mm) r = 0.50" (12.70 mm)
ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)		
K1 – 8	340 (1512)	5'-0" (1524)	6'-3" (1905)	7'-6" (2286)	8'-9" (2667)	10'-0" (3048)	12'-6" (3810)
K9-10, LH02-03	450 (2002)	4'-4" (1321)	6'-1" (1854)	7'-6" (2286)	8'-9" (2667)	10'-0" (3048)	12'-6" (3810)
K11-12, LH04-05	560 (2491)	3'-11" (1194)	5'-6" (1676)	7'-4" (2235)	8'-9" (2667)	10'-0" (3048)	12'-6" (3810)
LH06-08	750 (3336)		4'-9" (1448)	6'-3" (1905)	7'-11" (2413)	10'-0" (3048)	12'-6" (3810)
LH09	850 (3781)		4'-5" (1346)	5'-10" (1778)	7'-5" (2261)	9'-9" (2972)	12'-6" (3810)
LH/DLH10	900 (4003)		4'-4" (1321)	5'-8" (1727)	7'-3" (2210)	9'-5" (2870)	12'-6" (3810)
LH/DLH11	950 (4226)		4'-2" (1270)	5'-7" (1702)	7'-0" (2134)	9'-2" (2794)	12'-6" (3810)
LH/DLH12	1100 (4893)		3'-11" (1194)	5'-2" (1575)	6'-8" (2032)	8'-6" (2591)	12'-6" (3810)
LH/DLH13	1200 (5338)		3'-9" (1143)	4'-11" (1499)	6'-3" (1905)	8'-2" (2489)	12'-6" (3810)
LH/DLH14	1300 (5783)			4'-9" (1448)	6'-0" (1829)	7'-10" (2388)	12'-4" (3759)
LH/DLH15	1450 (6450)			4'-6" (1372)	5'-8" (1727)	7'-5" (2261)	11'-8" (3556)
LH/DLH16-17	1850 (8229)			4'-0" (1219)	5'-0" (1524)	6'-7" (2007)	10'-4" (3150)
LH/DLH18-20	2350 (10453)			3'-7" (1067)	4'-4" (1321)	5'-10" (1778)	9'-1" (2769)
LH/DLH21-22	3150 (14012)				3'-10" (1168)	5'-0" (1524)	7'-11" (2413)
LH/DLH23-24	4130 (18371)				3'-4" (1016)	4'-5" (1346)	6'-11" (2108)
LH/DLH25	4770 (21218)					4'-1" (1245)	6'-5" (1956)

(1) Refer to last two digit(s) of Joist Designation

(2) Connection to joist shall resist force listed in the Steel Joist Institute Standard Specifications Table 5.5-2



Steel Joist Institute – SJI COSP - 2020

TABLE 2.7-2

JOIST SPACING (ft.-in.)	MAXIMUM BRIDGING FORCE (P _{br}) FOR HORIZONTAL BRIDGING (lbs)						
	BRIDGING ANGLE SIZE (EQUAL LEG ANGLE)						
	1 x 7/64 r = 0.20"	1¼ x 7/64 r = 0.25"	1½ x 7/64 r = 0.30"	1¾ x 7/64 r = 0.35"	2 x 1/8 r = 0.40"	2½ x 5/32 r = 0.50"	3 x 3/16 r = 0.60"
2'-0"	2150	3960	5600				
2'-6"	1370	2730	4410	5910			
3'-0"	950	1890	3290	4850			
3'-6"	700	1390	2420	3840	6180		
4'-0"	530	1060	1850	2960	5030		
4'-6"	420	840	1460	2340	4000		
5'-0"	340	680	1180	1890	3240		
5'-6"	-	560	980	1560	2670		
6'-0"	-	470	820	1310	2250	5490	
6'-6"	-	-	700	1120	1910	4680	
7'-0"	-	-	600	960	1650	4030	
7'-6"	-	-	520	840	1440	3510	
8'-0"	-	-	-	740	1260	3090	
8'-6"	-	-	-	650	1120	2740	5680
9'-0"	-	-	-	-	1000	2440	5060
9'-6"	-	-	-	-	890	2190	4540
10'-0"	-	-	-	-	810	1970	4100
10'-6"	-	-	-	-	-	1790	3720
11'-0"	-	-	-	-	-	1630	3390
11'-6"	-	-	-	-	-	1490	3100
12'-0"	-	-	-	-	-	1370	2850



Steel Joist Institute – SJI COSP - 2020

TABLE 2.7-3

K, LH, and DLH SERIES JOISTS MAXIMUM JOIST SPACING FOR DIAGONAL BRIDGING ¹								
JOIST DEPTH	BRIDGING ANGLE SIZE – (EQUAL LEG ANGLE) ²							
	1 x 7/64 (25 x 3 mm) r = 0.20" (5.08 mm)	1-1/4 x 7/64 (32 x 3 mm) r = 0.25" (6.35 mm)	1-1/2 x 7/64 (38 x 3 mm) r = 0.30" (7.62 mm)	1-3/4 x 7/64 (45 x 3 mm) r = 0.35" (8.89 mm)	2 x 1/8 (50 x 3 mm) r = 0.40" (10.16 mm)	2 1/2 x 5/32 (64 x 4 mm) r = 0.50" (12.70 mm)	3 x 3/16 (76 x 5 mm) r = 0.60" (15.24 mm)	3 1/2 x 1/4 (89 x 6 mm) r = 0.70" (17.78 mm)
in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)	ft.-in. (mm)
12" (305)	6'-7" (2007)	8'-3" (2514)	9'-11" (3022)	11'-7" (3530)	13'-3" (4038)	16'-7" (5055)	19'-11" (6070)	23'-3" (7086)
14" (356)	6'-6" (1981)	8'-3" (2514)	9'-11" (3022)	11'-7" (3530)	13'-3" (4038)	16'-7" (5055)	19'-11" (6070)	23'-3" (7086)
16" (406)	6'-6" (1981)	8'-2" (2489)	9'-10" (2997)	11'-7" (3530)	13'-3" (4038)	16'-7" (5055)	19'-11" (6070)	23'-3" (7086)
18" (457)	6'-6" (1981)	8'-2" (2489)	9'-10" (2997)	11'-6" (3505)	13'-3" (4038)	16'-7" (5055)	19'-11" (6070)	23'-3" (7086)
20" (508)	6'-5" (1955)	8'-2" (2489)	9'-10" (2997)	11'-6" (3505)	13'-2" (4013)	16'-7" (5055)	19'-11" (6070)	23'-3" (7086)
22" (559)	6'-4" (1930)	8'-1" (2463)	9'-10" (2997)	11'-6" (3505)	13'-2" (4013)	16'-6" (5029)	19'-11" (6070)	23'-3" (7086)
24" (610)	6'-4" (1930)	8'-1" (2463)	9'-9" (2971)	11'-5" (3479)	13'-2" (4013)	16'-6" (5029)	19'-10" (6045)	23'-3" (7086)
26" (660)	6'-3" (1905)	8'-0" (2438)	9'-9" (2971)	11'-5" (3479)	13'-1" (3987)	16'-6" (5029)	19'-10" (6045)	23'-2" (7061)
28" (711)	6'-3" (1905)	8'-0" (2438)	9'-8" (2946)	11'-5" (3479)	13'-1" (3987)	16'-6" (5029)	19'-10" (6045)	23'-2" (7061)
30" (762)	6'-2" (1879)	7'-11" (2413)	9'-8" (2946)	11'-4" (3454)	13'-1" (3987)	16'-5" (5004)	19'-10" (6045)	23'-2" (7061)
32" (813)	6'-1" (1854)	7'-10" (2387)	9'-7" (2921)	11'-4" (3454)	13'-0" (3962)	16'-5" (5004)	19'-9" (6020)	23'-2" (7061)
36" (914)	5'-11" (1803)	7'-9" (2362)	9'-6" (2895)	11'-3" (3429)	12'-11" (3973)	16'-4" (4979)	19'-9" (6020)	23'-1" (7035)
40" (1016)	5'-9" (1753)	7'-7" (2311)	9'-5" (2870)	11'-2" (3403)	12'-10" (3911)	16'-4" (4979)	19'-8" (5994)	23'-1" (7035)
44" (1118)	5'-6" (1676)	7'-5" (2260)	9'-3" (2819)	11'-0" (3352)	12'-9" (3886)	16'-3" (4953)	19'-7" (5969)	23'-0" (7010)
48" (1219)	5'-4" (1626)	7'-3" (2209)	9'-2" (2794)	10'-11" (3327)	12'-8" (3860)	16'-2" (4928)	19'-7" (5969)	22'-11" (6985)
52" (1321)	5'-0" (1524)	7'-1" (2159)	9'-0" (2743)	10'-10" (3302)	12'-7" (3835)	16'-1" (4902)	19'-6" (5943)	22'-11" (6985)
56" (1422)	4'-9" (1448)	6'-10" (2083)	8'-10" (2692)	10'-8" (3251)	12'-5" (3784)	16'-0" (4877)	19'-5" (5918)	22'-10" (6960)
60" (1524)	4'-4" (1321)	6'-8" (2032)	8'-7" (2616)	10'-6" (3200)	12'-4" (3759)	15'-10" (4826)	19'-4" (5893)	22'-9" (6935)
64" (1626)	**	6'-4" (1931)	8'-5" (2565)	10'-4" (3149)	12'-2" (3708)	15'-9" (4801)	19'-3" (5867)	22'-8" (6909)
68" (1727)	**	6'-1" (1854)	8'-2" (2489)	10'-2" (3098)	12'-0" (3657)	15'-8" (4775)	19'-2" (5842)	22'-7" (6884)
72" (1829)	**	5'-9" (1753)	8'-0" (2438)	10'-0" (3048)	11'-10" (3606)	15'-6" (4724)	19'-1" (5816)	22'-6" (6858)
80" (2032)	**	5'-0" (1524)	7'-5" (2260)	9'-6" (2895)	11'-6" (3505)	15'-3" (4648)	18'-10" (5740)	22'-4" (6808)
88" (2235)		**	6'-9" (2058)	9'-0" (2743)	11'-1" (3378)	14'-11" (4546)	18'-7" (5664)	22'-1" (6731)
96" (2438)		**	6'-0" (1829)	8'-5" (2565)	10'-8" (3251)	14'-7" (4445)	18'-4" (5588)	21'-11" (6680)
104" (2642)			**	7'-9" (2362)	10'-1" (3073)	14'-2" (4318)	18'-0" (5486)	21'-8" (6604)
112" (2845)			**	7'-0" (2134)	9'-6" (2895)	13'-9" (4191)	17'-8" (5385)	21'-4" (6503)
120" (3048)				**	8'-9" (2667)	13'-4" (4064)	17'-3" (5258)	21'-1" (6426)

**** INTERPOLATION BELOW THE MINIMUM VALUES SHOWN IS NOT ALLOWED.**

1) SEE TABLE 2.7-4 FOR MINIMUM JOIST SPACE FOR DIAGONAL ONLY BRIDGING.
 2) In the shaded range of the Table, for LH23, 24, and 25, compressive strength requirements may control, reducing the maximum joist spacing shown. Either select a larger bridging angle size (outside of the shaded area) or check compression strength (Ref. Section 2.7(c)) for LH23, 24, and 25.



Steel Joist Institute – SJI COSP - 2020

TABLE 2.7-4

LH AND DLH SERIES JOISTS HORIZONTAL PLUS DIAGONAL BRIDGING REQUIREMENTS		
JOIST DEPTH	MINIMUM JOIST SPACE FOR DIAGONAL ONLY BRIDGING (0.70 x DEPTH)*	HORIZONTAL AND DIAGONAL MINIMUM ANGLE SIZE REQUIRED FOR JOIST SPACING < (0.70 X DEPTH) AND JOIST SPANS > 60'-0" (18.3 m)
in. (mm)	ft.-in. (mm)	in. (mm)
52" (1321)	3'- 0" (914)	1" x 1" x 7/64" (25 x 3)
56" (1422)	3'- 3" (990)	1" x 1" x 7/64" (25 x 3)
60" (1524)	3'- 6" (1066)	1" x 1" x 7/64" (25 x 3)
64" (1626)	3'- 8" (1117)	1 1/4" x 1 1/4" x 7/64" (32 x 3)
68" (1727)	3'-11" (1193)	1 1/4" x 1 1/4" x 7/64" (32 x 3)
72" (1829)	4'- 2" (1270)	1 1/4" x 1 1/4" x 7/64" (32 x 3)
80" (2032)	4'- 8" (1422)	1 1/4" x 1 1/4" x 7/64" (32 x 3)
88" (2235)	5'- 1" (1549)	1 1/2" x 1 1/2" x 7/64" (38 x 3)
96" (2438)	5'- 7" (1702)	1 1/2" x 1 1/2" x 7/64" (38 x 3)
104" (2642)	6'- 0" (1829)	1 3/4" x 1 3/4" x 7/64" (44 x 3)
112" (2845)	6'- 6" (1981)	1 3/4" x 1 3/4" x 7/64" (44 x 3)
120" (3048)	7'- 0" (2134)	2" x 2" x 1/8" (51 x 3)

*NOTE: WHEN THE JOIST SPACING IS LESS THAN 0.70 x JOIST DEPTH,
BOLTED HORIZONTAL BRIDGING SHALL BE USED IN ADDITION TO DIAGONAL BRIDGING.

TABLE 2.7-5

BOLT SIZES WHICH MEET BOLTED BRIDGING CONNECTION REQUIREMENTS		
JOIST SERIES	SECTION NUMBER*	BOLT DIAMETER
K	ALL	3/8" (10 mm) A307
LH/DLH	2 – 12	3/8" (10 mm) A307
LH/DLH	13 – 17	1/2" (13 mm) A307
LH/DLH	18 – 20	5/8" (16 mm) A307
LH/DLH	21 – 22	5/8" (16 mm) A325
LH/DLH	23 – 25	3/4" (19 mm) A325

*REFER TO LAST DIGIT(S) OF JOIST DESIGNATION
NOTE: WASHERS SHALL BE USED WITH SLOTTED OR OVERSIZED HOLES. BOLTS SHALL BE TIGHTENED TO A MINIMUM SNUG TIGHT CONDITION.



2.8 HEADERS

Where the end reaction of a steel joist is supported by a header, as outlined and defined in Section 5.2(a), and is not more than 10,000 pounds (44482 N), the header shall be furnished by the Seller. Such headers shall be any type standard with the joist manufacturer. Conditions involving headers shall be investigated during erection and, if necessary, provisions made to provide a safe condition. Headers are not provided for steel joists with end reactions greater than 10,000 pounds (44482 N).

2.9 BOTTOM CHORD LATERAL BRACING FOR JOIST GIRDERS

Bottom chord lateral bracing shall be furnished as required to prevent lateral movement of the bottom chord of the Joist Girder and to prevent the ratio of chord length to chord radius of gyration from exceeding that specified in the Steel Joist Institute Standard Specifications of latest adoption. The lateral bracing shall be that which is standard with the joist manufacturer, and shall be sufficient to properly brace the bottom chord of the Joist Girder.

2.10 CONNECTIONS

The adequacy of the end anchorage connection (bolted or welded) between the joist or Joist Girder bearing seat and the supporting structure is the responsibility of the *specifying professional*. The contract documents shall clearly illustrate the end anchorage connection. Forces to be considered include end moments, axial loads, and diaphragm boundaries. Particular attention is required where there is net uplift.

Welded End Anchorage for Uplift

The strength of the joist bearing seat for an uplift loading combination is a function of both the joist seat thickness and length of the end anchorage welds. The minimum end anchorage welds as shown in the Steel Joist Institute Standard Specifications Table 5.7-1 may not develop the full capacity of the joist seat assembly for the specified uplift resistance. When the support dimensions allow, it is recommended the *specifying professional* use a small fillet weld thickness in conjunction with a longer weld length for the connection design to facilitate the design of the joist bearing seat. The joist manufacturer will provide a seat of sufficient thickness and strength to resist the uplift end reaction resulting from the specified uplift. For additional information, including tables for welded end anchorage uplift capacities, refer to Steel Joist Institute Technical Digest 6, "Structural Design of Steel Joist Roofs to Resist Uplift Loads"

Bolted End Anchorage for Uplift

Typically, joists and Joist Girders with bolted end anchorage also require a final connection by welding in order to provide lateral stability to the supporting member. However, only the bolts are relied on to provide uplift anchorage. The bolt type and diameter designed by the *specifying professional* shall provide sufficient tensile strength to resist the uplift end reaction resulting from the specified uplift. Bolts of higher strength than the minimum required by the Steel Joist Institute Standard Specifications may be required.

When the bearing seats are detailed for a bolted connection, bolts shall be installed. If the bolts are not installed, an equivalent welded connection may be permitted by the *specifying professional*, provided the weld is deposited in the slot on the side farthest from the edge of the seat. Additional weld required to meet that specified for the welded connection shall be placed at a location on the seat away from the outer edge of the slot as shown in Figure 2.10-1.

For additional information, including tables for bolted end anchorage uplift capacities, refer to Steel Joist Institute Technical Digest 6, "Structural Design of Steel Joist Roofs to Resist Uplift Loads"

Steel Joist Institute – SJI COSP - 2020

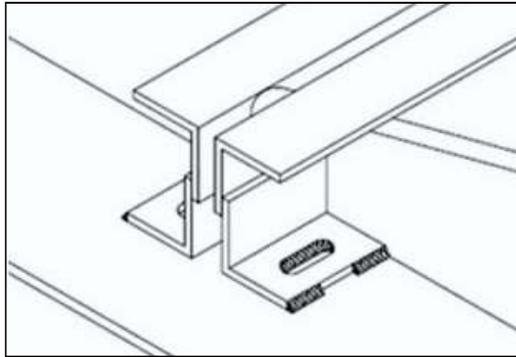


Figure 2.10-1

SECTION 3. MATERIALS

3.1 STEEL

The steel used in the manufacture of joists and Joist Girders shall comply with the Steel Joist Institute Standard Specifications of latest adoption.

3.2 PAINT

- (a) Standard Shop Paint - The shop coat of paint, when specified, shall comply with the Steel Joist Institute Standard Specifications of latest adoption.
- (b) Disclaimer - The typical shop applied paint that is used to coat steel joists and Joist Girders is a dip applied, air dried paint. The paint is intended to be an impermanent and provisional coating which shall protect the steel for only a short period of exposure in ordinary atmospheric conditions.

Since most joists and Joist Girders are painted using a standard dip coating, the coating shall be permitted to not be uniform and shall be permitted to include drips, runs, and sags. Compatibility of any coating including fire protective coatings applied over the standard shop paint shall be the responsibility of the specifier and/or painting contractor.

The shop applied paint may require field touch-up/repair as a result of, but not limited to, the following:

1. Abrasions from: Bundling, banding, loading and unloading, chains, dunnage during shipping, cables and chains during erection, bridging, installation, and other handling at the jobsite.
NOTE: Rusting should be expected at any abrasion.
2. Dirt.
3. Diesel smoke.
4. Road salt.
5. Weather conditions during storage.

The joist manufacturer shall not be responsible for the condition of the paint if it is not properly protected after delivery.

SECTION 4. **INSPECTION**

Inspections shall be made in accordance with Section 5.14 of the Steel Joist Institute Standard Specifications of latest adoption.

SECTION 5. **ESTIMATING**

5.1 PLANS FOR BIDDING

Plans to serve as the basis for bids shall show the character of the work with sufficient clarity to permit making an accurate estimate and shall show the following:

- Designation and location of Materials [see Section 5.2(a)], including any special design or configuration requirements
- Locations and elevations of all steel and concrete supporting members and bearing walls
- Location and length of joist extended ends
- Location and size of all openings in floors and roofs
- Location of all partitions
- Loads and their locations as defined in Section 6.1
- Construction and thickness of floor slabs, roof deck, ceilings and partitions
- Joists or Joist Girders requiring extended bottom chords
- Paint, if other than manufacturer's standard

5.2 SCOPE OF ESTIMATE

(a) Unless otherwise specified, the following items shall be included in the estimate, and requirements shall be determined as outlined in Section 6.1:

- Steel Joists
- Joist Girders
- Joist Substitutes
- Joist Extended Ends
- Ceiling Extensions
- Extended bottom chord used as strut
- Bridging
- Joist Girder bottom chord bracing
- Headers which are defined as members supported by and carrying Open Web Steel Joists with end reactions of no more than 10,000 lbs. (44482 N)
- One shop coat of paint, when specified, shall be in accordance with Section 3.2

(b) The following items shall not be included in the estimate but shall be permitted to be quoted and identified by the joist manufacturer as separate items:

- Headers carrying Open Web Steel Joists with end reactions greater than 10,000 lbs. (44482 N)
- Headers for Deep Longspan Steel Joists, **DLH-Series**

Steel Joist Institute – SJI COSP - 2020

- Reinforcement in slabs over joists
- Centering material, decking, and attachments
- Miscellaneous framing between joists for openings at ducts, dumbwaiters, ventilators, skylights, etc.
- Loose individual or continuous bearing plates and bolts or anchors for such plates
- Erection bolts for joist and Joist Girder end anchorage
- Horizontal bracing in the plane of the top and bottom chords from joist to joist or joist to structural framing and walls
- Bridging anchors and anchorage
- Wood nailers
- Moment plates
- Special joist configuration or bridging layouts for ductwork or sprinkler systems
- Shear studs

SECTION 6.

PLANS AND SPECIFICATIONS**6.1 PLANS FURNISHED BY BUYER**

The Buyer shall furnish the Seller plans and specifications as prepared by the *specifying professional* showing all Material requirements and steel joist and/or steel Joist Girder designations, the layout of walls, columns, beams, girders and other supports, as well as floor and roof openings and partitions correctly dimensioned. The elevation of finished floors, roofs, and bearings shall be shown.

(a) Loads

The *specifying professional* shall clearly provide all design loads as described in Section 2.4 This includes the live loads to be used, the wind uplift if any, the weights of partitions and the location and amount of any special loads, such as monorails, fans, blowers, tanks, etc.

(b) Connections

Minimum end anchorage for simple span gravity loading shall be in accordance with Steel Joist Institute Standard Specifications of latest adoption, Section 5.7. The end anchorage of a steel joist or Joist Girder is the connection of the joist or Joist Girder bearing seat to the support of the joist or Joist Girder.

The adequacy of the end anchorage connection (bolted or welded) between the joist or Joist Girder bearing seat and the supporting structure is the responsibility of the *specifying professional*. The contract documents shall clearly illustrate the end anchorage connection.

The joist manufacturer is responsible for the design of the bearing seats of joists or Joist Girders for the loads designated by the *specifying professional* in the contract documents.

The *specifying professional* is responsible for bridging termination connections. The contract documents shall clearly illustrate these termination connections.

(c) Special Considerations

The *specifying professional* shall indicate on the construction documents special considerations including:

- 1) Profiles for non-standard joist and Joist Girder configurations (Standard joist and Joist Girder configurations are as indicated in the Steel Joist Institute Standard Specifications of latest adoption).
- 2) Oversized or other non-standard web openings
- 3) Extended Ends

Steel Joist Institute – SJI COSP - 2020

- 4) Deflection criteria for live and total loads for non-SJI standard joists
- 5) Non-SJI standard bridging

6.2 PLANS FURNISHED BY SELLER

The Seller shall furnish the buyer with steel joist placement plans to show the material as specified on the construction documents and are to be utilized for field installation in accordance with specific project requirements as stated in Section 6.1. Steel placement plans shall include, at a minimum, the following:

- a) Listing of all applicable loads as stated in Section 6.1 and used in the design of the steel joists and Joist Girders as specified in the construction documents.
- b) Profiles for non-standard joist and Joist Girder configurations (standard joist and Joist Girder configurations are as indicated in the Steel Joist Institute Standard Specifications of latest adoption).
- c) Connection requirements for:
 - 1) Joist supports
 - 2) Joist Girder supports
 - 3) Field splices
 - 4) Bridging attachments
- d) Deflection criteria for live load and total loads for non-SJI standard joists.
- e) Size, location, and connections for all bridging
- f) Joist headers

All Material shall be identified with its mark which also appears on the Bill of Materials. The shop paint shall be as noted on the joist placement plans. **Steel joist placement plans do not require the seal and signature of the joist manufacturer's registered design professional.**

6.3 DISCREPANCIES

The *specifying professional's* bid plans and specifications shall be assumed to be correct in the absence of written notice from the Buyer to the contrary. When plans are furnished by the Buyer that do not agree with the Architect's bid plans, such detailed plans shall be considered as a written notice of change of plans. However, it shall be the Buyer's responsibility to advise the Seller of those changes which affect the joists or Joist Girders.

6.4 APPROVAL

When joist placement plans are furnished by the Seller, they are submitted to the Buyer and owner for examination and approval. The Seller allows a maximum of fourteen (14) calendar days in their schedule for the return of placement plans noted with the owner's and customer's approval, or approval subject to corrections as noted. The Seller makes the corrections, furnishes corrected prints for field use to the owner/customer and is released by the owner/customer to start joist manufacture.

Approval by the owner/customer of the placement plans, sections, notes and joist schedule prepared by the Seller indicates that the Seller has correctly interpreted the contract requirements, and is released by the owner/customer to start joist manufacture. This approval constitutes the owner's/customer's acceptance of all responsibility for the design adequacy of any detail configuration of joist support conditions shown by the Seller as part of the preparation of these placement plans.

Approval does not relieve the Seller of the responsibility for accuracy of detail dimensions on the plans, nor the general fit-up of joists to be placed in the field.

Steel Joist Institute – SJI COSP - 2020

6.5 CHANGES

When any changes in plans are made by the Buyer (or the buyer's representative) either prior to or after approval of detailed plans, or when any Material is required and was not shown on the plans used as the basis of the bid, the cost of such changes and/or extra Material shall be paid by the Buyer at a price to be agreed upon between Buyer and Seller.

6.6 CALCULATIONS

The Seller shall design the steel joists and/or steel Joist Girders in accordance with the current Steel Joist Institute Standard Specifications of latest adoption to support the load requirements of Section 6.1. The *specifying professional* may require submission of the steel joist and Joist Girder calculations as prepared by a registered design professional responsible for the product design. If requested by the *specifying professional*, the steel joist manufacturer shall submit design calculations with a cover letter bearing the seal and signature of the joist manufacturer's registered design professional. In addition to standard calculations under this seal and signature, submittal of the following shall be included:

- a) Non-SJI standard bridging details (e.g. for cantilevered conditions, net uplift, etc.)
- b) Connection details for:
 - 1) Non-SJI standard connections (e.g. flush framed or framed connections)
 - 2) Field splices
 - 3) Joist headers

SECTION 7.**HANDLING AND ERECTION**

The Buyer and Erector shall comply with the requirements of the Steel Joist Institute Standard Specifications of latest adoption in the handling and erection of Material. For additional coverage of this topic, refer to the Steel Joist Institute's Technical Digest 9, "Handling and Erection of Steel Joists and Joist Girders".

The Buyer and/or Erector shall check all materials on arrival at job site and promptly report to Seller any discrepancies and/or damages.

When joists cannot be delivered as a single piece, they shall be permitted to be delivered in several pieces therefore requiring the pieces to be spliced together in the field. The manufacturer's instructions SHALL be followed to ensure matching pieces are joined, proper bolts are used, and any required bolt tensioning is incorporated.

All joists shall be handled by methods which avoid damage to any part of the joist. For long LH-Series joists, DLH-Series joists, or Joist Girders this may require the use of spreader bars, multiple hoisting cables, or multiple cranes as necessary to safely handle the joist. Hoisting cables shall be attached at panel points and shall be at panel point locations selected to minimize erection stresses.

The current OSHA, 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R- Steel Erection, refers to certain joists at or near columns to be designed with sufficient strength to allow one employee to release the hoisting cable without the need for erection bridging. **This STANDARD shall not be interpreted that any joist at or near a column line is safe to support an employee without bridging installed.** Many limitations exist that prevent these joists from being designed to safely allow an employee on an un-bridged joist. Because of these limitations these joists shall be erected by incorporating erection methods ensuring joist stability and either:

- 1) Installing bridging or otherwise stabilizing the joist prior to releasing the hoisting cable, or
- 2) Releasing the hoisting cable without having a worker on the joist.

A steel joist or Joist Girder shall not be placed on any support structure unless such structure is stabilized. When steel joists or Joist Girders are landed on a structure, they shall be secured to prevent unintentional displacement prior to installation.

Steel Joist Institute – SJI COSP - 2020

A bridging terminus point shall be established before joist bridging is installed.

Steel joist and Joist Girders shall not be used as anchorage points for a fall arrest system unless written directions to do so is obtained from a “qualified person”. (For definition of “qualified person” see Code of Federal Regulations (CFR), Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R- Steel Erection, §1926.751 Definitions, January 18, 2001, Washington, D.C.)

No modification that affects the strength of a steel joist or Joist Girder shall be made without the written approval of the project engineer of record.

The Seller shall not be responsible for the condition of paint finish on Material if it is not properly protected after delivery.

The Seller shall not be responsible for improper fit of Material due to inaccurate construction work.

SECTION 8. **BUSINESS RELATIONS**

8.1 PRESENTATION OF PROPOSALS

All proposals for furnishing Material shall be made on a sales contract form. After acceptance by the Buyer, these proposals shall be approved or executed by a qualified official of the Seller. Upon such approval the proposal becomes a contract.

8.2 ACCEPTANCE OF PROPOSALS

All proposals are intended for prompt acceptance and are subject to change without notice.

8.3 BILLING

Contracts on a lump sum basis are to be billed proportionately as shipments are made.

8.4 PAYMENT

Payments shall be made in full on each invoice without retention.

8.5 ARBITRATION

All business controversies which cannot be settled by direct negotiations between Buyer and Seller shall be submitted to arbitration. Both parties shall sign a submission to arbitration and if possible agree upon an arbitrator. If they are unable to agree, each shall appoint an arbitrator and these two shall appoint a third arbitrator. The expenses of the arbitration shall be divided equally between the parties, unless otherwise provided for in the agreements to submit to arbitration. The arbitrators shall pass final judgment upon all questions, both of law and fact, and their findings shall be conclusive.

American National Standard SJI 100 - 2020

STANDARD SPECIFICATION

FOR K-SERIES, LH-SERIES, AND DLH-SERIES OPEN WEB STEEL JOISTS AND FOR JOIST GIRDERS.

K-Series Adopted by the Steel Joist Institute November 4, 1985
 LH/DLH-Series Adopted by the Steel Joist Institute May 10, 2006
 Joist Girders Adopted by the Steel Joist Institute November 4, 1985
 Revised to April 27, 2020, Effective July 1, 2020

SECTION 1.

SCOPE AND DEFINITIONS

1.1 SCOPE

The *Standard Specification for K-Series, LH-Series, DLH-Series Open Web Steel Joists and for Joist Girders*, hereafter referred to as the Specification, covers the design, manufacture, application, and erection stability and handling of Joist Girders and Open Web Steel Joists K-Series, LH-Series, and DLH-Series in buildings or other structures, where other structures are defined as those structures designed, manufactured, and erected in a manner similar to buildings. Joist Girders and K-Series, LH-Series, and DLH-Series joists shall be designed using Allowable Stress Design (ASD) or Load and Resistance Factor Design (LRFD) in accordance with this Specification. Included as part of this Specification are KCS joists, K-Series; Joist Substitutes, K-Series; and Top Chord Extensions and Extended Ends, K-Series.

1.2 OTHER REGULATIONS

Joist Girders and K-Series, LH-Series, and DLH-Series joists shall be erected in accordance with the Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection, Subpart R – Steel Erection. The erection of Joist Girders and K-Series, LH-Series, and DLH-Series joists 144 ft. (43.9 m) or less in length shall be in accordance with the requirements of Section 1926.757, Open Web Steel Joists. Joist Girders and DLH-Series joists greater than 144 ft. (43.9 m) in length shall be in accordance with the requirements of Section 1926.756 Beams and Columns.

1.3 APPLICATION

This Specification includes Section 1 through Section 6. The user notes shall not be part of the Specification.

User Note: User notes are intended to provide practical guidance in the use and application of this Specification.

1.4 DEFINITIONS

The following terms shall, for the purposes of this Specification, have the meanings shown in this Section. Where terms are not defined in this Section, those terms shall have their ordinary accepted meanings in the context in which it applies.

Joist Girders, K-Series, LH-Series, and DLH-Series shall be open web, in-plane load-carrying steel members utilizing hot-rolled or cold-formed steel, including cold-formed steel whose yield strength has been attained by cold working.

Joist Girders shall be open web steel trusses used as primary framing members designed as simple spans supporting in-plane concentrated loads for a floor or roof system. These concentrated loads shall be considered to act at the top chord panel points of the Joist Girders unless otherwise specified.



American National Standard SJI 100 - 2020

The Joist Girder standard designation in ASD shall be established by its nominal depth in inches (mm), the letter “G”, followed by the number of joist spaces, the letter “N”, the load in kips (kN) at each panel point, and the letter “K”. The Joist Girder standard designation in LRFD shall be established by its nominal depth in inches (mm), the letter “G”, followed by the number of joist spaces, the letter “N”, the factored load in kips (kN) at each panel point, and the letter “F”. Joist Girders shall be designed in accordance with this Specification to support the loads defined by the specifying professional.

Joist Girders shall be designed and manufactured as either simple framing members with underslung ends and bottom chord extensions or as part of an ordinary steel moment frame (OMF). Where used as part of an OMF the specifying professional shall be responsible for carrying out all the required frame analyses (i.e. first-order and second-order), provide all the required load information and stiffness data to the joist manufacturer, and indicate the type of **Joist Girder** to column connections that are being designed on the structural drawings.

User Note: Joist Girders have been standardized in depths from 20 inches (508 mm) through 120 inches (3048 mm), for spans from 20 feet (6096 mm) through 120 feet (36576 mm).

Where this Specification refers to “steel joists”, this shall mean the K-Series, LH-Series, and DLH-Series joists.

User Note: Joists are suitable for the direct support of floors and roof slabs or decks. The K-Series joists are standardized in depths from 10 inches (254 mm) through 30 inches (762 mm), for spans up through 60 feet (18288 mm). The LH-Series joists are standardized in depths from 18 inches (457 mm) through 48 inches (1219 mm), for spans up through 96 feet (29261 mm). The DLH-Series joists are standardized in depths from 52 inches (1321 mm) through 120 inches (3048 mm), for spans up through 240 feet (73152 mm).

The K-Series, LH-Series and DLH-Series standard joist designations shall be established by their nominal depth, followed by the letters K, LH or DLH as appropriate, and then by the Section Number designation assigned. The Section Number designations shall range from 01 to 25. The K-Series, LH-Series and DLH-Series standard joist designations listed in the following Standard Load Tables shall support the uniformly distributed loads as provided in the applicable tables:

Standard LRFD Load Table Open Web Steel Joists, K-Series – U.S. Customary Units
 Standard ASD Load Table Open Web Steel Joists, K-Series – U.S. Customary Units
 Standard LRFD Load Table Longspan Steel Joists, LH-Series – U.S. Customary Units
 Standard ASD Load Table Longspan Steel Joists, LH-Series – U.S. Customary Units
 Standard LRFD Load Table Deep Longspan Steel Joists, DLH-Series – U.S. Customary Units
 Standard ASD Load Table Deep Longspan Steel Joists, DLH-Series – U.S. Customary Units
 Standard LRFD Load Table Open Web Steel Joists, K-Series – S.I. Units
 Standard ASD Load Table Open Web Steel Joists, K-Series – S.I. Units
 Standard LRFD Load Table Longspan Steel Joists, LH-Series – S.I. Units
 Standard ASD Load Table Longspan Steel Joists, LH-Series – S.I. Units
 Standard LRFD Load Table Deep Longspan Steel Joists, DLH-Series – S.I. Units
 Standard ASD Load Table Deep Longspan Steel Joists, DLH-Series – S.I. Units

Wherever a standard SJI Section Number is specified in the joist designation (e.g. 18K4, 32LH10) and other design load cases are also specified for the joist, the steel joist shall be designed for the corresponding total load as shown in the Standard Load Tables as a minimum.

User Note: Six standard types of K-Series, LH-Series and DLH-Series joists are designed and manufactured. These types are underslung (top chord bearing) or square-ended (bottom chord bearing), with parallel chords or with single or double pitched top chords. The Standard Load Tables apply for a pitched top chord up to 1/2 inch per foot (1:24).

The steel joist or Joist Girder designation depth shall be the depth at mid-span.

An alternate method of specifying a standard K-Series, LH-Series, or DLH-Series joist shall be permitted by providing the designation in a “load/load” sequence. The format used shall be ddKt/ll, ddLHt/ll, or ddDLHt/ll where:

dd is the nominal depth of the joist in inches (mm)

tl is the total uniformly distributed load applied to the joist top chord, plf (kN/m)

ll is the uniform live load for which the deflection shall be checked and limited as required by this Specification, plf (kN/m)

American National Standard SJI 100 - 2020

User Note: The load/load K-Series, LH-Series, or DLH-Series joists can be specified in depths from 10 inches (254 mm) through 120 inches (3048 mm) and spans up through 240 feet (73152 mm). The maximum uniformly distributed load-carrying capacity of 2400 plf (35.03 kN/m) in ASD and 3600 plf (52.54 kN/m) in LRFD has been established for this alternate K-Series, LH-Series, or DLH-Series format. The maximum capacity for any given load/load joist designation is a function of span, depth and chord member size. When requirements exceed the standard K-Series load table limitations for loading, span, and depth, an LH-Series designation is recommended to facilitate the proper determination of minimum seat depth, end anchorage, bridging size, deck attachment, etc. Thus, any joist exceeding a 30 inch depth, a span of 60 feet, an in-kip moment of Depth x 61 kips in ASD or Depth x 91.5 kips in LRFD, or an end reaction of 9.2 kips in ASD or 13.8 kips in LRFD should be designated as an LH-Series which allows for a cross-reference with a standard LH designation as listed in this Specification for seat, end anchorage, bridging, attachment tables, etc.

A KCS Joist is a particular type of K-Series joist, and shall be designed in accordance with this Specification based on an envelope of moment and shear capacity, rather than uniform load capacity, to support uniform plus concentrated loads or other non-uniform loads. The KCS Joists shall be selected from standardized depths from 10 inches (254 mm) through 30 inches (762 mm), for spans up through 60 feet (18288 mm). The maximum total safe uniformly distributed load-carrying capacity of a KCS Joist, K-Series, shall be 550 plf (8.02 kN/m) in ASD or 825 plf (12.03 kN/m) in LRFD. A KCS Joist shall be parallel chord only and shall be permitted to be underslung or bottom chord bearing.

The KCS Joists, K-Series, standard designations shall be established by their nominal depth, followed by the letters "KCS", and then by the Section Number designation assigned. The Section Number designations shall range from 1 to 5. A KCS Joist shall not be designated using the alternate "load/load" method. The KCS Joists, K-Series, standard designations listed in the following Standard Load Tables shall provide the moment capacity and shear capacity as listed in the applicable tables:

- Standard LRFD Load Table for KCS Open Web Steel Joists – U.S. Customary Units
- Standard ASD Load Table for KCS Open Web Steel Joists – U.S. Customary Units
- Standard LRFD Load Table for KCS Open Web Steel Joists – S.I. Units
- Standard ASD Load Table for KCS Open Web Steel Joists – S.I. Units

Where an open web configuration becomes impractical, a Joist Substitute, K-Series, shall be designed in accordance with this Specification to support uniform loads when the span is less than 10 feet (3048 mm). The maximum total safe uniformly distributed load-carrying capacity of a Joist Substitute shall be 550 plf (8.02 kN/m) in ASD or 825 plf (12.03 kN/m) in LRFD.

The Joist Substitutes, K-Series, standard designations shall be established by their nominal depth, e.g. 2.5, followed by the letter "K" and then by the chord size designation assigned. The chord size designations shall range from 1 to 3. The Joist Substitutes, K-Series, standard designations listed in the following Load Tables shall support the uniformly distributed loads as provided in the applicable tables:

User Note: The Joist Substitutes, K-Series, are standardized as 2.5 inch (64 mm) deep sections for spans up through 10'-0" (3048 mm).

- LRFD Simple Span Load Table for 2.5 Inch K-Series Joist Substitutes – U.S. Customary Units
- ASD Simple Span Load Table for 2.5 Inch K-Series Joist Substitutes – U.S. Customary Units
- LRFD Simple Span Load Table for 64 mm K-Series Joist Substitutes – S.I. Units
- ASD Simple Span Load Table for 64 mm K-Series Joist Substitutes – S.I. Units

- LRFD Outriggers Load Table for 2.5 Inch K-Series Joist Substitutes – U.S. Customary Units
- ASD Outriggers Load Table for 2.5 Inch K-Series Joist Substitutes – U.S. Customary Units
- LRFD Outriggers Load Table for 64 mm K-Series Joist Substitutes – S.I. Units
- ASD Outriggers Load Table for 64 mm K-Series Joist Substitutes – S.I. Units

A Top Chord Extension or Extended End, K-series, shall be a joist accessory that shall be designed in accordance with this Specification to support uniform loads when one or both ends of an underslung joist needs to be cantilevered beyond its bearing seat.

User Note: The Top Chord Extensions and Extended Ends are standardized as an "S" Type (top chord angles extended only) and an "R" Type (top chord and bearing seat angles extended), respectively.

American National Standard SJI 100 - 2020

Standard designations for the “S” Type shall range from S1 to S12 for spans from 0'-6" to 4'-6" (152 to 1372 mm). Standard designations for the “R” Type shall range from R1 to R12 for spans from 0'-6" to 6'-0" (152 to 1829 mm). The maximum total safe uniformly distributed load-carrying capacity of either an “R” or “S” Type extension shall be 550 plf (8.02 kN/m) in ASD or 825 plf (12.03 kN/m) in LRFD. The “S” Type Top Chord Extensions and “R” Type Extended Ends listed in the following Standard Load Tables shall support the uniformly distributed loads as provided in the applicable tables:

LRFD Top Chord Extension Load Table (S Type) – U.S. Customary Units
 ASD Top Chord Extension Load Table (S Type) – U.S. Customary Units
 LRFD Top Chord Extension Load Table (R Type) – U.S. Customary Units
 ASD Top Chord Extension Load Table (R Type) – U.S. Customary Units
 LRFD Top Chord Extension Load Table (S Type) – S.I. Units
 ASD Top Chord Extension Load Table (S Type) – S.I. Units
 LRFD Top Chord Extension Load Table (R Type) – S.I. Units
 ASD Top Chord Extension Load Table (R Type) – S.I. Units

1.5 STRUCTURAL DESIGN DRAWINGS AND SPECIFICATIONS

The structural design drawings and specifications shall meet the requirements in the *Code of Standard Practice for Steel Joists and Joist Girders*, except for deviations specifically identified in the design drawings and/or specifications.

SECTION 2. **REFERENCED SPECIFICATIONS, CODES AND STANDARDS**

2.1 REFERENCES

The standards listed below shall be considered as part of the requirements of this Specification. Where conflicts occur between this Specification and a referenced standard, the provisions of this Specification shall take precedence unless otherwise stated. This section lists the standards that are referenced in this Specification. The standards are listed in alphabetical order by name of standards developer organization, with the specific standard designations, title and dates of each of the referenced standards below.

American Institute of Steel Construction, Inc. (AISC), Chicago, IL

ANSI/AISC 360-10 *Specification for Structural Steel Buildings*

American Iron and Steel Institute (AISI), Washington, DC

ANSI/AISI S100-2012 *North American Specification for the Design of Cold-Formed Steel Structural Members*

American Society of Civil Engineers (ASCE), Reston, VA

SEI/ASCE 7-10 *Minimum Design Loads for Buildings and Other Structures*

American Society of Testing and Materials, ASTM International (ASTM), West Conshohocken, PA

ASTM A6/A6M-13A, *Standard Specification for General Requirements for Rolled Structural Steel Bars, Plates, Shapes, and Sheet Piling*

American National Standard SJI 100 - 2020

- ASTM A36/A36M-12, *Standard Specification for Carbon Structural Steel*
- ASTM A242/242M-13, *Standard Specification for High-Strength Low-Alloy Structural Steel*
- ASTM A307-12a, *Standard Specification for Carbon Steel Bolts and Studs, 60 000 PSI Tensile Strength*
- ASTM A325/325M-13, *Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi [830 MPa] Minimum Tensile Strength*
- ASTM A370-12a, *Standard Test Methods and Definitions for Mechanical Testing of Steel Products*
- ASTM A500/A500M-13, *Standard Specification for Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes*
- ASTM A501-07 *Standard Specification for Hot-Formed Welded and Seamless Carbon Steel Structural Tubing* ASTM A529/A529M-05(2009), *Standard Specification for High-Strength Carbon-Manganese Steel of Structural Quality* ASTM A572/A572M-13a, *Standard Specification for High-Strength Low-Alloy Columbium-Vanadium Structural Steel*
- ASTM A588/A588M-10, *Standard Specification for High-Strength Low-Alloy Structural Steel, up to 50 ksi [345 MPa] Minimum Yield Point, with Atmospheric Corrosion Resistance*
- ASTM A606/A606M-09a, *Standard Specification for Steel, Sheet and Strip, High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, with Improved Atmospheric Corrosion Resistance*
- ASTM A992/A992M-11, *Standard Specification for Structural Steel Shapes*
- ASTM A1008/A1008M-13, *Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy and High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable*
- ASTM A1011/A1011M-13, *Standard Specification for Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength*
- ASTM A1065/A1065M-09(2014) *Standard Specification for Cold-Formed Electric-Fusion (ARC) Welded High-Strength Low-Alloy Structural Tubing in Shapes with 50 ksi (345 MPA) Minimum Yield Point*
- ASTM A1085-13 *Standard Specification for Cold-Formed Welded Carbon Steel Hollow Structural Sections (HSS)*

American Welding Society (AWS), Miami, FL

- AWS A5.1/A5.1M-2012, *Specification for Carbon Steel Electrodes for Shielded Metal Arc Welding*
- AWS A5.5/A5.5M:2006, *Specification for Low-Alloy Steel Electrodes for Shielded Metal Arc Welding*
- AWS A5.17/A5.17M-97:R2007, *Specification for Carbon Steel Electrodes and Fluxes for Submerged Arc Welding*
- AWS A5.18/A5.18M:2005, *Specification for Carbon Steel Electrodes and Rods for Gas Shielded Arc Welding*
- AWS A5.20/A5.20M:2005, *Specification for Carbon Steel Electrodes for Flux Cored Arc Welding*
- AWS A5.23/A5.23M:2011, *Specification for Low-Alloy Steel Electrodes and Fluxes for Submerged Arc Welding*
- AWS A5.28/A5.28M:2005, *Specification for Low-Alloy Steel Electrodes and Rods for Gas Shielded Arc Welding*
- AWS A5.29/A5.29M:2010, *Specification for Low-Alloy Steel Electrodes for Flux Cored Arc Welding*
- AWS D1.1/D1.1M:2015, *Structural Welding Code - Steel*
- AWS D1.3/D1.3M:2008, *Structural Welding Code Sheet Steel*

American National Standard SJI 100 - 2020

User Note: The following informative references provide practical guidance in the use and application of this Specification:

Code of Federal Regulations (CFR), Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R - Steel Erection; January 18, 2001, Washington, D.C.

Steel Joist Institute (SJI), Florence, SC

SJI-COSP-2015, *Code of Standard Practice for Steel Joists and Joist Girders*

Technical Digest No. 3 (2007), *Structural Design of Steel Joist Roofs to Resist Ponding Loads*

Technical Digest No. 5 (2015), *Vibration of Steel Joist-Concrete Slab Floors*

Technical Digest No. 6 (2012), *Structural Design of Steel Joist Roofs to Resist Uplift Loads*

Technical Digest No. 8 (2008), *Welding of Open Web Steel Joists and Joist Girders*

Technical Digest No. 9 (2008), *Handling and Erection of Steel Joists and Joist Girders*

Technical Digest No. 10 (2003), *Design of Fire Resistive Assemblies with Steel Joists*

Technical Digest No. 11 (2007), *Design of Lateral Load Resisting Frames Using Steel Joists and Joist Girders*

Technical Digest No. 12 (2007), *Evaluation and Modification of Open-Web Steel Joists and Joist Girders*

The Society for Protective Coatings (SSPC), *Steel Structures Painting Manual, Volume 2, Systems and Specifications*, Paint Specification No. 15, Steel Joist Shop Primer, May 1, 1999, Pittsburgh, PA.

Van Malssen, S.H. (1984), *The Effects of Arc Strikes on Steel Used in Nuclear Construction*, Welding Journal, American Welding Society, Miami, FL, July 1984.

SECTION 3. MATERIALS

3.1 STEEL

The steel used in the manufacture of Joist Girders and K-Series, LH-Series, and DLH-Series joists shall conform to one of the following ASTM specifications:

ASTM A36/A36M, Carbon Structural Steel

ASTM A242/A242M, High-Strength Low-Alloy Structural Steel

ASTM A500/A500M, Cold-Formed Welded and Seamless Carbon Steel Structural Tubing in Rounds and Shapes

ASTM A529/A529M, High-Strength Carbon-Manganese Steel of Structural Quality

ASTM A572/A572M, High-Strength Low-Alloy Columbium-Vanadium Structural Steel

ASTM A588/A588M, High-Strength Low-Alloy Structural Steel up to 50 ksi [345 MPa] Minimum Yield Point with Atmospheric Corrosion Resistance

ASTM A606/A606M, Steel, Sheet and Strip, High-Strength, Low-Alloy, Hot-Rolled and Cold-Rolled, with Improved Atmospheric Corrosion Resistance

ASTM A992/A992M, Structural Steel Shapes

ASTM A1008/A1008M, Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Solution Hardened, and Bake Hardenable

American National Standard SJI 100 - 2020

ASTM A1011/A1011M, Steel, Sheet and Strip, Hot-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, and Ultra-High Strength

ASTM A1018/A1018M, Steel, Sheet and Strip, Heavy Thickness Coils, Hot Rolled, Carbon, Structural, High-Strength Low-Alloy, Columbium or Vanadium, and High-Strength Low-Alloy with Improved Formability and Ultra-High Strength

EXCEPTION: Steel used in the manufacture of Joist Girders and K-Series, LH-Series, and DLH-Series joists shall be permitted to be of suitable quality ordered or produced to other than the listed ASTM specifications, provided that such material in the state used for final assembly and manufacture is weldable and is proven by tests performed by the producer or manufacturer to have properties, in accordance with Section 3.2.

3.2 MECHANICAL PROPERTIES

3.2.1 Minimum Yield Strength: Steel used for Joist Girders and K-Series, LH-Series, and DLH-Series joists shall have a minimum yield strength determined in accordance with one of the procedures specified in this section, which is equal to the yield strength assumed in the design.

User note: The term "Yield Strength" as used herein designates the yield level of a material as determined by the applicable method outlined in paragraph 13.1 "Yield Point", and in paragraph 13.2 "Yield Strength", of ASTM A370, *Standard Test Methods and Definitions for Mechanical Testing of Steel Products*, or as specified in Section 3.2.3.

Evidence that the steel furnished meets or exceeds the design yield strength shall, if requested, be provided in the form of an affidavit or by witnessed or certified test reports.

For material used without consideration of increase in yield strength resulting from cold forming, the specimens shall be taken from as-rolled material. In the case of such material, the mechanical properties of which conform to the requirements of one of the listed ASTM specifications in Section 3.1, the test specimens and procedures shall conform to those of the applicable ASTM specification and to ASTM A370.

3.2.2 Other Materials: For materials where the mechanical properties do not conform to the requirements of one of the ASTM specifications listed in Section 3.1, these materials shall conform to the following requirements:

- a) The specimens shall comply with ASTM A370,
- b) The specimens shall exhibit a yield strength equal to or exceeding the design yield strength,
- c) The specimens shall have an elongation of not less than 20 percent in 2 inches (51 mm) for sheet strip, or 18 percent in 8 inches (203 mm) for plates, shapes and bars with adjustments for thickness for plates, shapes and bars as prescribed in either ASTM A36/A36M, A242/A242M, A500/A500M, A529/A529M, A572/A572M, A588/A588M, or A992/A992M, whichever ASTM specification is applicable, on the basis of design yield strength.
- d) The number of tests for a), b), and c) above shall be as prescribed in ASTM A6/A6M for plates, shapes, and bars; and ASTM A606/A606M, A1008/A1008M and A1011/A1011M for sheet and strip.

3.2.3 As-Formed Strength: If as-formed strength is utilized, the test reports shall show the results of tests performed on full section specimens in accordance with the provisions of the AISI S100. The reports shall also indicate compliance with the following additional requirements:

- a) The yield strength calculated from the test data shall equal or exceed the design yield strength.
- b) Where tension tests are made for acceptance and control purposes, the tensile strength shall be at least 8 percent greater than the yield strength of the section.
- c) Where compression tests are used for acceptance and control purposes, the specimen shall withstand a gross shortening of 2 percent of its original length without cracking. The length of the specimen shall be not greater than 20 times the least radius of gyration.
- d) If any test specimen fails to pass the requirements of the subparagraphs (a), (b), or (c) above, as applicable, two retests shall be made of specimens from the same lot. Failure of one of the retest specimens to meet such requirements shall be the cause for rejection of the lot represented by the specimens.

American National Standard SJI 100 - 2020

3.3 WELDING ELECTRODES

3.3.1 Welding Electrodes: The welding electrodes used for arc welding shall be in accordance with the following:

- a) For connected members both having a specified minimum yield strength greater than 36 ksi (250 MPa), one of the following electrodes shall be used:

AWS A5.1:	E70XX
AWS A5.5:	E70XX-X
AWS A5.17:	F7XX-EXXX, F7XX-ECXXX flux electrode combination
AWS A5.18:	ER70S-X, E70C-XC, E70C-XM
AWS A5.20:	E7XT-X, E7XT-XM
AWS A5.23:	F7XX-EXXX-XX, F7XX-ECXXX-XX
AWS A5.28:	ER70S-XXX, E70C-XXX
AWS A5.29:	E7XTX-X, E7XTX-XM

- b) For connected members both having a specified minimum yield strength of 36 ksi (250 MPa) or one having a specified minimum yield strength of 36 ksi (250 MPa), and the other having a specified minimum yield strength greater than 36 ksi (250 MPa), one of the following electrodes shall be used:

AWS A5.1:	E60XX
AWS A5.17:	F6XX-EXXX, F6XX-ECXXX flux electrode combination
AWS A5.20:	E6XT-X, E6XT-XM
AWS A5.29:	E6XTX-X, E6XTX-XM

or any of those listed in Section 3.3.1(a).

3.3.2 Other Welding Methods: Other welding methods, providing equivalent strength as demonstrated by tests, shall be permitted to be used.

3.4 PAINT

The standard shop paint shall be considered an impermanent and provisional coating.

User Note: The standard shop paint is intended to protect the steel for only a short period of exposure in ordinary atmospheric conditions.

When specified, the standard shop paint shall conform to one of the following:

- The Society for Protective Coatings, SSPC Paint Specification No. 15.
- Or, shall be a shop paint which meets the minimum performance requirements of SSPC Paint Specification No. 15.

SECTION 4.**DESIGN AND MANUFACTURE****4.1 METHOD**

Joist Girders support steel joists or other secondary members and shall be designed in accordance with this Specification as simply-supported primary load-carrying members for in-plane loading. Steel joists shall be designed in accordance with this Specification as simply-supported trusses supporting a floor or roof deck so constructed as to brace the top chord of the steel joists against lateral buckling. Where any applicable design feature is not specifically covered herein, the design shall be in accordance with the following Specifications:

- Where the steel used consists of hot-rolled shapes, bars or plates, AISC 360.
- For members which are cold-formed from sheet or strip steel, AISI S100.

American National Standard SJI 100 - 2020

4.1.1 Design Basis:

Steel joist and Joist Girder designs shall be in accordance with the provisions in this Specification using Load and Resistance Factor Design (LRFD) or Allowable Strength Design (ASD) as specified by the specifying professional for the project.

4.1.2 Loads, Forces and Load Combinations:

The loads and forces used for the steel joist and Joist Girder design shall be calculated by the specifying professional in accordance with the applicable building code and specified and provided on the structural drawings.

For nominal concentrated loads, which have been accounted for in the specified uniform loads, the addition of chord bending moments or an added shop or field web member due to these nominal concentrated loads shall not be required provided that the sum of the concentrated loads within a chord panel does not exceed 100 pounds and the attachments are concentric to the chord. When exact dimensional locations for concentrated loads which do not meet the above criteria are provided by the specifying professional, the joist shall be designed for the loads and load locations provided without the need for additional field applied web members at the specified locations.

The load combinations shall be specified by the specifying professional on the structural drawings in accordance with the applicable building code. In the absence of an applicable building code, the load combinations shall be those stipulated in SEI/ASCE 7 Section 2.3 and Section 2.4 as appropriate. For LRFD designs, the load combinations in SEI/ASCE 7, Section 2.3 shall apply. For ASD designs, the load combinations in SEI/ASCE 7, Section 2.4 shall apply.

4.2 DESIGN AND ALLOWABLE STRESSES

4.2.1 Design Using Load and Resistance Factor Design (LRFD)

Joists and Joist Girders shall have their components so proportioned that the required stresses, f_u , shall not exceed ϕF_n where

f_u	= required stress	ksi (MPa)
F_n	= nominal stress	ksi (MPa)
ϕ	= resistance factor	
ϕF_n	= design stress	ksi (MPa)

4.2.2 Design Using Allowable Strength Design (ASD)

Joists and Joist Girders shall have their components so proportioned that the required stresses, f , shall not exceed F_n / Ω where

f	= required stress	ksi (MPa)
F_n	= nominal stress	ksi (MPa)
Ω	= safety factor	
F_n / Ω	= allowable stress	ksi (MPa)

4.2.3 Stresses:

The calculation of design stress or allowable stress for chords shall be based on a yield strength, F_y , of the material used in manufacturing equal to 50 ksi (345 MPa). The calculation of design stress or allowable stress for all other joist elements shall be based on a yield strength, F_y , of the material used in manufacturing, but shall not be less than 36 ksi (250 MPa) nor greater than 50 ksi (345 MPa). Yield strengths greater than 50 ksi shall not be used for the design of any members.

4.2.3.1 Tension: $\phi_t = 0.90$ (LRFD), $\Omega_t = 1.67$ (ASD)

$$\text{Design Stress} = 0.9F_y \text{ (LRFD)} \tag{4.2-1}$$

$$\text{Allowable Stress} = 0.6F_y \text{ (ASD)} \tag{4.2-2}$$

American National Standard SJI 100 - 2020

4.2.3.2 Compression: $\phi_c = 0.90$ (LRFD), $\Omega_c = 1.67$ (ASD)

$$\text{Design Stress} = 0.9F_{cr} \text{ (LRFD)} \quad (4.2-3)$$

$$\text{Allowable Stress} = 0.6F_{cr} \text{ (ASD)} \quad (4.2-4)$$

Where:

For members with $k\ell/r \leq 4.71\sqrt{E/QF_y}$

$$F_{cr} = Q \left[0.658^{\left(\frac{QF_y}{F_e} \right)} \right] F_y \quad (4.2-5)$$

For members with $k\ell/r > 4.71\sqrt{E/QF_y}$

$$F_{cr} = 0.877F_e \quad (4.2-6)$$

Where F_e = Elastic buckling stress determined in accordance with Equation 4.2-7

$$F_e = \frac{\pi^2 E}{\left(\frac{k\ell}{r} \right)^2} \quad (4.2-7)$$

In the above equations, ℓ is the length, k is the effective length factor, and r is the corresponding radius of gyration of the member as defined in Section 4.3. E is equal to 29,000 ksi (200,000 MPa).

For hot-rolled sections and cold-formed angles, Q shall be taken as the full reduction factor for slender compression members as determined in accordance with AISI 360-10.

Exception: Where a compression web member is a crimped-end angle member intersecting at the first bottom chord panel point, whether hot-rolled or cold-formed, then Q shall be determined as follows:

$$Q = [5.25/(w/t)] + t \leq 1.0 \quad (4.2-8a)$$

Where: w = angle leg length, inches
 t = angle leg thickness, inches

or,

$$Q = [5.25/(w/t)] + (t/25.4) \leq 1.0 \quad (4.2-8b)$$

Where: w = angle leg length, millimeters
 t = angle leg thickness, millimeters

For all other cold-formed sections the method of calculating the nominal compression strength shall be in accordance with AISI S100.

4.2.3.3 Bending: $\phi_b = 0.90$ (LRFD), $\Omega_b = 1.67$ (ASD)

Bending calculations shall be based on the elastic section modulus.

American National Standard SJI 100 - 2020

For chords and web members other than solid rounds: $F_n = F_y$

$$\text{Design Stress} = \phi_b F_n = 0.9F_y \text{ (LRFD)} \quad (4.2-9)$$

$$\text{Allowable Stress} = F_n/\Omega_b = 0.6F_y \text{ (ASD)} \quad (4.2-10)$$

For web members of solid round cross section: $F_n = 1.6 F_y$

$$\text{Design Stress} = \phi_b F_n = 1.45F_y \text{ (LRFD)} \quad (4.2-11)$$

$$\text{Allowable Stress} = F_n/\Omega_b = 0.95F_y \text{ (ASD)} \quad (4.2-12)$$

For bearing plates used in joist seats: $F_n = 1.5 F_y$

$$\text{Design Stress} = \phi_b F_n = 1.35F_y \text{ (LRFD)} \quad (4.2-13)$$

$$\text{Allowable Stress} = F_n/\Omega_b = 0.90F_y \text{ (ASD)} \quad (4.2-14)$$

4.2.3.4 Weld Strength:

Shear at throat of fillet welds, flare bevel groove welds, partial joint penetration groove welds, and plug/slot welds shall be determined as follows:

$$\text{Nominal Shear Stress} = F_{nw} = 0.6F_{exx} \quad (4.2-15)$$

LRFD: $\phi_w = 0.75$

$$\text{Design Shear Strength} = \phi R_n = \phi_w F_{nw} A = 0.45F_{exx} A_w \quad (4.2-16)$$

ASD: $\Omega_w = 2.0$

$$\text{Allowable Shear Strength} = R_n/\Omega_w = F_{nw} A/\Omega_w = 0.3F_{exx} A_w \quad (4.2-17)$$

Where:

F_{exx} is determined as follows:

E70 series electrodes or F7XX-EXXX flux-electrode combinations $F_{exx} = 70 \text{ ksi (483 MPa)}$

E60 series electrodes or F6XX-EXXX flux-electrode combinations $F_{exx} = 60 \text{ ksi (414 MPa)}$

A_w = effective throat area, where:

For fillet welds, A_w = effective throat area

Other design methods demonstrated to provide sufficient strength by testing shall be permitted to be used.

For flare bevel groove welds, the effective weld area is based on a weld throat width, T, where:

$$T \text{ (inches)} = 0.12D + 0.11 \quad (4.2-18a)$$

Where D = web diameter, inches

or,

$$T \text{ (mm)} = 0.12D + 2.8 \quad (4.2-18b)$$

Where D = web diameter, mm

For plug/slot welds, A_w = cross-sectional area of the hole or slot in the plane of the faying surface provided that the hole or slot meets the requirements of AISC 360.

User Note: For more on plugs/slot welds see Steel Joist Institute Technical Digest No. 8, "Welding of Open-Web Steel Joists and Joist Girders".

American National Standard SJI 100 - 2020

Strength of resistance welds and complete-joint-penetration groove or butt welds in tension or compression (only where the stress is normal to the weld axis) shall be equal to the base metal strength:

$$\phi_t = \phi_c = 0.90 \text{ (LRFD)} \quad \Omega_t = \Omega_c = 1.67 \text{ (ASD)}$$

$$\text{Design Stress} = 0.9 F_y \text{ (LRFD)} \quad (4.2-19)$$

$$\text{Allowable Stress} = 0.6 F_y \text{ (ASD)} \quad (4.2-20)$$

4.3 MAXIMUM SLENDERNESS RATIOS

The slenderness ratios, $1.0\ell/r$ and $1.0\ell_s/r$ of members as a whole or any component part shall not exceed the values given in Table 4.3-1, Part A.

4.3.1 Effective Slenderness Ratios: The effective slenderness ratio, $k\ell/r$ to be used in calculating the nominal stresses, F_{cr} and F'_e , is the largest value as determined from Table 4.3-1, Part B and Part C, and modified where required with equation 4.3-1. The effective length k shall be taken as 1.0 for all components in Joist Girders.

4.3.2 Compressive Members: In compression members where fillers or ties are used, they shall be spaced so that the ℓ_s/r_z ratio of each component does not exceed the governing ℓ/r ratio of the member as a whole. The terms used in Table 4.3-1 shall be defined as follows:

- ℓ = length center-to-center of panel points, except $\ell = 36$ inches (914 millimeters) for calculating ℓ/r_y of the top chord member for joists, and for Joist Girders this distance shall be the unbraced length between joists which are positively attached to the top chord, in. (mm).
- ℓ_s = maximum length center-to-center between panel point and filler (tie), or between adjacent fillers (ties), in. (mm).
- r_x = member radius of gyration about the horizontal axis of the joist or Joist Girder cross section, in. (mm).
- r_y = member radius of gyration about the vertical axis of the joist or Joist Girder cross section, in. (mm).
- r_z = least radius of gyration of a member component, in. (mm).

Compression web members shall be those web members subject to compressive axial loads under gravity loading.

4.3.3 Tension Members: Tension web members shall be those web members subject to tension axial loads under gravity loading, and which shall be permitted to be subject to compressive axial loads under alternate loading conditions

User Note: An example of a non-gravity alternate loading condition is net uplift.

4.3.4 Top Chords: For top chords, the end panel(s) shall be the panels between the bearing seat and the first primary interior panel point comprised of at least two intersecting web members.

American National Standard SJI 100 - 2020

4.3.5 Built-Up Web Members: For built-up web members composed of two interconnected shapes, where $\ell_s/r_z > 40$,

a modified slenderness ratio $\left(\frac{k\ell}{r_y}\right)_m$ shall replace $\frac{k\ell}{r_y}$ in equations 4.2-5, 4.2-6, and 4.2-7, where:

$$\left(\frac{k\ell}{r_y}\right)_m = \sqrt{\left(\frac{k\ell}{r_y}\right)^2 + \left(\frac{k_i\ell_s}{r_z}\right)^2} \quad (4.3-1)$$

and,

$$\begin{aligned} k_i &= 0.50 \text{ for angles back-to-back} \\ &= 0.75 \text{ for channels back-to-back} \end{aligned}$$

American National Standard SJI 100 - 2020

TABLE 4.3-1

MAXIMUM AND EFFECTIVE SLENDERNESS RATIOS¹

Description		$k\ell/r_x$	$k\ell/r_y$	$k\ell/r_z$	$k\ell_s/r_z$
I. TOP CHORD INTERIOR PANELS					
A.	The slenderness ratios, $1.0\ell/r$ and $1.0\ell_s/r$, of members as a whole or any component part shall not exceed 90.				
B.	The effective slenderness ratio for joists, $k\ell/r$, to determine F_{cr} where k is:				
1.	Two shapes with fillers or ties	0.75	0.94	---	1.0
2.	Two shapes without fillers or ties	---	---	0.75	---
3.	Single component members	0.75	0.94	---	---
C.	For bending, the effective slenderness ratio, $k\ell/r$, to determine F'_e where k is:				
		0.75	---	---	---
II. TOP CHORD END PANELS					
A.	The slenderness ratios, $1.0\ell/r$ and $1.0\ell_s/r$, of members as a whole or any component part shall not exceed 120.				
B.	The effective slenderness ratio for joists, $k\ell/r$, to determine F_{cr} where k is:				
1.	Two shapes with fillers or ties	1.0	0.94	---	1.0
2.	Two shapes without fillers or ties	---	---	1.0	---
3.	Single component members	1.0	0.94	---	---
C.	For bending, the effective slenderness ratio, $k\ell/r$, to determine F'_e where k is:				
		1.0	---	---	---
III. ALL BOTTOM CHORD PANELS					
A.	The slenderness ratios, $1.0\ell/r$ and $1.0\ell_s/r$, of members as a whole or any component part shall not exceed 240.				
B.	For members subject to compression, the effective slenderness ratio for joists, $k\ell/r$, to determine F_{cr} where k is:				
1.	Two shapes with fillers or ties	0.9	0.94	---	1.0
2.	Two shapes without fillers or ties	---	---	0.9	---
3.	Single component members	0.9	0.94	---	---
C.	For bending, the effective slenderness ratio, $k\ell/r$, to determine F'_e where k is:				
		0.9	---	---	---
IV. WEB MEMBERS					
A.	The slenderness ratios, $1.0\ell/r$ and $1.0\ell_s/r$, of members as a whole or any component part shall not exceed 240 for a tension member or 200 for a compression member.				
B.	For members subject to compression, the effective slenderness ratio for joists, $k\ell/r$, to determine F_{cr} where k is:				
1.	Two shapes with fillers or ties	0.75	1.0	---	1.0
2.	Two shapes without fillers or ties	---	---	1.0	---
3.	Single component members	0.75	0.9*	---	---
	*For end tension web members subject to compression, k shall equal 0.8				
(1) The effective length k shall equal 1.0 for all components of Joist Girders.					

American National Standard SJI 100 - 2020

4.4 MEMBERS

4.4.1 Chords

The joist and Joist Girder bottom chord shall be designed as an axially loaded tension member.

For Joist Girders, the radius of gyration of the bottom chord about its vertical axis shall not be less than $\ell/240$ where ℓ is the distance between lines of bracing. The radius of gyration of a Joist Girder top chord about the vertical axis shall not be less than $\text{Span}/575$.

For steel joists, the radius of gyration of the top chord about its vertical axis shall not be less than the results of equation 4.4-1 or 4.4-2:

$$r_y \geq \ell_{br} / \left(124 + 0.67 d_j + 28 \frac{d_j}{L} \right), \text{ in.} \quad (4.4-1a)$$

$$r_y \geq \ell_{br} / \left(124 + 0.026 d_j + 0.34 \frac{d_j}{L} \right), \text{ mm} \quad (4.4-1b)$$

or,

$$r_y \geq \ell_{br} / 170 \quad (4.4-2)$$

Where:

d_j is the steel joist depth, in. (mm)

L is the joist span length, ft. (m)

r_y is the radius of gyration of the top chord about the vertical axis of the joist cross section, in. (mm)

ℓ_{br} is the spacing in inches (millimeters) between lines of bracing as specified in Section 5.5.3.1.

A steel joist top chord shall be considered as laterally braced by the floor slab or roof deck provided the requirements of Section 5.9 are met.

A Joist Girder top chord shall be considered as laterally braced by the steel joists provided positive attachment is made. The outstanding part of the top chord member shall be designed such that the allowable reaction from a single joist shall not exceed equation 4.4-3 or 4.4-4:

$$\phi P_p \text{ and } \phi P_p (1.6 - f_{au}/\phi Q F_y) \quad (\text{LRFD, } \phi = 0.9) \quad (4.4-3)$$

$$P_p/\Omega \text{ and } P_p/\Omega (1.6 - \Omega f_{au}/Q F_y) \quad (\text{ASD, } \Omega = 1.67) \quad (4.4-4)$$

Where:

F_y = Specified minimum yield strength, ksi (MPa)

P_p = Plastic failure mode = $[(t^2 F_y) / [2(b-k)]] [g + 5.66(b-k)]$, kips (N)

Q = Form factor defined in Section 4.2.3.2

b = width of the outstanding part of the top chord member, in. (mm)

f_{au} = P_u/A = Required compressive stress, ksi (MPa)

f_a = P/A = Required compressive stress, ksi (MPa)

g = width of bearing seat, in. (mm)

k = value from angle properties or similar dimension for other members, in (mm)

t = thickness of the outstanding part of the top chord member, in. (mm)

The top chord of a steel joist or Joist Girder shall be designed as a continuous member subject to combined axial and bending stresses, except a Joist Girder loaded only at panel points shall be designed as an axial loaded compression member. For combined stresses the top chord shall be so proportioned that:



American National Standard SJI 100 - 2020

For LRFD:

at the panel point:

$$f_{au} + f_{bu} \leq 0.9F_y \quad (4.4-5)$$

at the mid panel:

$$\text{for, } \frac{f_{au}}{\phi_c F_{cr}} \geq 0.2,$$

$$\frac{f_{au}}{\phi_c F_{cr}} + \frac{8}{9} \left[\frac{C_m f_{bu}}{\left[1 - \left(\frac{f_{au}}{\phi_c F'_e} \right) \right] Q \phi_b F_y} \right] \leq 1.0 \quad (4.4-6)$$

$$\text{for, } \frac{f_{au}}{\phi_c F_{cr}} < 0.2,$$

$$\frac{f_{au}}{2\phi_c F_{cr}} + \left[\frac{C_m f_{bu}}{\left[1 - \left(\frac{f_{au}}{\phi_c F'_e} \right) \right] Q \phi_b F_y} \right] \leq 1.0 \quad (4.4-7)$$

f_{au} = P_u/A = Required compressive stress using LRFD load combinations, ksi (MPa)

P_u = Required axial strength using LRFD load combinations, kips (N)

A = Area of the top chord, in.² (mm²)

f_{bu} = M_u/S = Required bending stress at the location under consideration using LRFD load combinations, ksi (MPa)

M_u = Required flexural strength using LRFD load combinations, kip-in. (N-mm)

S = Elastic Section Modulus, in.³ (mm³)

F_{cr} = Nominal axial compressive stress in ksi (MPa) based on $k\ell/r$ as defined in Section 4.3

C_m = $1 - 0.3 f_{au}/\phi_c F'_e$ for end panels

C_m = $1 - 0.4 f_{au}/\phi_c F'_e$ for interior panels

Q = Form factor defined in Section 4.2.3.2

ϕ_c = Resistance factor for compression = 0.9

ϕ_b = Resistance factor for flexure = 0.9

F_y = Specified minimum yield strength, ksi (MPa)

$$F'_e = \frac{\pi^2 E}{(k\ell/r_x)^2}, \text{ ksi (MPa),}$$

where ℓ is the length, k is the effective length factor, and r_x is the corresponding radius of gyration of the member as defined in Section 4.3

E = Modulus of elasticity, 29,000 ksi (200,000 MPa)

American National Standard SJI 100 - 2020

For **ASD**:

at the panel point:

$$f_a + f_b \leq 0.6F_y \quad (4.4-8)$$

at the mid panel:

for, $\frac{f_a}{F_a} \geq 0.2$,

$$\frac{f_a}{F_a} + \frac{8}{9} \left[\frac{C_m f_b}{\left[1 - \left(\frac{1.67f_a}{F'_e} \right) \right] QF_b} \right] \leq 1.0 \quad (4.4-9)$$

for $\frac{f_a}{F_a} < 0.2$,

$$\left(\frac{f_a}{2F_a} \right) + \left[\frac{C_m f_b}{\left[1 - \left(\frac{1.67f_a}{F'_e} \right) \right] QF_b} \right] \leq 1.0 \quad (4.4-10)$$

- f_a = P/A required compressive stress using ASD load combinations, ksi (MPa)
- A = Area of the top chord, in.² (mm²)
- P = Required axial strength using ASD load combinations, kips (N)
- f_b = M/S = required bending stress at the location under consideration using ASD load combinations, ksi (MPa)
- S = Elastic Section Modulus, in.³ (mm³)
- M = Required flexural strength using ASD load combinations, k-in. (N-mm)
- F_a = Allowable axial compressive stress based on $k\ell/r$ as defined in Section 4.3; $0.6F_{cr}$, ksi (MPa)
- F_b = Allowable bending stress; $0.6F_y$, ksi (MPa)
- C_m = $1 - 0.50 f_a/F'_e$ for end panels
- C_m = $1 - 0.67 f_a/F'_e$ for interior panels
- Q = Form factor defined in Section 4.2.3.2
- $F'_e = \frac{\pi^2 E}{(k\ell/r_x)^2}$, ksi (MPa),
where ℓ is the length, k is the effective length factor, and r_x is the corresponding radius of gyration of the member as defined in Section 4.3
- E = Modulus of elasticity, 29,000 ksi (200,000 MPa)

American National Standard SJI 100 - 2020

The top chord and bottom chord shall be designed such that at each joint complies with equation 4.4-11 or 4.4-12:

$$f_{vmod} \leq \phi_v F_n \quad (\text{LRFD, } \phi_v = 1.00) \quad (4.4-11)$$

$$f_{vmod} \leq F_n / \Omega_v \quad (\text{ASD, } \Omega_v = 1.50) \quad (4.4-12)$$

F_n = nominal shear stress = $0.6F_y$, ksi (MPa)

f_t = axial stress = P/A , ksi (MPa)

f_v = shear stress = V/bt , ksi (MPa)

f_{vmod} = modified shear stress = $(1/2)\sqrt{f_t^2 + 4f_v^2}$

b = length of vertical part(s) of cross section, in. (mm)

t = thickness of vertical part(s) of cross section, in. (mm)

It shall not be necessary to design the top chord and bottom chord for the modified shear stress, f_{vmod} , where a round bar web member is continuous through a joint. The minimum required shear of section 4.4.2 (25 percent of the maximum end reaction) shall not be required when evaluating Equation 4.4-11 or 4.4-12.

KCS Joist, K-Series, chords shall be designed for a flat positive bending moment envelope where the moment capacity is constant at all interior panels. The top chord end panel(s) shall be designed for an axial load based on the force in the first tension web resulting from the specified shear. A uniform load of 550 plf (8.02 kN/m) in ASD or 825 plf (12.03 kN/m) in LRFD shall be used to check bending in the end panel(s). The top chord interior panels shall be designed for an axial stress resulting from the constant moment capacity plus the bending stress. The bending stress shall be determined from the smaller uniform load derived from the constant moment and constant shear, not to exceed 550 plf (ASD) or 825 plf (LRFD). The constant moment and shear shall be those values as listed in the Standard Load Table for KCS Steel Joists.

4.4.2 Web

The vertical shears to be used in the design of the web members shall be determined by including all loads, but such vertical shears shall be not less than 25 percent of the maximum end reaction from the design load combinations.

4.4.2.1 Redundant Web Members: Redundant web members used in modified Warren type web systems shall be designed to resist the gravity loads supported by the member plus an additional axial load of $1/2$ of 1.0 percent of the top chord axial force. For a **Joist Girder**, this total axial load shall not be less than 2 percent of the top chord axial force.

4.4.2.2 Joist Girders: For Joist Girders, the tension web members shall be designed to resist at least 25 percent of their axial force in compression.

4.4.2.3 KCS Joist Web Forces: KCS Joist web forces shall be determined based on a flat shear envelope, and the following:

- a) All webs shall be designed for a vertical shear equal to the specified shear capacity.
- b) All webs shall be designed for 100 percent stress reversal except for the first tension web which remains in tension under all simple span gravity loads.

4.4.2.4 Single Component Web Member: In those cases where a single component web member is attached to the outside of the stem of a tee or double angle chord or any other orientation of a single web member which creates an out-of-plane moment, the web member design shall account for the stresses due to eccentricity.

American National Standard SJI 100 - 2020

4.4.2.4.1 Uncrimped Single Angle Web Members

For 1 inch uncrimped single angle web members where one leg is placed flat against one chord member in the gap, the resulting eccentricities and the effects in loading shall be considered in the design. A minimum of 50 percent of the required weld shall be deposited to each chord angle.

For angles subjected to tensile loading, the following requirements shall be met:

For **LRFD**: combined axial and bending stresses shall be proportioned in accordance with Eq. 4.4-5.

For **ASD**: combined axial and bending stresses shall be proportioned in accordance with Eq. 4.4-8.

For angles subjected to compression loading, the following requirements shall be met:

For **LRFD**:

at the panel point, combined axial and bending stresses shall be proportioned in accordance with Eq. 4.4-5.

at the mid length, the strength shall meet Eqs. 4.4-6 or 4.4-7, and 4.4-13:

$$\frac{f_{au}}{\phi_c F_{crz}} \leq 1.0 \quad (4.4-13)$$

where

f_{au} = P_u/A = Required tensile or compressive stress, ksi (MPa)

P_u = Required axial strength using LRFD load combinations, kips (N)

A = Area of the uncrimped angle web, in.², (mm²)

f_{bu} = M_u/S = required bending stress, ksi (MPa)

M_u = Required flexural strength = $0.5 P_u \left(\frac{\text{chord gap}}{2} - \bar{y} \right)$, kip-in. (N-mm)

S = Minimum Elastic Section Modulus, in.³ (mm³)

F_{cr} = F_{crx} , ksi (MPa)

F_{crx} = Nominal axial compressive stress in ksi (MPa) based on $k\ell/r_x$, where ℓ is the length, k is the effective length factor, and r_x is the corresponding radius of gyration of the member as defined in Section 4.3

F_{crz} = Nominal axial compressive stress in ksi (MPa) based on $k\ell/r_z$ where $k = 1.0$

C_m = 1.0

F_y = Specified minimum yield strength, ksi (MPa)

$F'_c = \frac{\pi^2 E}{(k\ell/r_x)^2}$, ksi (MPa)

Q = Form factor defined in Section 4.2.3.2

American National Standard SJI 100 - 2020

For **ASD**:

at the panel point, combined axial and bending stresses shall be proportioned in accordance with Eq. 4.4-8.

at the mid length the strength shall meet Eqs. 4.4-9 or 4.4-10, and 4.4-14:

$$\frac{f_a}{F_{az}} \leq 1.0 \quad (4.4-14)$$

where

f_a = P/A = Required tensile or compressive stress, ksi (MPa)

P = Required axial strength using ASD load combinations, kips (N)

A = Area of the uncrimped angle web, in.², (mm²)

f_b = M/S = required bending stress, ksi (MPa)

S = Minimum Elastic Section Modulus, in.³ (mm³)

M = Required flexural strength = $0.5 P \left(\frac{\text{chord gap}}{2} - \bar{y} \right)$, kip-in. (N-mm)

F_a = F_{ax} , ksi (MPa)

F_{ax} = Nominal axial compressive stress in ksi (MPa) based on $k\ell/r_x$, where ℓ is the length, k is the effective length factor, and r_x is the corresponding radius of gyration of the member as defined in Section 4.3

F_{az} = Nominal axial compressive stress in ksi (MPa) based on $K\ell/r_z$, where $k = 1.0$

F_b = Allowable bending stress; $0.6F_y$, ksi (MPa)

Alternate methods of design shall be permitted provided they provide strength equal to or greater than those given. Alternate design procedures shall be submitted to the Steel Joist Institute's consulting engineer for approval.

4.4.3 Fillers and Ties

Fillers or ties added on chord or web compression members shall be designed and connected for a force equal to 2 percent of the required member axial force.

4.4.4 Joist and Joist Girder Extensions

Joist and Joist Girder extensions shall be designated as one of three extension types, as follows: top chord extensions (TCX), extended ends, or full depth cantilevers.

Design criteria for joist extensions shall be specified using one of the following methods:

- A joist top chord extension (TCX), extended end, or full depth cantilevered end shall be designed for the load from the Standard Load Tables based on the design length and designation of the specified joist. In the absence of other design information, the joist manufacturer shall design the joist extension for this loading as a default.
- A loading diagram shall be provided for the joist extension, extended end, or full depth cantilevered end. The diagram shall include the magnitude and location of the loads to be supported, as well as the applicable load combinations.

American National Standard SJI 100 - 2020

- c) 2½" deep steel joist extensions shall be permitted to be specified using extension designations found in the Top Chord Extension Load Table (S Type) for TCXs or the Top Chord Extension Load Table (R Type) for extended ends.

Any deflection requirements or limits due to the accompanying loads and load combinations on the steel joist or Joist Girder extension shall be provided by the specifying professional, regardless of the method used to specify the extension. Unless otherwise specified, the joist manufacturer shall check the extension for the specified deflection limit under uniform live load acting simultaneously on both the joist base span and the extension.

The joist manufacturer shall consider the effects of steel joist or Joist Girder extension loading on the base span of the steel joist or Joist Girder. This shall include carrying the design bending moment due to the loading on the extension into the top chord end panel(s), and the effect on the overall steel joist or Joist Girder chord and web axial forces. In the case of a K-Series Standard Type 'R' Extended End or 'S' TCX, the design bending moment shall be determined by the tabulated extension section modulus (S) multiplied by the appropriate allowable (ASD) or design (LRFD) flexural stress.

Bracing of extensions shall be clearly indicated on the structural drawings.

4.5 CONNECTIONS

4.5.1 Methods

Member connections and splices shall be made by attaching the members to one another by arc or resistance welding or other accredited methods in accordance with the following:

- a) Steel joist and Joist Girder arc welded joints shall be in accordance with the American Welding Society, "Structural Welding Code-Steel", D1.1, and/or the "Structural Welding Code Sheet Steel", D1.3 with the following seven modified acceptance criteria as permitted by AWS D1.1 Clause 6.8:

- 1) Undercut shall not exceed 1/16 inch (2 mm) for welds oriented parallel to the principal stress.

User Note: The typical diagonal web member connection to one leg of a chord angle is considered to be parallel to the principal stress.

- 2) Discontinuities outside of the weld design length shall be permitted provided no cracks exist and undercut does not exceed the limits of item 1).

User Note: The weld design length is the minimum weld length needed for the connection force and weld thickness. Portions of the actual weld length with imperfections or discontinuities such as porosity or lack of a full profile are not included when comparing the actual weld length to the weld design length.

- 3) One unrepaired arc strike shall be permitted per joint provided it does not result in other unacceptable defects.

User Note: Minor arc strikes do not reduce the strength of AWS Group II materials (refer to Van Malssen, 1984).

- 4) The effective throat for flare bevel groove welds shall be calculated in accordance with equation 4.2-18.

User Note: The effective weld throat used by the SJI with round bars is based on SJI research and is more conservative than AWS D1.1 for GMAW for round bars in excess of 9/16" (14 mm). See Steel Joist Institute Technical Digest 8, "Welding of Open Web Steel Joists and Joist Girders".

American National Standard SJI 100 - 2020

- 5) Tack welds that are discontinuous from other welds shall meet the criteria for undercut, but shall be exempt from all other acceptance criteria.

User Note: Joist manufacturers use tack welds in the assembly process, and so long as they do not diminish the strength of the base metal and are not incorporated into the final weld for strength, they are not required to meet other inspection criteria.

- 6) The weld profile shall be considered acceptable provided neither the weld leg nor the weld throat is undersized less than AWS D1.1 limits within the weld design length.
- 7) For material with thickness less than 1/8", AWS D1.1 or D1.3 shall be considered appropriate.

User Note: AWS D1.1 does not address thicknesses less than 1/8" for hot rolled material and AWS D1.3 does not address hot rolled material, thus SJI has extended the ranges to include these material thicknesses.

- b) Steel joist and Joist Girder resistance welded joints shall follow a preproduction validation procedure and a production checking procedure and shall meet the strength requirements of this Specification.

User Note: Spot, flash or upset resistance welds should have a written welding procedure qualification record and a systematic quality plan. For further information, see Steel Joist Institute Technical Digest 8, "Welding of Open Web Steel Joists and Joist Girders".

- c) Welded Connections for Crimped-End Angle Web Members

- 1) The connection of each end of a crimped angle web member to each side of the chord shall consist of a weld group made of more than a single line of weld. The design weld length shall include an end return of no less than two times the nominal weld size.

- d) Welding Program

- 1) The manufacturer's welders shall be qualified in accordance with either AWS D1.1 or AWS D1.3 for the applicable weld type, position, and material.
- 2) Manufacturers shall have a program for establishing weld procedures and operator qualification, and for weld sampling and testing. Each manufacturing facility shall have trained inspectors, and an engineer responsible for all welding procedures.

- e) Weld Inspection by Outside Agencies (See Section 5.14)

- 1) The agency shall arrange for visual inspection to determine that welds meet the acceptance standards of Section 4.5.1.

User Note: Ultrasonic, X-ray, and magnetic particle testing are inappropriate for joists due to the configurations of the components and welds.

4.5.2 Strength

4.5.2.1 Joint Connections: Joint connections shall develop the maximum force due to any of the design loads, but not less than 50 percent of the strength of the member in tension or compression, whichever force is the controlling factor in the selection of the member.

American National Standard SJI 100 - 2020

4.5.2.2 Shop Splices: Shop splices shall be permitted to occur at any point in chord or web members. Splices shall be designed for the member force, but not less than 50 percent of the member strength. All component parts comprising the cross section of the chord or web member (including reinforcing plates, rods, etc.) at the point of the splice shall develop a nominal tensile strength of at least 1.2 times the product of the yield strength and the full design area of the chord or web. The "full design area" shall be defined as the minimum required area such that the required stress will be less than the design (LRFD) or allowable (ASD) stress.

User Note: For more information on welding, see Steel Joist Institute Technical Digest 8, "Welding of Open Web Steel Joists and Joist Girders".

4.5.3 Field Splices

Field Splices shall be designed by the manufacturer and shall be either bolted or welded. Splices shall be designed for the member force, but not less than 50 percent of the member strength.

4.5.4 Eccentricity

Members connected at a joint shall have their center of gravity lines meet at a point, where practical. Ends of joists or Joist Girders shall be proportioned to resist bending produced by eccentricity at the support.

For a single component web member, the eccentricity shall be permitted to be neglected where it does not exceed the lesser of three-quarters of the over-all dimension of the chord or 2" (51 mm). This eccentricity, measured in the plane of the joist, shall be the perpendicular distance from the centroidal axis of that web member to the point on the centroidal axis of the chord which is vertically above or below the intersection of the centroidal axis of the web member(s) forming the joint in accordance with Figure 4.5-1.

For a web member composed of at least two shapes, the eccentricity on either side of the neutral axis of chord members, measured in the plane of the joist at the joint work point, shall be permitted to be neglected where the web intersect point does not exceed one and one-half times the distance between the neutral axis and the back of the chord in accordance with Figure 4.5-2.

If these limits are exceeded, provision shall be made for the stresses due to eccentricity.

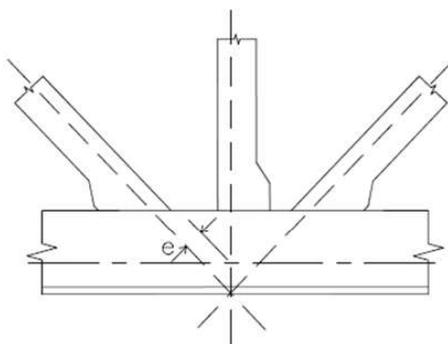


FIGURE 4.5-1

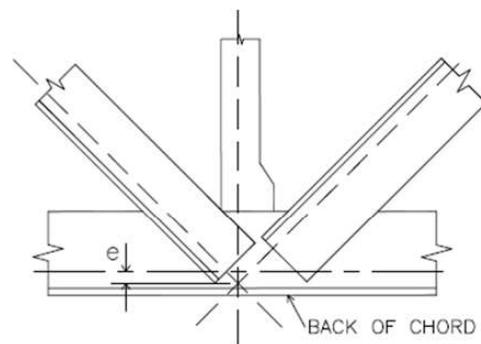


FIGURE 4.5-2

American National Standard SJI 100 - 2020

4.6 CAMBER

Steel joists and Joist Girders 100'-0" or less shall have a manufactured camber in accordance with Table 4.6-1:

TABLE 4.6-1

TOP CHORD LENGTH		APPROXIMATE CAMBER	
20'-0"	(6096 mm)	1/4"	(6 mm)
30'-0"	(9144 mm)	3/8"	(10 mm)
40'-0"	(12192 mm)	5/8"	(16 mm)
50'-0"	(15240 mm)	1"	(25 mm)
60'-0"	(18288 mm)	1 1/2"	(38 mm)
70'-0"	(21336 mm)	2"	(51 mm)
80'-0"	(24384 mm)	2 3/4"	(70 mm)
90'-0"	(27432 mm)	3 1/2"	(89 mm)
100'-0"	(30480 mm)	4 1/4"	(108 mm)

For lengths exceeding 100'-0", manufactured camber equal to Span/300 shall be used.

User Note: The specifying professional shall give consideration to coordinating this approximate camber with adjacent framing.

4.7 VERIFICATION OF DESIGN AND MANUFACTURE

User Note: This Section is included as part of this Specification since the verification of design and manufacture is a requirement of any Steel Joist Institute member company in order to be in compliance with this Specification. This Section applies only to a Steel Joist Institute member manufacturer.

4.7.1 Design Calculations

Companies manufacturing any K-Series, LH-Series, DLH-Series Joists or Joist Girders shall submit design data to the Steel Joist Institute, or an independent agency approved by the Steel Joist Institute, for verification of compliance with this Specification. Design data shall be submitted in detail and in the format specified by the Steel Joist Institute.

4.7.2 Tests of Chord and Web Members

Each manufacturer shall, at the time of design review by the Steel Joist Institute, verify by tests that the design, in accordance with Section 4.1 through Section 4.5, provides the theoretical strength of critical members. Such tests shall be evaluated considering the actual yield strength of the members of the test joists.

Material tests for determining mechanical properties of component members shall be conducted.

4.7.3 Tests of Joints and Connections

Each manufacturer shall, at the time of design review by the Steel Joist Institute, verify by shear tests on representative joints of typical joists that connections will meet the provision of Section 4.5.2. Chord and web members shall be permitted to be reinforced for such tests.

American National Standard SJI 100 - 2020

4.7.4 In-Plant Inspections

Each manufacturer shall verify their ability to manufacture K-Series, LH-Series, DLH-Series Joists and Joist Girders through periodic In-Plant Inspections. Inspections shall be performed by an independent agency approved by the Steel Joist Institute. The frequency, manner of inspection, and manner of reporting shall be determined by the Steel Joist Institute. The plant inspections shall not represent a guarantee of the quality of any specific joists; this responsibility shall lie fully and solely with the individual manufacturer.

**SECTION 5.
APPLICATION****5.1 USAGE**

5.1.1 Scope: This Specification shall apply to any type of structure where floors or roofs are to be supported directly by steel joists installed as hereinafter specified or where steel joists are to be supported directly by Joist Girders installed as hereinafter specified. Where joists or Joist Girders are used other than on simple spans under uniformly distributed loading for joists, or under equal concentrated gravity loading for Joist Girders, as prescribed in Section 4.1, they shall be designed to limit the required stresses to those listed in Section 4.2. The magnitude and location of all loads and forces to be considered in the joist or Joist Girder design shall be provided on the structural drawings.

5.1.2 Continuous Frame Action: Where a rigid connection of the bottom chord is to be made to a column or other structural support, the steel joist or Joist Girder is then no longer simply-supported, and the system shall be investigated for continuous frame action by the specifying professional. The specifying professional shall design the supporting structure, including the design of columns, connections, and moment plates. This design shall account for the stresses caused by lateral forces and the stresses due to connecting the bottom chord to the column or other structural support.

The designed detail of a rigid type connection and moment plates shall be shown on the structural drawings by the specifying professional. The moment plates shall be furnished by other than the joist manufacturer.

User Note: For further reference concerning continuous frame action and their connections, refer to Steel Joist Institute Technical Digest No. 11, "Design of Lateral Load Resisting Frames Using Steel Joists and Joist Girders".

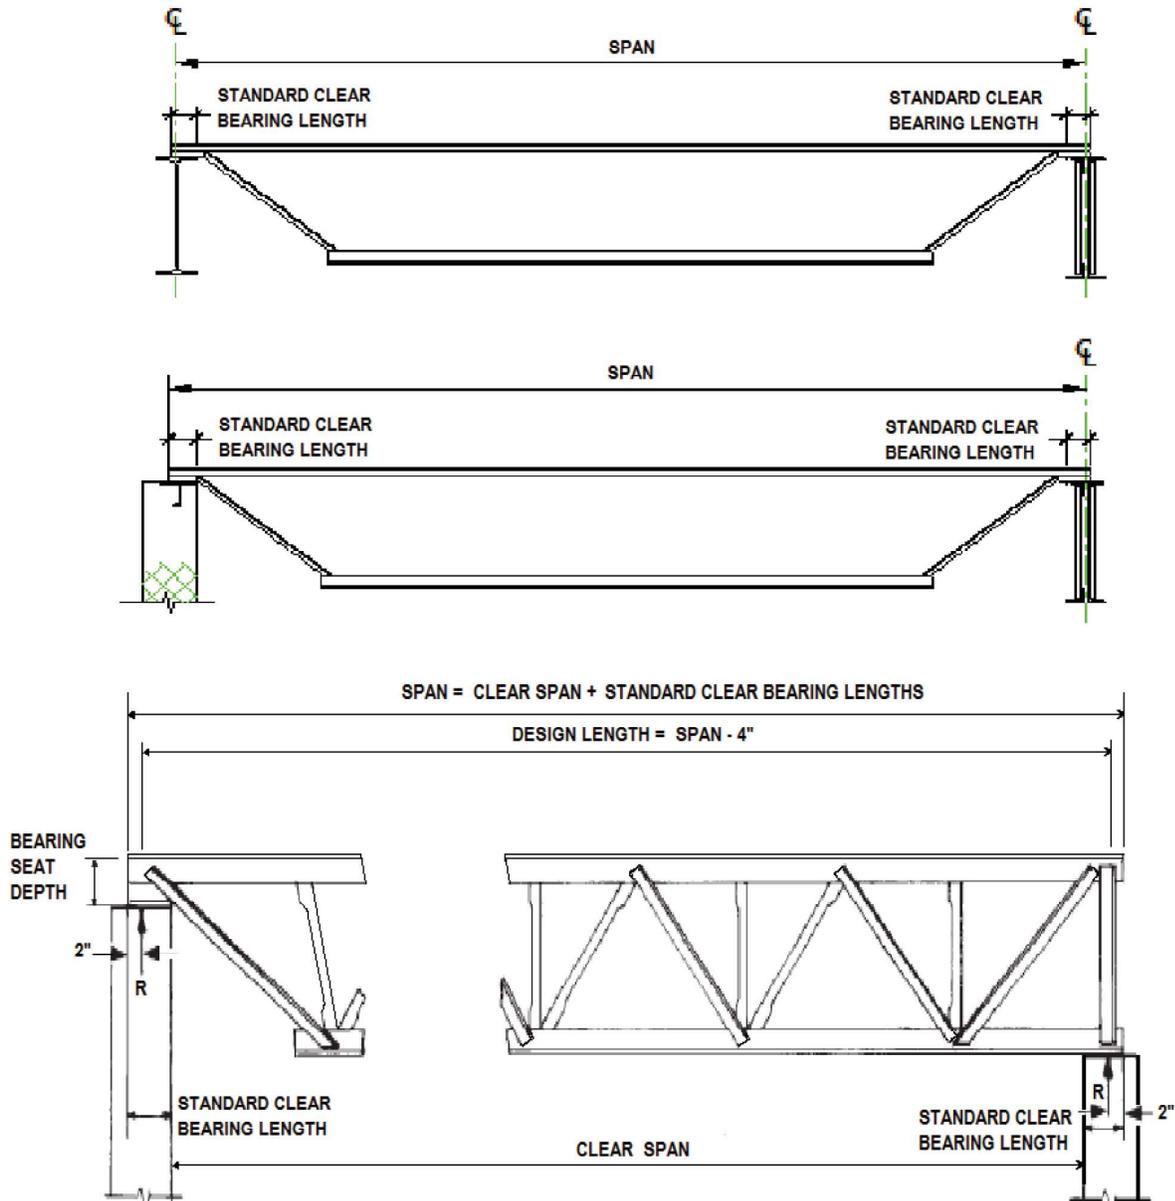
5.2 SPAN

Except for joist substitutes, the span of a joist or Joist Girder shall not exceed 24 times the depth. Design length shall equal the span minus 4 inches (102 mm) as shown in Figure 5.2-1 "Definition of Span".



American National Standard SJI 100 - 2020

Figure 5.2-1
DEFINITION OF SPAN
(U. S. Customary Units)



- NOTES:
- 1) DESIGN LENGTH = SPAN - 4"
 - 2) MINIMUM BEARING LENGTHS SHALL MEET THE REQUIREMENTS OF SECTION 5.4. BEARING LENGTHS SHOWN MAY VARY BETWEEN STANDARD CLEAR BEARING AND MINIMUM BEARING LENGTH.
 - 3) PARALLEL CHORD JOISTS INSTALLED TO A SLOPE GREATER THAN 1/2 INCH PER FOOT SHALL USE A SPAN DEFINED BY THE LENGTH ALONG THE SLOPE.

American National Standard SJI 100 - 2020

5.3 DEPTH

Steel joists or Joist Girders shall have either parallel chords or a top chord pitch of up to 1/2 inch per foot (1:24). The steel joist or Joist Girder designation depth or nominal depth shall be the depth at mid-span, except for double pitched joists which shall be the depth at the ridge.

5.4 END SUPPORTS

Consideration of the reactions, vertical and lateral, shall be taken by the specifying professional in the design of the steel support, or the steel bearing plate on masonry or concrete. The standard location of the end reaction shall be 2" (51 mm) from the end of the span (exclusive of extensions) at each end of the steel joist or Joist Girder as shown in Figure 5.2-1 "Definition of Span". The standard end reaction location shall require the minimum bearing lengths shown in Table 5.4-1.

TABLE 5.4-1

JOIST SECTION NUMBER ¹	STANDARD CLEAR BEARING LENGTH	MINIMUM BEARING LENGTH ON STEEL
K1-12	4" (102 mm)	2 ½" (64 mm)
LH02-06	6" (152 mm)	2 ½" (64 mm)
LH07-17, DLH10-17, JG	6" (152 mm)	4" (102 mm)
LH/DLH18-25, JG ²	6" (152 mm)	6" (152 mm)
⁽¹⁾ Last digit(s) of joist designation shown in Load Table. ⁽²⁾ Joist Girders with a self weight greater than 50 plf (0.73 kN/m).		

If the specifying professional requires the end reaction to be located at a distance from the face of support more than the standard clear bearing length values shown in Table 5.4-1 minus 2" (51 mm), the structural drawings shall indicate the required special location of the end reaction. The seat depth shall also be increased to the special minimum bearing seat depth per Table 5.4-3.

5.4.1 Masonry and Concrete

5.4.1.1 Scope: A K-Series, LH-Series, DLH-Series Joist or Joist Girder end supported by masonry or concrete shall bear on steel bearing plates and shall be designed as steel bearing.

5.4.1.2 Bearing Length: The ends of K-Series Joists shall extend a distance of not less than 4 inches (102 mm) over the face of masonry or concrete support unless it is deemed necessary to bear less than 4 inches (102 mm) over the support. The ends of LH-Series, DLH-Series Joists and Joist Girders shall extend a distance of not less than 6 inches (152 mm) over the face of masonry or concrete support unless it is deemed necessary to bear less than 6 inches (152 mm) over the support.

5.4.1.3 Anchorage: K-Series, LH-Series, DLH-Series Joists and **Joist Girders** shall be anchored to the steel bearing plate per Section 5.7.

The steel bearing plate shall be located not more than 1/2 inch (13 mm) from the face of the wall. If the steel bearing plate is located more than 1/2 inch (13 mm) from the face of the wall, or the minimum bearing over the masonry or concrete support cannot be provided as shown in Table 5.4-1, special consideration shall be given to the design of the steel bearing plate and the masonry or concrete by the specifying professional.

The steel bearing plate width shall not be less than that shown in Table 5.4-2 perpendicular to the length of the joist. The plate is to be designed by the specifying professional and shall be furnished by other than the joist manufacturer.

American National Standard SJI 100 - 2020

TABLE 5.4-2

JOIST SECTION NUMBER ¹	MINIMUM BEARING PLATE WIDTH
K1-12, LH02-06	7" (178 mm)
LH07-17, DLH10-17, JG	9" (229 mm)
LH/DLH18-25, JG ²	14" (356 mm)
⁽¹⁾ Last digit(s) of joist designation shown in Load Table.	
⁽²⁾ Joist Girders with a self weight greater than 50 plf (0.73 kN/m).	

5.4.2 Steel

The ends of K-Series, LH-Series, DLH-Series Joists and Joist Girders shall be anchored to the support per Section 5.7.

5.4.3 Bearing Depth

The standard non-sloping bearing seat depths shall be as shown in Table 5.4-3. If the steel joist slopes 3/8 inch per foot or greater, the high end bearing seat shall require additional depth due to the slope.

User Note: The Steel Joist Institute Code of Standard Practice provides guidance for determining additional seat depth requirements for sloped joists.

TABLE 5.4-3

JOIST SECTION NUMBER ¹	STANDARD BEARING SEAT DEPTH	STANDARD CLEAR BEARING LENGTH	SPECIAL MINIMUM BEARING SEAT DEPTH ²
K1-12	2 ½" (64 mm)	4" (102 mm)	0.6 x (RP + 2 ½" (64 mm))
LH02-17, DLH10-17	5" (127 mm)	6" (152 mm)	0.6 x (RP + 4" (102 mm))
LH/DLH18-25	7 ½" (191 mm)	6" (152 mm)	0.6 x (RP + 4" (102 mm)) + 2 ½" (64 mm)
JG	7 ½" (191 mm)	6" (152 mm)	RP + 4" (102 mm)
⁽¹⁾ Last digit(s) of joist designation shown in Load Table.			
⁽²⁾ RP is equal to the distance the reaction is to occur from the face of the wall or leading edge of support member. The equation is not applicable for the high end of a sloped joist or Joist Girder.			

When the specifying professional requires the steel joist or Joist Girder reaction to occur at or near the centerline of the wall or other support, a special bearing seat depth shall be required and a note shall be placed on the structural drawings identifying where the reaction is to occur. The specified bearing seat depth shall be increased according to Table 5.4-3 to allow for this special requirement.

5.5 BRIDGING or BRACING

Joist Girders shall be proportioned such that they can be erected without bridging. Therefore, the following requirements shall be met:

- The ends of the bottom chord shall be restrained from lateral movement to brace the girder from overturning. For Joist Girders at columns in steel frames, restraint shall be provided by a stabilizer plate on the column.
- No other loads shall be placed on the Joist Girder until the steel joists bearing on the Joist Girder are in place and positively attached to the Joist Girder.

American National Standard SJI 100 - 2020

User Note: See Section 5.12 for bridging or bracing required for uplift forces.

Steel joist top and bottom chord bridging shall be required and shall consist of one or both of either horizontal or diagonal bridging.

5.5.1 Horizontal Bridging

Horizontal bridging lines shall consist of continuous horizontal steel members. The ℓ/r ratio of the bridging member shall not exceed 300, where ℓ is the distance in inches (millimeters) between attachments and r is the least radius of gyration of the bridging member.

5.5.2 Diagonal Bridging

Diagonal bridging lines shall consist of cross-bracing with a ℓ/r ratio of not more than 200, where ℓ is the distance in inches (millimeters) between connections and r is the least radius of gyration of the bracing member. Where cross-bracing members are connected at their point of intersection, the ℓ distance shall be taken as the distance in inches (millimeters) between connections at the point of intersection of the bridging members and the connections to the chords of the joists.

5.5.2.1 Diagonal Erection Bridging

User Note: Joists exhibit varying degrees of stability dependent upon the span, depth, member sizes, self weight and other parameters. Bolted diagonal Erection Bridging which must be installed prior to releasing hoisting cables may be required.

Where required as identified below, bolted diagonal Erection Bridging shall be required and shall be in accordance with the following:

- (a) For joist spans up through and including 60 feet (18288 mm) in length;

Welded horizontal bridging shall be permitted except where the row of bridging nearest the center is required to be bolted diagonal Erection Bridging as indicated by the **Red shaded area** in the Load Tables. Hoisting cables shall not be released until this row of bolted diagonal Erection Bridging is completely installed and anchored.

Bolted diagonal Erection Bridging shall be provided as required in the SJI Load Tables wherever a standard SJI Section Number designation is specified. For spans 60 feet (18288mm) or less, in the absence of a standard SJI Section Number designation, minimum bolted diagonal Erection Bridging requirements shall be determined by:

- 1) Matching the joist design to an equivalent standard SJI Section Number designation to determine the span at which Erection Bridging is needed as designated in the tables; or
- 2) Using Equation 5.5-1 to determine the joist stability and the need for Erection Bridging.

$$W = \frac{-b + \sqrt{b^2 - 4 \cdot a \cdot c}}{2 \cdot a} ; \quad \text{If, } \frac{w_u}{w_{actual}} > 1.00 \text{ Erection Bridging is not required.} \quad (5.5-1)$$

$$a = \left(\frac{\pi^2 + 3}{24} \right)^2$$

$$b = P \cdot \frac{\pi^2 + 3}{12} \cdot \frac{\pi^2 + 4}{16} - \frac{\pi^4 \cdot E \cdot I_y}{2 \cdot (k \cdot L)^3} \cdot \left[\beta_x \cdot \left(\frac{\pi^2 - 3}{24} \right) - \frac{y_o}{2} \right]$$

$$c = (P)^2 \left(\frac{\pi^2 + 4}{16} \right)^2 - \frac{\pi^4 \cdot E \cdot I_y}{2 \cdot (k \cdot L)^3} \cdot \left[P \cdot \left(\beta_x \cdot \frac{\pi^2 - 4}{16} - a_e \right) + \frac{\pi^4 \cdot E \cdot C_w}{2 \cdot (k \cdot L)^3} + \frac{\pi^2 \cdot G \cdot J}{2 \cdot k \cdot L} \right]$$



American National Standard SJI 100 - 2020

Where:

P = Factored weight of erector = 1.2 x (assumed weight of 250 lbs.) = 300 lbs. (1334 N)

E = Modulus of elasticity = 29,000,000 psi (200,000 MPa)

I_y = Joist moment of inertia about y-axis, in.⁴ (mm⁴) $I_y = I_{yt} + I_{yb}$

I_{yt} = Top chord moment of inertia about y-axis, in.⁴ (mm⁴)

I_{yb} = Bottom chord moment of inertia about y-axis, in.⁴ (mm⁴)

L = Joist Span, in. (mm)

k = Effective length factor = 0.85

β_x = Cross-Sectional parameter
$$\beta_x = \frac{1}{I_x} \left[A_b \cdot (d_e - y)^3 - A_t \cdot y^3 \right] - 2 \cdot y_o$$

A_b = Area of bottom chord, in.² (mm²)

A_t = Area of top chord, in.² (mm²)

d_e = Joist effective depth, in. (mm) $d_e = d - y_t - y_b$

y_t = Neutral axis of top chord, in. (mm)

y_b = Neutral axis of bottom chord, in. (mm)

y = Distance from centroid of top chord to centroid of cross section, in. (mm) $y = \frac{A_b \cdot d_e}{A_t + A_b}$

I_x = Joist moment of inertia about x-axis, in.⁴ (mm⁴) $I_x = A_t y^2 + A_b (d_e - y)^2$

y_o = Distance from centroid of cross section to shear center, in. (mm) $y_o = -y + \frac{I_{yb} \cdot d_e}{I_y}$

a_e = Vertical location of load P from shear center (locate at joist center of gravity), in. (mm), where $a_e = y_o$

C_w = Warping constant
$$C_w = \frac{d_e^2 \cdot I_{yb} \cdot I_{yt}}{I_y}$$

G = Shear modulus, psi (MPa) $G = 0.385E$

J = St. Venant torsion constant, in.⁴ (mm⁴) $J = \frac{1}{3} (A_t \cdot t_t^2 + A_b \cdot t_b^2)$

t_t = Thickness of top chord, in. (mm)

t_b = Thickness of bottom chord, in. (mm)

w_u = Ultimate lateral buckling load $w_u = \frac{W \cdot 12}{L}$, plf $w_u = \frac{W}{L}$, (kN/m)

w_{actual} = Joist self-weight, plf (kN/m)

American National Standard SJI 100 - 2020

- b) For joist spans greater than 60 feet (18288 mm) in length; Bolted diagonal Erection Bridging shall be used as indicated by the **Blue and Gray shaded areas** of the Load Tables. Hoisting cables shall not be released until all rows of bolted diagonal Erection Bridging are completely installed and anchored. Where the joist spacing is less than 0.70 x joist depth, bolted horizontal bridging shall be used in addition to bolted diagonal Erection Bridging.
- c) The bolted diagonal Erection Bridging determined by Section 5.5.2.1a and Section 5.5.2.1b shall be considered a minimum. This bolted diagonal Erection Bridging shall be indicated on the placement plans.

User Note: Joists with special profiles having a higher center of gravity as compared to a parallel chord joist, joists which are canted, or joists having any condition which may create instability, may require additional bridging and/or special erection methods.

5.5.3 Quantity and Spacing of Bridging

5.5.3.1 Scope: Bridging shall be properly spaced and anchored to support the decking and the employees prior to the attachment of the deck to the top chord. The maximum spacing between lines of bridging, ℓ_{brmax} shall be the lesser of,

$$\ell_{brmax} = \left(124 + 0.67 d_j + 28 \frac{d_j}{L} \right) r_y, \text{ in.} \quad (5.5-2a)$$

$$\ell_{brmax} = \left(124 + 0.026 d_j + 0.34 \frac{d_j}{L} \right) r_y, \text{ mm} \quad (5.5-2b)$$

or,
$$\ell_{brmax} = 170 r_y \quad (5.5-3)$$

Where:

d_j is the steel joist depth, in. (mm)

L is the joist span length, ft. (m)

r_y is the radius of gyration of the top chord about the vertical axis of the joist cross section, in. (mm)

5.5.3.2 Number of Rows: The number of rows of top chord bridging shall not be less than as shown in Table 5.5-1 and the spacing shall meet the requirements of Equations 5.5-2 and 5.5-3. The number of rows of bottom chord bridging, including bridging required per Section 5.12, shall not be less than the number of top chord rows. Rows of bottom chord bridging shall be permitted to be spaced independently of rows of top chord bridging. The spacing of rows of bottom chord bridging shall meet the slenderness requirement of Section 4.3 and any specified strength requirements.

5.5.3.3 DLH Joist Section 21 and Greater: For DLH-Series joist Section Number 21 and greater, bridging shall be installed near a bottom chord panel point or an extra web member shall be furnished to brace the bottom chord for the vertical component of the bridging force equal to the horizontal bracing force.

American National Standard SJI 100 - 2020

TABLE 5.5-1

U.S. CUSTOMARY UNITS										
NUMBER OF ROWS OF TOP CHORD BRIDGING ²										
Section Number ¹	Joist Depth	1 Row	2 Rows	3 Rows	4 Rows	5 Rows	6 Rows	7 Rows	8 Rows	9 Rows
K1	All	17	>17 to 26	>26 to 28						
K2	All	21	>21 to 30	>30 to 32						
K3	All	18	>18 to 26	>26 to 40						
K4	All	20	>20 to 30	>30 to 41	>41 to 48					
K5	12K to 24K	20	>20 to 30	>30 to 42	>42 to 48					
	26K	28	>28 to 41	> 41 to 52						
K6	14K to 24K	20	>20 to 31	>31 to 42	>42 to 48					
	26K & 28K	28	>28 to 41	>41 to 54	>54 to 56					
K7	16K to 24K	23	>23 to 34	>34 to 48						
	26K to 30K	29	>29 to 44	>44 to 60						
K8	24K	25	>25 to 39	>39 to 48						
	26K to 30K	29	>29 to 44	>44 to 60						
K9	16K to 24K	22	>22 to 34	>34 to 48						
	26K to 30K	29	>29 to 44	>44 to 60						
K10	18K to 24K	22	>22 to 38	>38 to 48						
	26K to 30K	29	>29 to 48	>48 to 60						
K11	22K	24	>24 to 39	>39 to 44						
	30K	34	>34 to 49	>49 to 60						
K12	24K	25	>25 to 43	>43 to 48						
	26K to 30K	29	>29 to 47	>47 to 60						
LH02-03	All	20	>20 to 30	>30 to 40	>40					
LH04-05	All	22	>22 to 33	>33 to 44	>44 to 55	>55				
LH06-08	All	26	>26 to 45	>45 to 60	>60 to 75	>75				
LH09	All	26	>26 to 48	>48 to 64	>64 to 80	>80				
LH/DLH10	All	28	>28 to 54	>54 to 72	>72 to 90	>90				
LH/DLH11	All	30	>30 to 54	>54 to 72	>72 to 90	>90 to 108	>108			
LH/DLH12	All	34	>34 to 55	>55 to 74	>74 to 92	>92 to 111	>111			
LH/DLH13	All	36	>36 to 63	>63 to 84	>84 to 105	>105 to 126	>126			
LH/DLH14	All	38	>38 to 64	>64 to 86	>86 to 107	>107 to 129	>129			
LH/DLH15	All	42	>42 to 73	>73 to 98	>98 to 122	>122 to 147	>147			
LH/DLH 16-17	All	44	>44 to 75	>75 to 100	>100 to 125	>125 to 150	>150 to 175	>175		
LH/DLH 18-20	All	52	>52 to 78	>78 to 104	>104 to 130	>130 to 156	>156 to 182	>182 to 208	>208 to 234	>234
LH/DLH 21-25	All	60	>60 to 90	>90 to 120	>120 to 150	>150 to 180	>180 to 210	>210		

(1) Last digit(s) of joist designation shown in Load Table.
 (2) Distances are Joist Span lengths in feet – See “Definition of Span” Figure 5.2-1. Refer to the Joist Load Table and Specification Section 6 for required bolted diagonal bridging and additional stability requirements. See Section 5.12 for additional bridging required for uplift design.



American National Standard SJI 100 - 2020

5.5.4 Sizing of Bridging

Horizontal and diagonal bridging shall be capable of resisting the nominal unfactored horizontal compressive force, P_{br} given in Equation 5.5-4.

$$P_{br} = 0.0025 n A_t F_{\text{construction}}, \text{ kips (N)} \quad (5.5-4)$$

Where:

$n = 8$ for horizontal bridging

$n = 2$ for diagonal bridging

A_t = cross sectional area of joist top chord, in.² (mm²)

$F_{\text{construction}}$ = assumed ultimate stress in top chord to resist construction loads, determined in accordance with the following:

$$F_{\text{construction}} = \left(\frac{\pi^2 E}{\left(\frac{0.9 \ell_{brmax}}{r_y} \right)^2} \right) \geq 12.2 \text{ ksi} \quad (5.5-5a)$$

$$F_{\text{construction}} = \left(\frac{\pi^2 E}{\left(\frac{0.9 \ell_{brmax}}{r_y} \right)^2} \right) \geq 84.1 \text{ MPa} \quad (5.5-5b)$$

Where:

E = Modulus of Elasticity of steel = 29,000 ksi (200,000 MPa)

and $\frac{\ell_{brmax}}{r_y}$ is determined from Equations 5.5-2 or 5.5-3

The bridging nominal horizontal unfactored compressive forces, P_{br} , shall be in accordance with Table 5.5-2.

American National Standard SJI 100 - 2020

TABLE 5.5-2

BRIDGING NOMINAL HORIZONTAL UNFACTORED COMPRESSIVE FORCE					
JOIST SECTION NUMBER ¹	HORIZONTAL BRIDGING P_{br} (n=8)		REQUIRED BRIDGING CONNECTION WELD ²	DIAGONAL BRIDGING P_{br} (n=2)	
	Lbs.	(N)	In.	Lbs.	(N)
K1-8	340	(1512)	1/8" x 1" (3mm x 25mm)	85	(378)
K9-10, LH02-03	450	(2002)		113	(503)
K11-12, LH04-05	560	(2491)		140	(623)
LH06-08	750	(3336)		188	(836)
LH09	850	(3781)		213	(945)
LH/DLH10	900	(4003)		225	(1001)
LH/DLH11	950	(4226)		238	(1056)
LH/DLH12	1100	(4893)		275	(1223)
LH/DLH13	1200	(5338)		300	(1334)
LH/DLH14	1300	(5783)		325	(1446)
LH/DLH15	1450	(6450)		363	(1612)
LH/DLH16-17	1850	(8229)	1/8" x 1 1/2" (3mm x 38mm)	463	(2057)
LH/DLH18-20	2350	(10453)		585	(2602)
LH/DLH21-22	3150	(14012)	1/8" x 2" (3mm x 51mm)	790	(3514)
LH/DLH23-24	4130	(18371)	1/8" x 3" (3mm x 76mm)	1035	(4604)
LH/DLH25	4770	(21218)		1195	(5316)

(¹) Last digit(s) of joist designation shown in Load Table.
(²) Or other connection type designed for the required force.

5.5.5 Connections

Connections to the joist chords shall be made by welding or mechanical means and shall be capable of resisting the unfactored or nominal horizontal force, P_{br} , of Equation 5.5-4 but not less than 700 pounds (3114 N).

5.5.6 Bottom Chord Bearing Joists

Where bottom chord bearing joists are utilized, a row of diagonal bridging shall be provided near the support(s). This bridging shall be installed and anchored before the hoisting cable(s) is released.

5.6 INSTALLATION OF BRIDGING

Bridging shall support the top and bottom chords against lateral movement during the construction period and shall hold the steel joists in the approximate position as shown on the joist placement plans.

The ends of all bridging lines terminating at walls or beams shall be anchored thereto.

American National Standard SJI 100 - 2020

5.7 BEARING SEAT ATTACHMENTS

5.7.1 Masonry and Concrete

Ends of K-Series, LH-Series, and DLH-Series Joists and Joist Girders resting on steel bearing plates on masonry or structural concrete shall be attached thereto, as shown in Table 5.7-1, with a minimum of two fillet welds, or with two bolts, or the equivalent.

5.7.2 Steel

Ends of K-Series, LH-Series, and DLH-Series Joists and Joist Girders resting on steel supports shall be attached thereto, as shown in Table 5.7-1, with a minimum of two fillet welds, or with two bolts, or the equivalent. Where K-Series, LH-Series and DLH-Series Joists and Joist Girders are used to provide lateral stability to the supporting member, the final connection shall be made by welding or as designated by the specifying professional.

TABLE 5.7-1

JOIST SECTION NUMBER ¹	MINIMUM FILLET WELD	MINIMUM BEARING SEAT BOLTS FOR ERECTION
K1-12	2– 1/8" x 2 1/2" (3 x 64 mm)	2– 1/2" (13 mm) A307
LH02-06	2– 3/16" x 2 1/2" (5 x 64 mm)	
LH07-17, DLH10-17, JG	2– 1/4" x 2 1/2" (6 x 64 mm)	2– 3/4" (19 mm) A307
LH/ DLH18-25, JG ²	2– 1/4" x 4" (6 x 102 mm)	2– 3/4" (19 mm) A325
⁽¹⁾ Last digit(s) of joist designation shown in load table.		
⁽²⁾ Joist Girders with a self weight greater than 50 plf (0.73 kN/m).		

5.7.3 Uplift

Where uplift forces are a design consideration, roof joists shall be anchored to resist such forces and shall meet the requirements of Section 5.12.

5.8 JOIST SPACING

Joists shall be spaced so that the loading on each joist does not exceed the design load (LRFD or ASD) for the particular joist designation and span as shown in the applicable load tables.

5.9 FLOOR AND ROOF DECKS

5.9.1 Material

Floor and roof decks shall be permitted to consist of cast-in-place or pre-cast concrete or gypsum, cold-formed steel, wood, or other suitable material capable of supporting the required load at the specified joist spacing.

5.9.2 Thickness

Cast-in-place slabs shall be not less than 2 inches (51 mm) thick.



American National Standard SJI 100 - 2020

5.9.3 Centering

Centering for cast-in-place slabs shall be permitted to be ribbed metal lath, corrugated steel sheets, paper-backed welded wire fabric, removable centering or any other suitable material capable of supporting the slab at the designated joist spacing.

Centering shall not cause lateral displacement or damage to the top chord of joists during installation or removal of the centering or placing of the concrete.

5.9.4 Bearing

Slabs or decks shall bear uniformly along the top chords of the joists.

5.9.5 Attachments

The spacing of attachments along the joist top chord shall not exceed 36 inches (914 mm). Such attachments of the slab or deck to the top chords of joists shall be capable of resisting the forces given in Table 5.9-1.

TABLE 5.9-1

JOIST SECTION NUMBER ¹	NOMINAL FORCE REQUIRED ²
K1-12	100 lbs/ft. (1.46 kN/m)
LH02-04	120 lbs/ft. (1.75 kN/m)
LH05-09	150 lbs/ft. (2.19 kN/m)
LH/DLH10-17	200 lbs/ft. (2.92 kN/m)
LH/DLH18-19	250 lbs/ft. (3.65 kN/m)
LH/DLH20-21	300 lbs/ft. (4.38 kN/m)
LH/DLH22-24	420 lbs/ft. (6.13 kN/m)
LH/DLH25	520 lbs/ft. (7.59 kN/m)
⁽¹⁾ Last digit(s) of joist designation shown in Load Table.	
⁽²⁾ Nominal bracing force is unfactored.	

5.9.6 Wood Nailers

Where wood nailers are used, such nailers in conjunction with deck or slab shall be firmly attached to the top chords of the joists in conformance with Section 5.9.5.

5.9.7 Joist With Standing Seam Roofing or Laterally Unbraced Top Chords

Where the roof systems do not provide lateral stability for the steel joists in accordance with Section 5.9.5 sufficient stability shall be provided to brace the steel joists laterally under the full design load. For this condition, the compression chord design shall include the effects of both the in-plane and out-of-plane buckling of the steel joist (e.g., buckling about the vertical axis of the steel joist cross section). In any case where the attachment requirement of Section 5.9.5 is not achieved, out-of-plane strength shall be achieved by adjusting the bridging spacing and/or increasing the compression chord area and the y-axis radius of gyration. The effective slenderness ratio about the vertical axis equals $0.94 L/r_y$; where L is the bridging spacing in inches (millimeters) and r_y is the radius of gyration of the top chord in inches (millimeters). The maximum bridging spacing shall not exceed that specified in Section 5.5.3.

User Note: Some examples of roof systems which may not provide adequate top chord lateral stability may be standing seam roofs, skylights, or other openings which do not provide top chord attachments per Section 5.9.5.

American National Standard SJI 100 - 2020

Horizontal bridging members attached to the compression chords and their anchorages shall be designed for a compressive axial force, P_{br} , given in Equation 5.9-1.

$$P_{br} = 0.001nP + 0.004P\sqrt{n} \geq 0.0025nP, \text{ kips (N)} \quad (5.9-1)$$

Where n is the number of joists between end anchors and P is the chord design force in kips (N)

The attachment force between the horizontal bridging member and the compression chord shall be $0.01P$. Horizontal bridging attached to the tension chords shall be proportioned so that the slenderness ratio between attachments does not exceed 300. Diagonal bridging shall be proportioned so that the slenderness ratio between attachments does not exceed 200.

5.10 DEFLECTION

The deflection due to the design live load shall not exceed the following:

Floors: 1/360 of span.

Roofs: 1/360 of span where a plaster ceiling is attached or suspended, or
1/240 of span for all other cases.

The specifying professional shall give consideration to the effects of deflection and vibration in the selection of joists.

User Note: For further information on vibration, refer to Steel Joist Institute Technical Digest 5, "Vibration of Steel Joist-Concrete Slab Floors".

5.11 PONDING

The ponding investigation shall be performed by the specifying professional.

User Note: For further reference, refer to Steel Joist Institute Technical Digest 3, "Structural Design of Steel Joist Roofs to Resist Ponding Loads" and AISC 360.

5.12 UPLIFT

Where uplift forces due to wind are a design requirement, these forces shall be indicated on the structural drawings in terms of NET uplift in pounds per square foot (Pascals). The structural drawings shall indicate if the net uplift is based upon an LRFD or ASD load combination. When these forces are specified, they shall be considered in the design of joists, Joist Girders, and required bridging or bracing. Wherever uplift due to wind forces is a design consideration, the following shall be required:

- For joists, a single line of **bottom chord** bridging shall be provided near the first bottom chord panel points.
- For **Joist Girders**, if the ends of the bottom chord are not strutted and extended to column stabilizer plates, bracing shall be provided near the first bottom chord panel points.

User Note: For further reference, refer to Steel Joist Institute Technical Digest 6, "Structural Design of Steel Joist Roofs to Resist Uplift Loads".

5.13 DIAPHRAGMS AND COLLECTORS

Where diaphragm collector forces due to wind or seismic forces are a design requirement, these forces shall be indicated on the structural drawings. The structural drawings shall indicate the nominal (unfactored) forces. The structural drawings shall also indicate the Seismic Design Category, and the Seismic Force Resisting System type, and applicable seismic design coefficients. When this data is specified, joist collectors or chords in horizontal diaphragm systems, shall be designed in conformance with the provisions of Section 4 through Section 6. End connections and splices in joists incorporated into Seismic Force Resisting System (SFRS) as horizontal diaphragms as collectors or chords shall adhere to the requirements stipulated by the applicable building code.

American National Standard SJI 100 - 2020

5.14 INSPECTION

Joists shall be inspected by the manufacturer before shipment to verify compliance of materials and workmanship with the requirements of this Specification.

User Note: If the purchaser requires an inspection of the steel joists or Joist Girders by someone other than the manufacturer's own inspectors, they shall be permitted to reserve the right to do so in their "Invitation to Bid" or the accompanying "Job Specifications". Arrangements shall be made with the manufacturer for such inspection of the joists or Joist Girders at the manufacturing shop by the purchaser's inspectors at purchaser's expense.

5.15 PARALLEL CHORD SLOPED JOISTS AND JOIST GIRDERS

The span of a parallel chord sloped joist or Joist Girder shall be defined by the length along the slope. Minimum depth, load-carrying capacity, and bridging requirements shall be determined by the sloped definition of span. The Load Table capacity shall be the component normal to the joist.

SECTION 6**ERECTION STABILITY
AND HANDLING**

As a minimum, erection stability and handling of joists and Joist Girders shall meet the requirements of this Section 6.

User Note: Additional requirements for erection of steel joists and Joist Girders can be found in Steel Joist Institute Technical Digest No. 9, "Handling and Erection of Steel Joists and Joist Girders".

6.1 STABILITY REQUIREMENTS

User Note: It is not recommended that an erector climb on unbridged joists, extreme caution shall be exercised since unbridged joists exhibit some degree of instability under the erector's weight.

- a) In steel framing, where joists/Joist Girders are utilized at column lines, the joist/Joist Girder shall be field-bolted at the column. Before hoisting cables are released and before an employee is allowed on the joists/Joist Girder the following conditions shall be met:
 - 1) The seat at each end of the joist/Joist Girder is attached in accordance with Section 5.7. Where a bolted seat connection is used for erection purposes, as a minimum, the bolts shall be snug tightened. The snug tight condition shall be defined as the tightness that exists where all plies of a joint are in firm contact. This shall be attained by a few impacts of an impact wrench or the full effort of an employee using an ordinary spud wrench.
 - 2) Where stabilizer plates are required the joist/Joist Girder bottom chord shall engage the stabilizer plate.

During the construction period, the contractor shall provide means for the adequate distribution of loads so that the carrying capacity of any joist or Joist Girder is not exceeded.

- b) Before an employee is allowed on the steel joist: BOTH ends of joists at columns (or joists designated as column joists) shall be attached to its supports. For all other joists a minimum of one end shall be attached before the employee is allowed on the joist. The attachment shall be in accordance with Section 5.7.

Where a bolted seat connection is used for erection purposes, as a minimum, the bolts shall be snug tightened. The snug tight condition shall be defined as the tightness that exists where all plies of a joint are in firm contact. This shall be attained by a few impacts of an impact wrench or the full effort of an employee using an ordinary spud wrench.

American National Standard SJI 100 - 2020

- c) On steel joists that do not require erection bridging as shown by either the unshaded area of the Load Tables or as determined by Section 5.5.2.1, only one employee shall be allowed on the steel joist until all bridging is installed and anchored.
- d) Where the span of the steel joist is within the Red shaded area of the Load Table, or in the absence of a standard SJI Section Number designation and Erection Bridging is required in accordance with Section 5.5.2.1, the following shall apply:
 - 1) The row of bridging nearest the midspan of the steel joist shall be bolted diagonal Erection Bridging; and
 - 2) Hoisting cables shall not be released until this bolted diagonal Erection Bridging is installed and anchored, unless an alternate method of stabilizing the joist has been provided; and
 - 3) No more than one employee shall be allowed on these spans until all other bridging is installed and anchored.
- e) Where the span of the steel joist is within the Blue shaded area of the Load Table, the following shall apply:
 - 1) All rows of bridging shall be bolted diagonal bridging; and
 - 2) Hoisting cables shall not be released until the two rows of bolted diagonal Erection Bridging nearest the third points of the steel joist are installed and anchored; and
 - 3) No more than two employees shall be allowed on these spans until all bridging is installed and anchored.
- f) Where the span of the steel joist is in the Gray shaded area of the Load Table, the following shall apply:
 - 1) All rows of bridging shall be bolted diagonal bridging; and
 - 2) Hoisting cables shall not be released until all bridging is installed and anchored; and
 - 3) No more than two employees shall be allowed on these spans until all other bridging is installed and anchored.
- g) Where permanent bridging terminus points cannot be used during erection, additional temporary bridging terminus points shall be required to provide lateral stability.
- h) In the case of bottom chord bearing joists, the ends of the joist shall be restrained laterally per Section 5.5.6 before releasing the hoisting cables.
- i) After the joist is straightened and plumbed, and all bridging is completely installed and anchored, the ends of the joists shall be fully connected to the supports in accordance with Section 5.7.

6.2 LANDING AND PLACING LOADS

- a) Except as stated in Section 6.2(d), no "construction loads" shall be allowed on the steel joists until all bridging is installed and anchored, and all joist bearing ends are attached.

User Note: For definition of "construction load" see Code of Federal Regulations (CFR), Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R - Steel Erection, §1926.751 Definitions; January 18, 2001, Washington, D.C.

- b) During the construction period, loads placed on the steel joists shall be distributed so as not to exceed the capacity of the steel joists.
- c) The weight of a bundle of joist bridging shall not exceed a total of 1000 pounds (454 kilograms). The bundle of joist bridging shall be placed on a minimum of three steel joists that are secured at one end. The edge of the bridging bundle shall be positioned within 1 foot (0.30 m) of the secured end.
- d) No bundle of deck shall be placed on steel joists until all bridging has been installed and anchored and all joist bearing ends attached, unless the following conditions are met:
 - 1) The contractor has first determined from a "qualified person" and documented in a site-specific erection plan that the structure or portion of the structure is capable of supporting the load;
 - 2) The bundle of decking is placed on a minimum of three steel joists;

American National Standard SJI 100 - 2020

- 3) The joists supporting the bundle of decking are attached at both ends;
- 4) At least one row of bridging is installed and anchored;
- 5) The total weight of the decking does not exceed 4000 pounds (1816 kilograms); and
- 6) The edge of the bundle of decking is placed within 1 foot (0.30 meters) of the bearing surface of the joist end.

User Note: For definition of “qualified person” see Code of Federal Regulations (CFR), Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R - Steel Erection, §1926.751 Definitions; January 18, 2001, Washington, D.C.

- e) The edge of the construction load shall be placed within 1 foot (0.30 meters) of the bearing surface of the joist end.

6.3 FIELD WELDING

All field welding shall be performed in accordance with the structural drawings. Field welding shall not damage the joists or Joist Girders.

On cold-formed steel members whose yield strength has been attained by cold working, and whose as-formed strength is used in the design, the total length of weld at any one point shall not exceed 50 percent of the overall developed width of the cold-formed section.

6.4 HANDLING

Particular attention shall be considered for the handling and erection of K-Series, LH-Series, DLH-Series steel joists and Joist Girders. Damage to the joists and accessories shall be avoided. Hoisting cables shall be attached at panel point locations and those locations shall be selected to minimize erection stresses.

Each joist shall be adequately braced laterally before any loads are applied. If lateral support is provided by bridging, the bridging lines as defined in Section 6.1(c), 6.1(d), 6.1(e), and 6.1(f) shall be anchored to prevent lateral movement.

6.5 FALL ARREST SYSTEMS

Steel joists and Joist Girders shall not be used as anchorage points for a fall arrest system unless written direction to do so is obtained from a “qualified person”.

User Note: For definition of “qualified person” see Code of Federal Regulations (CFR), Occupational Safety and Health Administration (OSHA), 29 CFR Part 1926, Safety Standards for Steel Erection; Subpart R - Steel Erection, §1926.751 Definitions; January 18, 2001, Washington, D.C.